

UNFCCC

CDM – Executive Board

page 1

CLEAN DEVELOPMENT MECHANISM PROJECT DESIGN DOCUMENT FORM (CDM-PDD) (Version 02 - in effect as of: 1 July 2004)

CONTENTS

- A. General description of <u>project activity</u>
- B. Application of a <u>baseline methodology</u>
- C. Duration of the project activity / Crediting period
- D. Application of a <u>monitoring methodology</u> and plan
- E. Estimation of GHG emissions by sources
- F. Environmental impacts
- G. <u>Stakeholders'</u> comments

Annexes

- Annex 1: Contact information on participants in the project activity
- Annex 2: Information regarding public funding
- Annex 3: <u>Baseline</u> information
- Annex 4: Monitoring plan



UNFCC

CDM – Executive Board

page 2

SECTION A. General description of project activity

A.1 Title of the <u>project activity</u>:

Lucélia Bagasse Cogeneration Project (LBCP). Version 2 B Date of the document: December 02nd, 2005.

The only changes made to this version of the PDD compared to the PDD version Rev.1 dated 15/08/2005 referred to in the letter of approval of the DNA of Brazil are related to the recalculation of the build margin emission factor with the plant efficiencies recommended by the CDM Executive Board at its 22nd meeting.

A.2. Description of the project activity:

This project activity consists of increasing efficiency in the bagasse (a renewable fuel source, residue from sugarcane processing) cogeneration facility at **Central de Álcool Lucélia Ltda** (Lucélia), a Brazilian sugar mill. With the implementation of this project, the mill is able to sell electricity to the national grid, avoiding the dispatch of same amount of energy produced by fossil-fuelled thermal plants to that grid. By that, the initiative avoids CO_2 emissions, also contributing to the regional and national sustainable development.

By investing to increase in steam efficiency in the sugar and alcohol production and increase in the efficiency of burning the bagasse (more efficient boilers), Lucélia generates surplus steam and uses it exclusively for electricity production (through turbo-generators).

The sponsors of the LBCP are convinced that bagasse cogeneration is a sustainable source of energy that brings not only advantages for mitigating global warming, but also creates a sustainable competitive advantage for the agricultural production in the sugarcane industry in Brazil. Using the available natural resources in a more efficient way, the Lucélia project activity helps to enhance the consumption of renewable energy. Besides that, it is used to demonstrate the feasibility of electricity generation as a side-business source of revenue for the sugar industry. It is worthy to highlight that out of approximately 320 sugar mills in Brazil, the great majority, produces energy for on-site use only, and not for grid supply, which is mainly due to the low-efficiency of the cogeneration equipment installed on those sugar mills.

Furthermore, bagasse cogeneration also plays an important role on the country's economic development, as Brazil's sugarcane-based industry provides for approximately 1 million jobs and represents one of the major agribusiness products within the trade balance of the country. The Brazilian heavy industry has developed the technology to supply the sugarcane industry with equipments to provide expansion for the cogeneration. Therefore such heavy industry development also helps the country to create jobs and achieve sustainable development.

Bagasse cogeneration is important for the energy strategy of the country. Cogeneration is an alternative that allows postponing the installation and/or dispatch of electricity produced by fossil-fuelled generation utilities. The sale of the CERs generated by the project will boost the attractiveness of bagasse cogeneration projects, helping to increase the production of this energy and decrease dependency on fossil fuel.





page 3

Lucélia also believes that sustainable development will be achieved not only by the implementation of a renewable energy production facility, but also by carrying out activities which corresponds to the company social and environmental responsibilities, as described below:

Social Contribution

Lucélia is an important job creator. The total number of direct employees at Lucélia was 1.850 directly during the 2002/2003 harvest season and many others benefited indirectly from the company's activities. One can say that Lucélia is one of the most important job creators in the city of 18.000 people where the company is located.

Lucélia plays also an unique role towards a better social environment. Aware of its responsibility with the employees, their families, and the communities in its range of action, Lucélia has designed many programs and initiatives in an attempt to improve those people's quality of life. Such measures include:

- Healthy child program: developed with collaboration of Ana Maria Javouhey kinder garden. The project aims at clarifying the aspects relating to children's health and nutrition, and also provides orientation regarding teeth care. The program includes also donation of material, food, medicines and cultural visits sponsored by Lucélia;
- APAE project: APAE stands for *Associação de Pais e Amigos dos Excepcionais*, an organization for people with Down Syndrome. The company works with APAE in the municipality of Lucélia, providing incentives for cultural formation, integration and leisure. The company also donates school material, toys, medicines and provides cultural visits. Lucélia also promotes sports activities for APAE in the company's club. The final objective of this initiative is to promote the integration of children with this problem;
- Program of Social Integration: The program was set up with the idea of providing information and clarification in the areas of health and family planning, towards children between 10 and 15 years old, and counts on the collaboration of Lucélia's employees;
- Lucélia contributed also with administrative issues in the municipality of Lucélia, donating computers to the department in charge of organizing activities for children and youngsters;
- The company invited employees with obesity, diabetes or hypertension to join a program to learn how to fight those diseases/problems, including sport activities and eating habits;
- Lucélia has set a "Soup House", which serves soup during weekends to poor families, helping more than 200 of them;
- The "Projeto Futuro", providing social, cultural, leisure and professional formation activities for children and youngsters who are employees siblings, between 10 and 15 years old;
- AFUCAL, the association of Lucélia's employees, which is the club and leisure area the company provides its employees, including a gym which is also open to the community;



- São Vicente de Paula shelter is a place for old people in the municipality of Lucélia which also counts on donations and support from Central de Álcool Lucélia. The company donates medicines, food, and provides cultural visits and leisure to the people living there.
- General assistance, including medical assistance, odonthological assistance, subsidies to school fees, subsidies to medicines, extra-food for the sugarcane harvesters;
- The "João-de-Barro" project helps employees repair their house, providing people to perform the repairing;
- Job training;
- A lodge in the surroundings of Aguapeí river, to be used by the employees and their families in special occasions such as weddings, birthdays, baptisms;
- Labor health, including light gymnastics before the working day and information about lesions due to repetitive efforts;
- Transportation to courses in surrounding municipalities;
- Ambulances, to transport employees and their relatives to more equipped cities, in case of necessity;
- Restaurant situated in the company's site, open 24 hours a day to serve the employees.

Besides all these, Lucélia takes other social attitudes, such as health campaigns, donation of money and food to churches in the communities around the company, donation of toys to poor children, donation of medicines to poor families, donation of literature books to a state school, donation of sugar for the hunger committee in the municipality of Lucélia, and donations to the Cancer Hospital in Jaú, a nearby municipality.

All these numerous initiatives show the importance of Lucélia not only to its employees, but also to the communities surrounding the company. And due to its practices towards children's care, Lucélia has been awarded the Fundação ABRINQ (Brazilian toys manufacturers' association) certificate.

Environmental Contribution

Besides reducing the GHG emissions by the construction of its projects, Lucélia has also been developing its Environmental Management System and the following environmental programs are being executed:

The company has set a program to improve the natural area and the landscape in the region where it actuates, producing 130 thousand seedlings annually to grow vegetation of native and exotic plant species. Currently, 75,5 ha or 126.000 trees have been planted.

Increasing the company's annual revenues due to CERs commercialization adds substantial value to direct employees of the firm, their families and local community.



page 5

A.3. **Project participants:**

Name of Party involved (*) ((host) indicates a host Party)	Private and/or public entity(ies) project participants (*) (as applicable)	Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No)
Brazil (host)	 Private entity Central de Álcool Lucélia Ltda. Private entity Econergy Brasil Ltda. 	No

(*) In accordance with the CDM modalities and procedures, at the time of making the CDM-PDD public at the stage of validation, a Party involved may or may not have provided its approval. At the time of requesting registration, the approval by the Party(ies) involved is required.

A.4. Technical description of the project activity:

A.4.1. Location of the project activity:

A.4.1.1. Host Party(ies):

Brazil

A.4.1.2. Region/State/Province etc.:

São Paulo

A.4.1.3. City/Town/Community etc:

Lucélia


A.4.1.4. Detail of physical location, including information allowing the unique identification of this <u>project activity</u> (maximum one page):

The overview of the Lucélia plant, where LBCP project activity is located, is shown in Figure 1.



page 6

UNFCCC

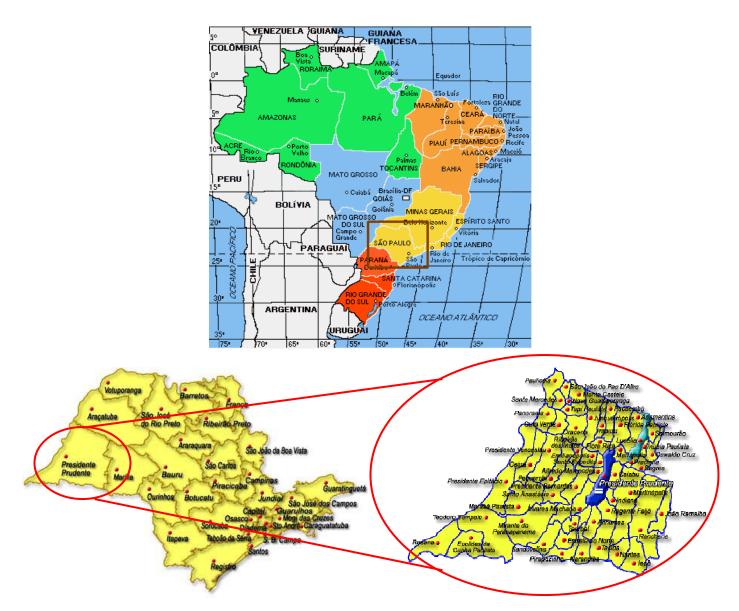




Figure 1: Geographical position of the city of Lucélia, in light green.

A.4.2. Category(ies) of project activity:

Sectorial Scope: 1-Energy industries (renewable - / non-renewable sources)

¹ http://www.sebraesp.com.br/



/

UNFCCC

page 7

A.4.3. Technology to be employed by the project activity:

The predominant technology in all parts of the world today for generating megawatt (MW) levels of electricity from biomass is the steam-Rankine cycle, which consists of direct combustion of biomass in a boiler to generate steam, which is then expanded through a turbine. Most steam cycle plants are located at industrial sites, where the waste heat from the steam turbine is recovered and used for meeting industrial process heat needs. Such combined heat and power (CHP), or cogeneration, systems provide greater levels of energy services per unit of biomass consumed than systems that generate electric power only.

The steam-Rankine cycle involves heating pressurized water, with the resulting steam expanding to drive a turbine-generator, and then condensing back to water for partial or full recycling to the boiler. A heat exchanger is used in some cases to recover heat from flue gases to preheat combustion air, and a de-aerator must be used to remove dissolved oxygen from water before it enters the boiler.

Steam turbines are designed as either "backpressure" or "condensing" turbines. CHP applications typically employ backpressure turbines, wherein steam expands to a pressure that is still substantially above ambient pressure. It leaves the turbine still as a vapour and is sent to satisfy industrial heating needs, where it condenses back to water. It is then partially or fully returned to the boiler. Alternatively, if process steam demands can be met using only a portion of the available steam, a condensing-extraction steam turbine (CEST) might be used. This design includes the capability for some steam to be extracted at one or more points along the expansion path for meeting process needs (Figure 2). Steam that is not extracted continues to expand to sub-atmospheric pressures, thereby increasing the amount of electricity generated per unit of steam compared to the backpressure turbine. The non-extracted steam is converted back to liquid water in a condenser that utilizes ambient air and/or a cold water source as the coolant².

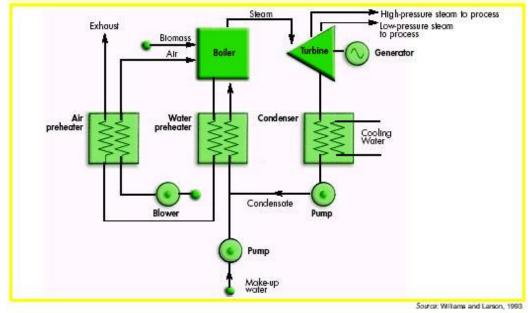


Figure 2: Schematic diagram of a biomass-fired steam-Rankine cycle for cogeneration using a condensingextraction steam turbine

² Williams & Larson, 1993 and Kartha & Larson, 2000, p.101



page 8

The steam-Rankine cycle uses different boiler designs, depending on the scale of the facility and the characteristics of the fuel being used. The initial pressure and temperature of the steam, together with the pressure to which it is expanded, determine the amount of electricity that can be generated per kilogram of steam. In general, the higher the peak pressure and temperature of the steam, the more efficient, sophisticated, and costly the cycle is.

Using steam-Rankine cycle as the basic technology of its cogeneration system, for achieving an increasing amount of surplus electricity to be generated, Lucélia began its efforts in two phases, which are:

▶ Phase 1 (2002): A 12 MW backpressure turbo- generator was installed, along with a refurbishment	▶ Phase 2 (2006): Lucélia will install a 20 MW condensing-type turbo-generator and a 65
of a 23 bar boiler to 44 bar. In this phase, also, a 1,2	bar boiler, putting a 23 bar boiler on stand-by,
MW and a 2,5 MW turbo-generators were put on	therefore reaching a total capacity of 35,7 MW.
stand-by, reaching a total capacity of 15,7 MW.	

Moreover, the technology for expanding the electricity availability from biomass in the sugar industry is, for the local utility companies, an advantage, as the baseload for the utilities in Brazil is supported mainly with hydro-generation and the Sugar Mill, coincidentally, supplies electricity during the dry season.

Further, as bagasse cogeneration requires a constant bagasse supply to the sugar mill's boilers. If there is an interruption in bagasse supply, for example due to an interruption in sugarcane supply to the mill, the boilers would not be able to produce the steam required by both the sugar/ethanol production process and the power-generation. Therefore, in order to avoid power-generation interruptions, the cogeneration expansion plan in LBCP includes investments in the sugar/ethanol production process that reduce the steam consumption in the sugar and ethanol production processes. This fine-tune improvement is necessary in order to drive as much steam as possible to the cogeneration project. Consequently, the greater the quantity of electricity production, the higher the investment per MWh produced is sought.

Table 1 shows how Lucélia's cogeneration infrastructure will be updated according to LBCP phases.

Table 1: Cogeneration	ı equipment	upgrades
-----------------------	-------------	----------

	Active/Acti	ivating	Standy by
Before the Expansion Plan (Until 2001)	One 1,2 MW and one 2,5 MW backpressure turbo generators		
(Until 2001)	Two 23 bar boilers		



UNFCCC

CDM – Executive Board

page 9

Phase 1	One 12 MW backpressure turbo generator		One 1,2 MW and one 2,5 MW backpressure turbo generators
2002	One 44 bar boiler (refurbished from a 23 bar one)	One 23 bar boiler	
Phase 2	One 20 MW condensing-type turbo generator	One 12 MW backpressure turbo generator	One 1,2 MW and one 2.5 MW backpressure turbo generators
2006	One 65 bar boiler	One 44 bar boiler (refurbished from a 23 bar one)	One 23 bar boiler

Figure 3 provides an energy diagram for Lucélia, in order to provide a picture of how the energy is distributed through the mill and the path from biomass energy to electric power.

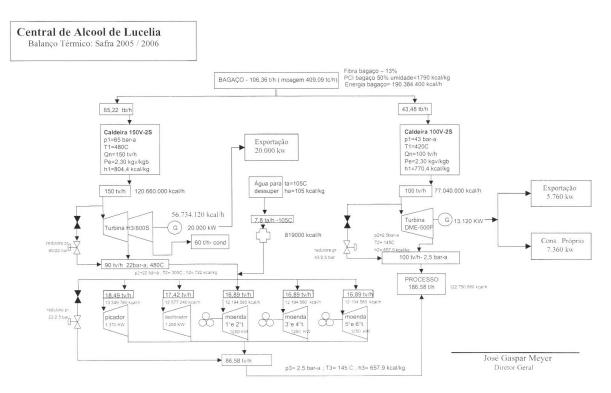


Figure 3: Lucélia's Energy Balance Diagram for LBCP Phase 2



UNFCC

CDM – Executive Board

page 10

A.4.4. Brief explanation of how the anthropogenic emissions of anthropogenic greenhouse gas (GHGs) by sources are to be reduced by the proposed CDM <u>project activity</u>, including why the emission reductions would not occur in the absence of the proposed <u>project activity</u>, taking into account national and/or sectoral policies and circumstances:

By dispatching renewable electricity to a grid, electricity that would otherwise be produced using fossil fuel is displaced. This electricity displacement will occur at the system's margin, i.e. this CDM project will displace electricity that is produced by marginal sources (mainly fossil fueled thermal plants) which have higher electricity dispatching costs and are solicited only over the hours that baseload sources (low-cost or must-run sources) cannot supply the grid (due to higher marginal dispatching costs or fuel storage – in case of hydro sources – constraints).

Bagasse is a fibrous biomass by-product from sugarcane processing, which accounts for about 25 percent on weight of fresh cane and approximately one third of the cane's energy content. In a typical Brazilian sugarcane mill, burning bagasse for generation of process heat and power production is a practice already established. It is estimated that over 700 MW of bagasse-based power capacity is currently installed in the state of São Paulo only³. The energy produced from these facilities is almost all consumed for their own purposes. Because of constraints that limit the access of independent power producers to the electric utilities market, there is no incentive for sugarcane mills to operate in a more efficient way. Low-pressure boilers, very little concern with optimal use and control of steam, crushers mechanically activated by steam, energy intensive distillation methods, are a few examples of inefficient methods applied to the sugar industry as normal routine.

The Brazilian electric sector legislation currently recognizes the role of independent power producers, which has triggered interest in improving boiler efficiency and increasing electricity generation at mills, allowing the production of enough electricity not only to satisfy sugar mills' needs but also a surplus amount for selling to the electricity market. Furthermore, the ever increasing electricity demand opens an opportunity for some bagasse cogeneration power plants in Brazil. Additionally, the feature of electricity generation from sugarcane coinciding with dry months of the year, when hydroelectric generation system - the most important electricity source in the country - is under stress, should provide considerable complementary energy and make bagasse cogeneration electricity attractive for any potential purchasers.

Nevertheless, some barriers pose a challenge for implementation of this kind of projects. In most cases, the sponsors' culture in the sugar industry is very much influenced by the commodities – sugar and ethanol – market. Therefore, they need an extra incentive to invest in electricity production due to the fact that it is a product that can never be stored in order to speculate with price. The Power Purchase Agreement (PPA) requires different negotiation skills, which is not the core of the sugar industry. For instance, when signing a long-term electricity contract, the PPA, a given sugar mill has to be confident that it will produce sufficient biomass to supply its cogeneration project. Although it seems easy to predict, the volatility of sugarcane productivity may range from 75 to 120 ton of sugarcane per hectare annually depending on the rainfall. So, the revenue from GHG emission reductions and other benefits associated with CDM certification offer a worthy financial comfort for the sugar mills, like Lucélia, which is investing to expand its electric power

³ São Paulo. Secretary of Energy, 2001.



page 11

UNFCCC

generation capacity and to operate in a more rationale way under the above mentioned new electric sector circumstances.

Years	Annual estimation of emission reductions in tonnes of CO ₂ e
2002	2.873
2003	4.367
2004	4.528
2005	5.354
2006	27.804
2007	27.804
2008	27.804
Total estimated reductions (tonnes of CO ₂ e)	100.534
Total Number of crediting years	7
Annual average over the crediting period of estimated reductions (tonnes of CO ₂ e)	14.362

A.4.4.1.	Estimated amount of	of emission red	luctions over	the cho	osen <u>crediting period</u> :

More detailed information about electricity and emission reduction generation is provided in Annex 3 – Baseline Information.

A.4.5. Public funding of the project activity:

There is no public funding involved in Annex I in this project activity.

SECTION B. Application of a baseline methodology

B.1. Title and reference of the <u>approved baseline methodology</u> applied to the <u>project activity</u>:

AM0015: Bagasse-based cogeneration connected to an electricity grid.

B.1.1. Justification of the choice of the methodology and why it is applicable to the <u>project</u> <u>activity:</u>



UNFCCO

CDM – **Executive Board**

page 12

This methodology is applicable to LBCP due to the fact that (i) the bagasse is produced and consumed in the same facility – Lucélia -; (ii) the project would never be implemented by the public sector, as well as it would not be implemented in the absence of CDM, as shown in the additionality chapter below; (iii) there is no increase on the bagasse production due to the project activity itself/ and (iv) there will be no bagasse storage for more than one year.

B.2. Description of how the methodology is applied in the context of the <u>project activity</u>:

The project activity follows the steps provided by the methodology taking into account the (b) Simple Adjusted OM calculation for the STEP 1, since there would be no available data for applying to the preferred option -(c) Dispatch Data Analysis OM. For STEP 2, the option 1 was chosen. The following table presents the key information and data used to determine the baseline scenario.

ID number	Data type	Value	Unit	Data Source
1. EG _y	Electricity supplied to the grid by the Project.	Obtained throughout project activity lifetime.	MWh	Project.owner
2. EF _y	CO ₂ emission factor of the Grid.	0,2677	tCO ₂ e/MWh	Calculated
3. EF _{OM,y}	CO ₂ Operating Margin emission factor of the grid.	0,4310	tCO ₂ e/MWh	This value was calculated using data information from ONS, the Brazilian electricity system manager.
4. EF _{BM,y}	CO ₂ Build Margin emission factor of the grid.	0,1045	tCO ₂ e/MWh	This value was calculated using data information from ONS, the Brazilian electricity system manager.
10. λ _y	Fraction of time during which low-cost/ must-run sources are on the margin.	$\begin{array}{l} \lambda_{2002} = 0{,}5053 \\ \lambda_{2003} = 0{,}5312 \\ \lambda_{2004} = 0{,}5041 \end{array}$	-	This value was calculated using data information from ONS, the Brazilian electricity system manager.

B.3. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM <u>project activity</u>:

Application of the Tool for the demonstration and assessment of additionality for LBCP.

Step 0. Preliminary screening based on the starting date of the project activity





(a) The starting date of this activity occurred after 1 January 2000, which is evidenced by the Environmental Installation Licence of Central de Álcool Lucélia Ltda in 28th January 2002.

(b) Lucélia would not initiate the project in the absence of CDM. The mill was informed about the CDM through Informação UNICA, the newsletter from UNICA – *União da Agroindústria Canavieira de São Paulo* – state of São Paulo sugarcane association. The evidence that Lucélia Sugar Mill has seriously considered CDM in the decision to proceed with the project activity is also the fact that Lucélia contacted Econergy before the starting date of the project activity with intention to Econergy assist the mill on the baseline analysis.

Step 1. Identification of alternatives to the project activity consistent with current laws and regulations.

Sub-step 1a: Define alternatives to the project activity

1. There were only two possibilities to implement this project activity: one was to continue the current situation of the sugar mill, focusing only on the production of sugar and alcohol and thus investing to enhance the efficiency and increasing the scale of its core business. The other option was the project activity undertaken, which is the investment made to increase steam efficiency and production for electricity sales purposes by acquiring high-efficiency boilers and turbo-generators.

Sub-step 1b: Enforcement of applicable laws and regulations

2. The alternative, which is to continue with the business-as-usual (BAU) situation before the decision of implementing this CDM project activity is consistence with the applicable laws and regulations.

3. Non applicable.

4. Both the project activity and the alternative scenario are in compliance with all regulations.

Step 3. Barrier analysis

Sub-step 3a: Identify barriers that would prevent the implementation of type of the proposed project activity

- 1. According to COELHO (1999)⁴, "large scale cogeneration program in sugar-alcohol sector has not yet occurred, due to several barriers, mainly economic, political and institutional", these barriers include:
 - I. Technological Barriers

Technological barriers represent a very important issue for increasing bagasse cogeneration in Brazil, as – despite the fact that Rankine-cycle is a well known technology – the cogeneration units operate with low-efficiency and are not competitive comparing to other generation options. Due to this, there is a delicate

⁴ COELHO, Suani T. *Mecanismos para implementação da cogeração de eletricidade a partir de biomassa*: um modelo para o Estado de São Paulo. São Paulo: Programa interunidades de pós-graduação em energia, 1999.





INFCCC

page 14

issue about technology and economic value for such technology. Although this technology is well developed, the economic value for its application is not present for projects on the scale similar to the sugar mills in Brazil. COELHO (1999) justifies that by highlighting that the unit costs (\$/installed MW) are significantly influenced by the scale-effect. As the bagasse cogeneration unit should have a small scale due to the high cost for transportation of the fuel (bagasse), investments are high. Therefore, as a lower cost of capital is wanted, the result is a simplified installation and lower efficiency.

COELHO (1999) also states that the great majority of the sugar mills still rely on inefficient technology, such as on 22 bar pressure boilers, even in the state of São Paulo, the most industrialized in Brazil. Moreover, when there is a necessity to change equipments it is usual not to consider purchasing high-efficiency boilers due to conservativeness, lack of knowledge or even lack of interest to generate surplus steam for electricity sales purposes.

Finally, SWISHER $(1997)^5$ considers it difficult to convince the local distributor that the energy to be acquired, generally generated during the harvest season, is sufficiently reliable to be accounted in the distributor's planning.

II. Institutional and Political Barriers

From the electric sector point of view, according to COELHO (1999), acquiring electricity other than hydroelectric would not be a priority, arguing that since bagasse based electricity is generated only during the harvest season, no reliable energy could be offered. However, the biggest advantage of bagasse based electricity is that it is produced during the period where hydroelectric plants face difficulties due to the low level of rainfall. As a result, COELHO (1999) suggests that there is a significant prejudice and conservativeness of the distributors when deciding whether to purchase bagasse based energy or not.

From the sugar mill point of view, save rare exceptions, COELHO (1999) says that the great majority of sugar mills do not consider investments in cogeneration (for electricity sale) as a priority. The sector "even in the new political context, does not seem to have motivation to invest in a process that it sees with mistrust and no guarantees that the product will have a secure market in the future. Moreover, it is a fact that "the sugar mills are essentially managed by families, which hurdles the association with external financial agents" that would allow the sector to be more competitive and diversifying its investment.

Since 1997, according to SWISHER (1997), the announcement of a Cogeneration Decree has been awaited, and such decree was supposed to have a positive influence on corporate decision-making with respect to biomass project implementation. The original Cogeneration Decree proposal, which was never approved, called for mandatory purchase by the regional utilities - "concessionárias" - from cogenerating and self-generating facilities⁶. Instead of renewable energy, the government expansion plan for electric energy, approved in February 2000 is based on fossil fuel – Natural Gas. This expansion plan called Thermoelectricity Priority Plan (PPT) became a reality right before the energy crisis. The Thermoelectricity

⁵ SWISHER, J. Using area-specific cost analysis to identify low incremental-cost renewable energy options: a case study of co-generation using bagasse in the State of São Paulo. Washington DC: Prepared for Global Environment Facility (GEF) Secretariat, 1997.

⁶ Presidential Decree on the co-generation of electric energy, draft of 5 August 1997.





Priority Plan beneficiaries, which were mainly natural gas thermal plants, through the Ministry of Mines and Energy (MME) Decree 3.371 from February 2000, counted on guaranteed, long term and attractive price conditions on Natural Gas supply and Energy sales, together with financing from the national development bank BNDES. And though the PPT plan is not likely to be fully implemented, the public-sector policies for renewable energy are not considered reliable enough by the executives of the private sector to support cogeneration expansion in the sugar mills. This assumption is clearly shown in the following list of rules and/or regulations in the energy sector that have been set in the last 10 years:

- March 1993: Law 8.631 sets a tariff regulation for electric energy;
- February 1995: Law 8.987 establish public concession for energy;
- July 1995: Law 9.074 regulates concession for electric energy sector;
- **December 1996**: Law 9.427 creates the National Energy Agency (ANEEL);
- August 1997: Law 9.478 sets the National Council for Energy Planning (CNPE);
- October 1997: Decree 2.335 regulates the ANEEL task;
- **December 1997**: Implements ANEEL;
- May 1998: Law 9.648 establishes the Spot Market for Electric Energy (MAE) and the Operator National System (ONS);
- July 1998: Decree 2.655 regulates MAE and ONS tasks;
- February 2000: Decree 3.371 regulates the Thermoelectricity Priority Plan (PPT);
- April 2002: Law 10.438 sets the Program for Incentive Alternative Energy (PROINFA), stating that contracts shall be signed within 24 months from its date and that there will be different economic values for the acquisition of 3.300MW of electricity capacity from renewable sources by the state owned Eletrobrás, for plants starting operations before December 30, 2006;
- August 2002: MP 64 is a presidential act to change the constitution in order to allow the energy sector regulation including the PROINFA;
- **December 2002**: Resolution 4.541 from ANEEL regulates the implementation of PROINFA, stating that economic values would be defined within 90 days;
- March 2003: Decree 4.644 postponed for 180 days, from its date, the economic value and operational guidelines announcement;
- June 2003: Decree 4.758 indefinitely postponed the date for the economic value and operational guidelines announcement and revoked the above mentioned Decree 4.644.



- page 16
- November 2003: Law 10.762 of 11 November/03 revised Law 10.438 of 26 April 2002 institutes PROINFA.
- March 2004: Decree 5.025 regulates the Law 10.438 as of 26 April 2002.

For the purpose of this CDM project analysis, at the time the project started there were no institutional incentives like PROINFA to be considered. Therefore, the company's decision to sign a long-term PPA with the local distributor undoubtedly represented a significant risk that the mill was willing to take, partially thanks to the expected CDM revenue.

III. Economic and Investment Barriers

From the point of view of the economic agents, the excessive level of guarantees required to finance the projects is a common barrier to achieving a financial feasibility stage, deeply discussed in SWISHER (1997).

Other barriers have more to do with the lack of adequate commercial contractual agreements from the energy buyers (i.e. bankable long-term contracts and payment guarantee mechanisms for non-creditworthy local public-sector and private customers) making it much more difficult to obtain long-term financing from a commercial bank and/or a development bank. Some other financing barriers occur simply due to prohibitively high transaction costs, which include the bureaucracy to secure the environmental license.

"There are several reasons for the Brazilian utilities' reluctance to offer higher prices for co-generated power. One important reason stems from their assumption that their costs are geographically uniform – i.e., that there is essentially a single value for their avoided cost in the industrial sector. If this cost value does not indicate that sufficient savings are available from buying co-generated power, and then there is little economic motivation, under either a public monopoly or a privatized competitive structure, for a utility to pay enough for co-generation to satisfy potential investors' financial criteria" ⁷ as stated by SWISHER (1997). In fact, the economic cost is the reason that Brazilian utilities do not buy cogeneration electricity energy, at least, while the energy sector regulation does not guarantee them the right to pass such cost through to the end user tariff. The cost of cogeneration electricity ranges from US\$ 35 to US\$ 105 per MWh, according to the Expansion Plan 2001-2010 from Brazil Government, which is described as higher than the marginal cost for electricity expansion in the system – US\$ 33/MWh⁸.

COELHO (1999) also highlights as one of the major problems of selling surplus energy to the grid as being the economic value paid to the sugar mills which not enough to remunerate the capital invested in the expansion of a cogeneration project. Furthermore, "the fee for accessing the grid does not contribute to making feasible the sale of the surplus energy to the distributors".

⁷ Joel Swisher personal communication with Rolls Royce Power Ventures project manage. Mark Croke, August 26, 1997. Swisher J. 1997 pg. 76.

⁸ "As may be seen, the unit costs of the alternative sources of energy are still high compared to the marginal cost of expanding the system, nowadays calculed as US\$33/MWh". Translation by Econergy Brasil. IN: BRAZIL, Ministry of Mines and Energy, 2001, pg. 80.





INFCCC

Summarizing, SWISHER (1997) considers that the main difficulties are found in: (a) **small sizes of projects and installation costs**: as the fixed costs are high and usually installations do not tend to be large, there is a huge economic barrier towards implementation of these sort of projects, as returns will low comparing with such fixed costs. (b) **availability of long-term financing:** traditionally, infrastructure projects have had wide access to long-term financing, situation that has changed after the electric sector privatization. (c) **lack of guarantees:** besides technical guarantees, investors require commercial guarantees generating a contradiction: the objective of privatization is to foster a market based economy but banks still require governmental guarantees to ensure long-term investments in the private sector, (d) **lack of local funding**: lack of familiarity with project finance tools and due to the high interest rates in Brazil.

Moreover, it is important to note that the electricity commercialization business is responsible for a very small part of the total revenues of the mill -1,87% for the fiscal year of 2004.

IV. Cultural Barrier

Due to the nature of the business in the sugar industry the marketing approach is narrowly focused on commodity type of transaction. Therefore, the electricity transaction based on long-term contract (Power Purchase Agreement) represents a significant breakthrough in their business model. In this case, the electricity transaction has to represent a secure investment opportunity from both economical and social-environmental perspective for convincing the sugar mills to invest in.

There are also questions regarding the managerial capacity of the companies that comprise the Brazilian sugarcane industry. According to WALTER (1994)⁹, they have in many cases demonstrated the will to undertake investments in new technologies, but without sufficient financial and entrepreneurial capacity to complete such projects.

Sub-step 3b: Show that the identified barriers would not prevent the implementation of at least one of the alternatives (except the proposed project activity).

The alternative to this project activity was to maintain the current situation and focus strictly in its core business which is the production of sugar and alcohol. Therefore, as the barriers mentioned above are directly related to entering into a new business (electricity sale), there is no impediment for sugar mills to maintain (or even invest in) its core business.

Step 4. Common practice analysis.

Sub-step 4a: Analyze other activities similar to the proposed project activity

⁹ WALTER, A.C.S. *Viabilidade e perspectivas da co-geração e geração termelétrica no setor sucro-alcooleiro*, 1994. Thesis (Doctorate). UNICAMP, Campinas.





UNECCI

The sugar sector, historically, always exploited its biomass (bagasse) in an inefficient manner by making use of low-pressure boilers. Although they consume almost all of their bagasse for self-energy generation purposes, it is done in such a manner that no surplus electric energy is available for sale, and no sugar company has ventured in the electricity market until recent years.

Similar project activities have been implemented by leading companies in this industry, mainly after Vale do Rosário served as a sector benchmark. However, these are few examples in a universe of about 320 sugar mills. Currently, other similar project activities are under implementation, for example, Cia Energética Santa Elisa, Moema, Equipav, Nova América. Added together similar projects in the sugar industry in Brazil account to approximately 10% of the sugar industry. The additional 90% are still burning their bagasse for on-site use only in the old-fashioned inefficient way. That clearly shows that just a small part of this sector is willing to invest in cogeneration projects.

Sub-step 4b: Discuss any similar options that are occurring

This project activity type is not considered as a widely spread activity in Brazil as only a small portion of the existing sugar mills in the country actually produce electricity for sale purposes. Also, most of the existing similar activities are being developed as CDM project activities.

Step 5. Impact of CDM registration

The impact of registration of this CDM project activity will contribute to overcoming all the barriers described in this Tool: technological, institutional and political, economic and investment and cultural barriers. The registration will enhance the security of the investment itself and, therefore and will foster and support the project owners' breakthrough decision to expand their business activities. Along these lines, the project activity is already engaged in a deal to sell its expected CERs.

Notwithstanding, the benefits and incentives mentioned in the text of the Tool for demonstration and assessment of additionality, published by the CDM-EB, will be experienced by the project activities such as: the project will achieve the aim of anthropogenic GHG reductions; financial benefit of the revenue obtained by selling CERs will bring more robustness to the project's financial situation; and its likelyhood to attract new players and new technology (currently there are companies developing new type of boilers – extra-efficient – and the purchase of such equipment is to be fostered by the CER sales revenue) and reducing the investor's risk.

Registration will also have an impact on other sugarcane industry players, who will see the feasibility of implementing renewable energy commercialization projects in their facilities with the CDM. Moreover, hard-currency inflows are highly desirable in a fragile and volatile economy as is the Brazilian one.

B.4. Description of how the definition of the <u>project boundary</u> related to the <u>baseline methodology</u> selected is applied to the <u>project activity</u>:

The definition of the project boundary related to the baseline methodology is applied to the project activity in the following way:



page 19

UNFCCC

Baseline energy grid: For LBCP, the South-Southeast and Midwest subsystem of the Brazilian grid is considered as a boundary, since it is the system to which Lucélia is connected and therefore receives all the bagasse-based produced electricity.

Bagasse cogeneration plant: the bagasse cogeneration plant considered as boundary comprises the whole site where the cogeneration facility is located.

B.5. Details of <u>baseline</u> information, including the date of completion of the baseline study and the name of person (s)/entity (ies) determining the <u>baseline</u>:

1. Date of completing the final draft of this baseline section: 02/12/2005.

2. Name of person/entity determining the baseline:

ECONERGY BRASIL (Contact information in Annex 1), which is a participant in this project, is responsible for the technical services related to GHG emission reductions, and is therefore, in behalf of Lucélia, the developer of this document, and all its contents.

SECTION C. Duration of the project activity / Crediting period

C.1 Duration of the project activity:

C.1.1. Starting date of the project activity:

12/07/2002.

C.1.2. Expected operational lifetime of the project activity:

25y-0m.¹⁰

C.2 Choice of the <u>crediting period</u> and related information:

C.2.1. <u>Renewable crediting period</u>

C.2.1.1. Starting date of the first <u>crediting period</u>:

12/07/2002.

C.2.1.2. Length of the first <u>crediting period</u>:

7y-0m

¹⁰ Specialists from the Brazilian National Agency of Electric Power (ANEEL - *Agência Nacional de Energia Elétrica*) suggest using 25 years of lifetime for steam turbines, combustion turbines, combined cycle turbines and nuclear power plants, according to Bosi, 2000, p. 29.



page 20

C.2.2. <u>Fixed</u>	C.2.2. Fixed crediting period:							
C.2.2	Starting date:							
Left blank on purpose								

Left blank on purpose.

C.2.2.2. Length:

Left blank on purpose.

SECTION D. Application of a monitoring methodology and plan

D.1. Name and reference of <u>approved monitoring methodology</u> applied to the <u>project activity</u>:

Approved monitoring methodology AM0015: "Bagasse-based cogeneration connected to an electricity grid"

D.2. Justification of the choice of the methodology and why it is applicable to the project activity:

The monitoring methodology was designed to be applied to the Vale do Rosario CDM Project. Due to the great similarity of the project, the same methodology was chosen in order to monitor the emissions reduction due to LBCP.

The methodology considers monitoring emissions reductions generated from cogeneration projects with sugarcane bagasse. The energy produced by the project could be electricity exported to a grid-connected system and/or energy used to substitute fossil fuel off-grid connected. And that is exactly the case with LBCP: the project exploits a by-product from the sugarcane milling process (bagasse) to produce and commercialize renewable electricity connected to a regional Brazilian grid. The methodology is therefore fully applicable to LBCP, and justification for choosing it

Furthermore, besides being a methodology to be used in conjunction with the approved baseline methodology AM0015 ("Bagasse-based cogeneration connected to an electricity grid"), the same applicability conditions are described and justified in item B1.1 of this document.



page 21

UNFCCC

D.2. 1. Option 1: Monitoring of the emissions in the project scenario and the baseline scenario

There is no project emission to be considered in this project activity.

	D.2.1.1. Data to be collected in order to monitor emissions from the <u>project activity</u> , and how this data will be archived:								
ID number (Please use numbers to ease cross- referencing to D.3)	Data variable	Source of data	Data unit	Measured (m), calculated (c) or estimated (e)	Recording frequency	Proportion of data to be monitored	How will the data be archived? (electronic/ paper)	Comment	

D.2.1.2. Description of formulae used to estimate project emissions (for each gas, source, formulae/algorithm, emissions units of CO₂ equ.)

Left blank on purpose.

D.2.1.3. Relevant data necessary for determining the baseline of anthropogenic emissions by sources of GHGs within the project boundary and how such data will be collected and archived : How will the data ID number Data variable Source of data Data unit Measured Recording Proportion Comment (Please use (m), frequency of data to be archived? (electronic/ paper) be numbers to calculated ease cross-(c), monitored referencing estimated table to (e), D.3) Readings of the Double check by receipt of 1. EG_v Electricity MWh М Monthly 100% Electronic and supplied to energy metering sales. Will be archived paper according to internal the grid by connected to the procedures, until 2 years after the Project. grid and Receipt of the end of the crediting period. Sales.

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.





2. EF _y	CO ₂ emission factor of the Grid.	Calculated	tCO ₂ e/MWh	С	At the validation and baseline renewal	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.
3. EF _{OM.y}	CO ₂ Operating Margin emission factor of the grid.	Factor calculated from ONS, the Brazilian electricity system manager.	tCO ₂ e/MWh	С	At the validation and baseline renewal	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.
4. EF _{BM,y}	CO ₂ Build Margin emission factor of the grid.	Factor calculated from ONS, the Brazilian electricity system manager.	tCO ₂ e/MWh	С	At the validation and baseline renewal	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.
10. λ _y	Fraction of time during which low- cost/ must-run sources are on the margin.	Factor calculated from ONS, the Brazilian electricity system manager.	index	С	At the validation and baseline renewal	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.

UNFCCC





page 23

D.2.1.4. Description of formulae used to estimate baseline emissions (for each gas, source, formulae/algorithm, emissions units of CO₂ equ.)

$\sum_{i,j} F_{i,j,y}.COEF_{i,j} \qquad \sum_{i,k} F_{i,k,y}.COEF_{i,k}$	$F_{i,j(or\ m),y}$ Is the amount of fuel <i>i</i> (in a mass or volume unit) consumed by relevant power sources <i>j</i> in year(s) y
$EF_{OM,simple_adjusted,y} = (1 - \lambda_y) \frac{\sum_{i,j} F_{i,j,y}.COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \frac{\sum_{i,k} F_{i,k,y}.COEF_{i,k}}{\sum_k GEN_{k,y}} $ (tCO ₂ e/GWh)	<i>j,m</i> Refers to the power sources delivering electricity to the grid, not including low- operating cost and must-run power plants, and including imports4 from the grid
$EF_{electricity} = \frac{EF_{OM} + EF_{BM}}{2}$ (tCO ₂ e/GWh)	$COEF_{i,j(or m) y}$ Is the CO2 emission coefficient of fuel <i>i</i> (tCO2 / mass or volume unit of the fuel), taking intoaccount the carbon content of the fuels used by relevant power sources j (or m) and the percent oxidation of the fuel in year(s) y, a
	$GEN_{j(or m),y}$ Is the electricity (MWh) delivered to the grid by source j (or m)
$BE_{electricity,y} = EF_{electricity} \cdot EG_{y}$	BE _{electricity,y} Are the baseline emissions due to displacement of electricity during the year y in tons of CO ₂
	w_{OM} , w_{BM} Are the weights given to the operating margin (OM) and the build margin (BM) in the emission factor calculation.
	EG_y Is the net quantity of electricity generated in the bagasse-based cogeneration plant due to the project activity during the year y in MWh, and
	$EF_{electricity,y}$ Is the CO ₂ baseline emission factor for the electricity.

D. 2.2. Option 2: Direct monitoring of emission reductions from the project activity (values should be consistent with those in section E).

	D.2.2.1. Data to be collected in order to monitor emissions from the project activity, and how this data will be archived:									
ID number (Please use numbers to ease cross- referencing to table D.3)	Data variable	Source of data	Data unit	Measured (m), calculated (c), estimated (e),	Recording frequency	Proportion of data to be monitored	How will the data be archived? (electronic/ paper)	Comment		

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.



D.2.2.2. Description of formulae used to calculate project emissions (for each gas, source, formulae/algorithm, emissions units of CO₂ equ.):

Left blank on purpose.

D.2.3. Treatment of <u>leakage</u> in the monitoring plan

D.2.3.1. If applicable, please describe the data and information that will be collected in order to monitor leakage effects of the

<u>project activity</u>

ID number	Data	Source of	Data	Measured (m),	Recording	Proportion	How will the data	Comment
(Please use	variable	data	unit	calculated (c)	frequency	of data to	be archived?	
numbers to			um	or estimated (e)		be	(electronic/	
ease cross-						monitored	paper)	
referencing								
to table D.3)								

Left blank on purpose.

D.2.3.2. Description of formulae used to estimate <u>leakage</u> (for each gas, source, formulae/algorithm, emissions units of CO₂ equ.)

Left blank on purpose.

D.2.4. Description of formulae used to estimate emission reductions for the <u>project activity</u> (for each gas, source, formulae/algorithm, emissions units of CO₂ equ.)

$ER_{y} = BE_{thermal, y} + BE_{electricity, y} - PE_{y} - L_{y}$	ER_y : are the emissions reductions of the project activity during the year y in tons of CO_2
$BE_{thermal, y} = 0$	$BE_{electricity,y}$: Are the baseline emissions due to displacement of electricity during the year y in tons of CO_2
PE _y =0	BE _{thermal,v} : Are the baseline emissions due to displacement of thermal energy during the year y in
L _y =0	tons of CO ₂

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.



page 25

$BE_{electricity, y} = EF_{electricity} \cdot EG_{y}$	PE_{y} : Are the project emissions during the year y in tons of CO_2 .
	L_y : Are the leakage emissions during the year y in tons of CO_2 .

D.3. Quality control (QC) and quality assurance (QA) procedures are being undertaken for data monitored

Data	Uncertainty level of data	Explain QA/QC procedures planned for these data, or why such procedures are not necessary.
(Indicate table and	(High/Medium/Low)	
ID number e.g. 31.;		
3.2.)		
1	Low	These data will be directly used for calculation of emission reductions. Sales record and other records are used to
		ensure the consistency.
2	Low	Data does not need to be monitored
3	Low	Data does not need to be monitored
4	Low	Data does not need to be monitored
10	Low	Data does not need to be monitored

D.4 Please describe the operational and management structure that the project operator will implement in order to monitor emission reductions and any <u>leakage</u> effects, generated by the <u>project activity</u>

The structure for monitoring this project activity will basically consist of registering the amount of energy sold to the grid (EG_y) . There are two operations that the project operators must perform in order to ensure data consistency, despite the fact that this will actually consist of the monitoring of one single variable.

- 1. The monthly readings of the calibrated meter equipment must be recorded in an electronic spreadsheet;
- 2. Sales receipt must be archived for double checking the data. In case of inconsistency, these are the data to be used.

Moreover, according to the law, the metering equipment shall be periodically calibrated to comply with the regulations for independent power producers connected to the regional grid.

D.5 Name of person/entity determining the <u>monitoring methodology</u>:

ECONERGY BRASIL, which is a project participant (Contact information in Annex 1), is responsible for the technical services related to GHG emission reductions, and is therefore, on behalf of Lucélia, the developer of this document, and all its contents.

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.

UNFCCC



page 26

INFCC

SECTION E. Estimation of GHG emissions by sources

E.1. Estimate of GHG emissions by sources:

This project activity does not burn any additional quantity of fossil fuel due to the project implementation. Therefore, the variable PE_v , presented in the methodology, does not need to be monitored.

Thus, $PE_v = 0$

E.2. Estimated <u>leakage</u>:

Lucélia did not sell sugarcane bagasse before the implementation of LBCP.

Thus, $L_v = 0$

E.3. The sum of E.1 and E.2 representing the project activity emissions:

 $L_v + PE_v = 0$

E.4. Estimated anthropogenic emissions by sources of greenhouse gases of the <u>baseline</u>:

The baseline methodology considers the determination of the emissions factor for the grid to which the project activity is connected as the core data to be determined in the baseline scenario. In Brazil, there are two main grids, South-Southeast-Midwest and North-Northeast, therefore the South-Southeast-Midwest Grid is the relevant one for this project.

The method that will be chosen to calculate the Operating Margin (OM) for the electricity baseline emission factor is the option (b) *Simple Adjusted OM*, since the preferable choice (c) *Dispatch Data Analysis OM* would face the barrier of data availability in Brazil.

In order to calculate the Operating Margin, daily dispatch data from the Brazilian electricity system manager (ONS) needed to be gathered. ONS does not regularly provide such information, which implied in getting it through communicating directly with the entity.

The provided information comprised years 2002, 2003 and 2004, and is the most recent information available at this stage.

Simple Adjusted Operating Margin Emission Factor Calculation

According to the methodology, the project is to determine the Simple Adjusted OM Emission Factor $(EF_{OM, simple adjusted, y})$. Therefore, the following equation is to be solved:

$$EF_{OM,simple_adjusted,y} = (1 - \lambda_y) \frac{\sum_{i,j} F_{i,j,y} \cdot COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \frac{\sum_{i,k} F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}}$$
(tCO₂e/GWh)



page 27

It is assumed here that all the low-cost/must-run plants produce zero net emissions.

$$\frac{\sum_{i,k} F_{i,k,y}.COEF_{i,k}}{\sum_{k} GEN_{k,y}} = 0 \text{ (tCO}_2\text{e/GWh)}$$

Please refer to the methodology text or the explanations on the variables mentioned above.

The ONS data as well as the spreadsheet data with the calculation of emission factors have been provided to the validator (DOE). In the spreadsheet, the dispatch data is treated as to allow calculation of the emission factor for the most three recent years with available information, which are 2002, 2003 and 2004.

The Lambda factors were calculated in accordance with methodology requests. More detailed information is provided in Annex 3. The table below presents such factors.

Year	Lambda
2002	0,5053
2003	0,5312
2004	0,5041

Electricity generation for each year needs also to be taken into account. This information is provided in the table below.

Year	Electricity Load (MWh)
2002	275.402.896
2003	288.493.929
2004	297.879.874

Using therefore appropriate information for $F_{i,j,y}$ and $COEF_{i,j}$, OM emission factors for each year can be determined, as follows.

$$EF_{OM,simple_adjusted,2002} = (1 - \lambda_{2001}) \frac{\sum_{i,j} F_{i,j,2002} .COEF_{i,j}}{\sum_{j} GEN_{j,2002}} \therefore EF_{OM,simple_adjusted,2002} = 0,4207 \text{ tCO}_2/\text{MWh}$$

$$EF_{OM,simple_adjusted,2003} = (1 - \lambda_{2003}) \frac{\sum_{i,j} F_{i,j,2003} .COEF_{i,j}}{\sum_{j} GEN_{j,2003}} \therefore EF_{OM,simple_adjusted,2003} = 0,4397 \text{ tCO}_2/\text{MWh}$$

$$EF_{OM,simple_adjusted,2004} = (1 - \lambda_{2004}) \frac{\sum_{i,j} F_{i,j,2004} .COEF_{i,j}}{\sum_{j} GEN_{j,2004}} \therefore EF_{OM,simple_adjusted,2004} = 0,4327 \text{ tCO}_2/\text{MWh}$$

Finally, to determine the baseline *ex-ante*, the mean average among the three years is calculated, finally determining the $EF_{OM,simple_adjusted}$.

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.



page 28

$$EF_{OM,simple_adjusted_{2002}=2004} = 0,4310 \text{ tCO}_2/\text{MWh}$$

According to the methodology used, a Build Margin emission factor also needs to be determined.

$$EF_{BM,y} = \frac{\sum_{i,m} F_{i,m,y}.COEF_{i,m}}{\sum_{m} GEN_{m,y}}$$

Electricity generation in this case means 20% of total generation in the most recent year (2004), as the 5 most recent plants built generate less than such 20%. Calculating such factor one reaches:

$$EF_{BM,2004} = 0,1045 \,\mathrm{tCO}_2/\mathrm{MWh}$$

Finally, the electricity baseline emission factor is calculated through a weighted-average formula, considering both the OM and the BM, being the weights 50% and 50% by default. That gives:

$$EF_{electricity,2002-2004} = 0.5 * 0.4310 + 0.5 * 0.1045 = 0.2677 \text{ tCO}_2/\text{MWh}$$

It is important to note that adequate considerations on the above weights are currently under study by the Meth Panel, and there is a possibility that such weighing changes in the methodology applied here.

The baseline emissions would be then proportional to the electricity delivered to the grid throughout the project's lifetime. Baseline emissions due to displacement of electricity are calculated by multiplying the electricity baseline emissions factor ($EF_{electricity,2002-2004}$) with the electricity generation of the project activity.

 $BE_{electricity,y} = EF_{electricity,2002-2004} \cdot EG_{y}$

Therefore, for the first crediting period, the baseline emissions will be calculated as follows:

 $BE_{electricity,y} = 0,2677 \text{ tCO}_2/\text{MWh} \cdot \text{EG}_y$ (in tCO₂e)

E.5. Difference between E.4 and E.3 representing the emission reductions of the <u>project</u> <u>activity</u>:

The emissions reductions of this project activity are:

$$\mathbf{ER} = \mathbf{BE}_{\text{electricity},y} - (\mathbf{L}_{y} + \mathbf{PE}_{y}) = 0,2677 \text{ tCO}_{2}/\text{MWh} \text{ . EG}_{y} - 0 \rightarrow \mathbf{ER} = 0,2677 \text{ tCO}_{2}/\text{MWh} \text{ . EG}_{y}$$

E.6. Table providing values obtained when applying formulae above:



page 29

Year	Estimation of project activity emission reductions (tonnes of CO ₂ e)	Estimation of the baseline emission reductions (tonnes of CO ₂ e)	Estimation of leakage (tonnes of CO2e)	Estimation of emission reductions (tonnes of CO ₂ e)
2002	2.873	0	0	2.873
2003	4.367	0	0	4.367
2004	4.528	0	0	4.528
2005	5.354	0	0	5.354
2006	27.804	0	0	27.804
2007	27.804	0	0	27.804
2008	27.804	0	0	27.804
Total (tonnes of CO ₂ e)	100.534	0	0	100.534

More detailed information about electricity and emission reduction generation is provided in Annex 3 – Baseline Information.

SECTION F. Environmental impacts

F.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:

The possible environmental impacts are to be analyzed by the State Secretary of Environment (SMA – Secretaria de Estado do Meio Ambiente) through CETESB (Companhia de Tecnologia de Saneamento Ambiental) – state of São Paulo environmental agency. Lucélia was granted the Working License for LBCP Phase 1. For Phase 2, Lucélia has already applied for the Previous Environmental License, having submitted the Previous Environmental Report (RAP – Relatório Ambiental Preliminar) for analysis by the DAIA, the department within SMA responsible for analyzing environmental impacts arising from project initiatives. DAIA analyzed the RAP for Phase 1 and made no recommendations, attesting the project was in full compliance with its requirements.

There will be no transboundary impacts resulting from LBCP. All the relevant impacts occur within Brazilian borders and have been mitigated to comply with the environmental requirements for project's implementation. Moreover, the project is connected to the Brazilian grid and the country does not commercialize electricity out of its borders, meaning no energy will be exported and therefore LBCP will not affect by any means any country surrounding Brazil.



page 30

F.2. If environmental impacts are considered significant by the project participants or the <u>host</u> <u>Party</u>, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the <u>host Party</u>:

The impacts from LBCP are not considered significant. They arise from activities (cane crushing and bagasse burning) that were already in place before the project.

The secretary of environment and CETESB already analyzed the most relevant impacts from the project activity through the RAP (Preliminar Environmental Report), and the issuance of the working license attests Lucélia's compliance with the environmental legislation and environmental responsibility.

SECTION G. Stakeholders' comments

G.1. Brief description how comments by local <u>stakeholders</u> have been invited and compiled:

As a requirement of the Brazilian Interministerial Commission on Global Climate Change, the Brazilian DNA, Lucélia invited several organizations and institutions to comment the CDM project being developed. Letters¹¹ were sent to the following recipients:

- Prefeitura Municipal de Lucélia SP / Municipal Administration of Lucélia SP;
- Câmara Municipal de Lucélia SP / Municipal Legislation Chamber of Lucélia SP;
- Ministério Público / Federal Prosecutor's Office;
- Fórum Brasileiro de ONGs (SP) / Brazilian NGO Forum (SP);
- Fórum Brasileiro de ONGs (DF) / Brazilian NGO Forum (DF);
- Associação Comunitária dos Moradores do Bairro Jardim América / Communitarian Association of the residents of the Jardim América District;
- Associação Comunitária Grupo Recreativo dos Idosos / Communitarian Association Elderly Recreative Group;
- Órgão Ambiental Municipal / Municipal Environmental Agency;
- Secretaria de Estado do Meio Ambiente / Environment Secretary of State.

These letters have already been sent, and no comments were received from any of the stakeholders considered.

¹¹ The copies of these invitations are available from the Project participants.



page 31

Previously to the letters, Lucélia took to the public the initiative of expanding its cogeneration facilities in order to supply electricity to the grid. The company published announcements in newspapers with regional and national coverage, and the official newspaper of the state of São Paulo.

Initially, in February 2002, Lucélia published three announcements, being two in regional newspapers and the other one in the official newspaper. In the announcements, Lucélia first declared it had required the Installation License for LBCP Phase 1. Later, it declared it had received the license and required the Working License for LBCP Phase 1.

Further on, in September 2002, the company published a call for comments on LBCP Phase 2. Lucélia announced it had required the Previous Environmental License for Phase 2 through the submission of the RAP (Preliminary Environmental Report) to CETESB. From the date the announcements were published (21st of September), the public was invited to send comments on the project within a month.

Later, in October, Lucélia published announcements declaring it had received the working license for LBCP Phase 1.

G.2. Summary of the comments received:

Lucélia received no stakeholder comments.

G.3. Report on how due account was taken of any comments received:

Since no comments were received, Lucélia proceeded with the project as initially planned.



page 32

UNFCCO

Annex 1

CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY

1.1 Project Developer Responsible for the CDM Project Activity

Organization:	Econergy Brasil Ltda.
Street/P.O.Box:	Rua Pará, 76 cj 41
Building:	Higienópolis Office Center
City:	São Paulo
State/Region:	SP
Postfix/ZIP:	01243-020
Country:	Brazil
Telephone:	+ 55 (11) 3219-0068
FAX:	+55 (11) 3219-0693
E-Mail:	-
URL:	http://www.econergy.com.br
Represented by:	
Title:	Mr.
Salutation:	
Last Name:	Diniz Junqueira
Middle Name:	Schunn
First Name:	Marcelo
Department:	-
Mobile:	+55 (11) 8263-3017
Direct FAX:	Same above
Direct tel:	+ 55 (11) 3219-0068 ext 25 and/or mobile
Personal E-Mail:	junqueira@econergy.com.br



page 33

UNFCCC

1.2 Project Activity Host Company

Organization:	Central de Álcool Lucélia Ltda.
Street/P.O.Box:	Estrada Vicinal Paschoal Milton Lentini, km 18 – Bairro Colônia Paulista
Building:	
City:	Lucélia
State/Region:	SP
Postfix/ZIP:	17780-000
Country:	Brazil
Telephone:	+55 (18) 3551 9000
FAX:	+55 (18) 3551 9010
E-Mail:	centralcool@centralcool.com.br
URL:	http://www.centralcool.com.br
Represented by:	
Title:	Mr.
Salutation:	
Last Name:	Neto
Middle Name:	Antônio
First Name:	Serafim
Department:	Administration
Mobile:	
Direct FAX:	+55 (18) 3551 9010
Direct tel:	+55 (18) 3551 9000
Personal E-Mail:	serafim@centralcool.com.br



page 34

UNFCO

Annex 2

INFORMATION REGARDING PUBLIC FUNDING

There is no Annex I public funding involved in LBCP project activity.

Annex 3

BASELINE INFORMATION

Detailed information on the cogeneration system configuration and expected energy, as well as emission reductions, output:

	L	ucélia Bagas	se Cogenera	ation Project	t			
				First C	rediting Per	riod		
		Phase 1 2002	2003	2004	2005	Phase 2 2006	2007	2008
	Total Installed Capacity (MVA)	19,625	19,625	19,625	19,625	44,625	44,625	44,625
	Capacity "In-use" (MVA)	15,0	15,0	15,0	15,0	40,0	40,0	40,0
	Standby (MVA)	4,625	4,625	4,625	4,625	4,625	4,625	4,625
	Maximum Exploitable Capacity (MW)*	13,38	13,38	13,38	13,38	33,12	33,12	33,12
	Total Capacity for Internal Consumption (MW)	5,60	5,60	5,60	7,36	7,36	7,36	7,36
roject	Total Capacity for Surplus Electricity (MW)	7,78	7,78	7,78	6,02	25,76	25,76	25,76
Cogeneration Project	Contracted Capacity for Firm Energy (MW)	3,00	3,00	3,00	6,02	25,76	25,76	25,76
ogener	Hours of Operation (h)**	1.724	6.042	7.048	4.153	5.040	5.040	5.040
ŏ	Capacity Factor	0,8	0,9	0,8	0,8	0,8	0,8	0,8
	Energy to be Sold to Enertrade (MWh)***	10.732	16.312	16.915	20.000	103.864	103.864	103.864
	Baseline Carbon Instensity (mtCO ₂ /MWh)	0,2677	0,2677	0,2677	0,2677	0,2677	0,2677	0,2677
	Total CO ₂ emissions reductions - yearly (mtCO ₂)	2.873	4.367	4.528	5.354	27.804	27.804	27.804
	Total CO ₂ emissions reductions - First Crediting Period (mtCO ₂)			1	100.534			

The Brazilian electricity system has been historically divided into two subsystems: the North-Northeast (N-NE) and the South-Southeast-Midwest (S-SE-CO). This is due mainly to the historical evolution of the physical system, which was naturally developed nearby the biggest consuming centers of the country.



page 35

INFCC

The natural evolution of both systems is increasingly showing that integration is to happen in the future. In 1998, the Brazilian government was announcing the first leg of the interconnection line between S-SE-CO and N-NE. With investments of around US\$700 million, the connection had the main purpose, in the government's view, at least, to help solve energy imbalances in the country: the S-SE-CO region could supply the N-NE in case it was necessary and vice-versa.

Nevertheless, even after the interconnection had been established, technical papers still divided the Brazilian system in two $(Bosi, 2000)^{12}$:

"... where the Brazilian Electricity System is divided into three separate subsystems:

- (i) The South/Southeast/Midwest Interconnected System;
- (ii) The North/Northeast Interconnected System; and
- (iii) The Isolated Systems (which represent 300 locations that are electrically isolated from the interconnected systems)"

Moreover, Bosi (2000) gives a strong argumentation in favor of having so-called *multi-project baselines*:

"For large countries with different circumstances within their borders and different power grids based in these different regions, multi-project baselines in the electricity sector may need to be disaggregated below the country-level in order to provide a credible representation of 'what would have happened otherwise'".

Finally, one has to take into account that even though the systems today are connected, the energy flow between N-NE and S-SE-CO is heavily limited by the transmission lines capacity. Therefore, only a fraction of the total energy generated in both subsystems is sent one way or another. It is natural that this fraction may change its direction and magnitude (up to the transmission line's capacity) depending on the hydrological patterns, climate and other uncontrolled factors. But it is not supposed to represent a significant amount of each subsystem's electricity demand. It has also to be considered that only in 2004 the interconnection between SE and NE was concluded, i.e., if project proponents are to be coherent with the generation database they have available as of the time of the PDD submission for validation, a situation where the electricity flow between the subsystems was even more restricted is to be considered.

The Brazilian electricity system nowadays comprises of around 91,3 GW of installed capacity, in a total of 1.420 electricity generation enterprises. From those, nearly 70% are hydropower plants, around 10% are natural gas-fired power plants, 5,3% are diesel and fuel oil plants, 3,1% are biomass sources (sugarcane bagasse, black liquor, wood, rice straw and biogas), 2% are nuclear plants, 1,4% are coal plants, and there are also 8,1 GW of installed capacity in neighboring countries (Argentina, Uruguay, Venezuela and Paraguay) that may dispatch electricity to the Brazilian grid. (http://www.aneel.gov.br/aplicacoes/capacidadebrasil/OperacaoCapacidadeBrasil.asp). This latter capacity is in fact comprised by mainly 6,3 GW of the Paraguayan part of *Itaipu Binacional*, a hydropower plant operated by both Brazil and Paraguay, but whose energy almost entirely is sent to the Brazilian grid.

Approved methodologies AM0015 and ACM0002 ask project proponents to account for "all generating sources serving the system". In that way, when applying one of these methodologies, project proponents in Brazil should search for, and research, all power plants serving the Brazilian system.

¹² Bosi, M. An Initial View on Methodologies for Emission Baselines: Electricity Generation Case Study. International Energy Agency. Paris, 2000.



UNFCCC

CDM – Executive Board

page 36

In fact, information on such generating sources is not publicly available in Brazil. The national dispatch center, ONS – *Operador Nacional do Sistema* – argues that dispatching information is strategic to the power agents and therefore cannot be made available. On the other hand, ANEEL, the electricity agency, provides information on power capacity and other legal matters on the electricity sector, but no dispatch information can be got through this entity.

In that regard, project proponents looked for a plausible solution in order to be able to calculate the emission factor in Brazil in the most accurate way. Since real dispatch data is necessary after all, the ONS was contacted, in order to let participants know until which degree of detail information could be provided. After several months of talks, plants' daily dispatch information was made available for years 2002, 2003 and 2004.

Project proponents, discussing the feasibility of using such data, concluded it was the most proper information to be considered when determining the emission factor for the Brazilian grid. According to ANEEL, in fact, ONS centralized dispatched plants accounted for 75.547 MW of installed capacity by 31/12/2004, out of the total 98.848,5 MW installed in Brazil by the same date (http://www.aneel.gov.br/arquivos/PDF/Resumo Gráficos mai 2005.pdf), which includes capacity available in neighboring countries to export to Brazil and emergency plants, that are dispatched only during times of electricity constraints in the system. Such capacity in fact is constituted by plants with 30 MW installed capacity or above, connected to the system through 138 kV power lines, or at higher voltages. Therefore, even though the emission factor calculation is carried out without considering all generating sources serving the system, about 76,4% of the installed capacity serving Brazil is taken into account, which is a fair amount if one looks at the difficulty in getting dispatch information in Brazil. Moreover, the remaining 23,6% are plants that do not have their dispatch coordinated by ONS, since: either they operate based on power purchase agreements which are not under control of the dispatch authority; or they are located in non-interconnected systems to which ONS has no access. In that way, this portion is not likely to be affected by the CDM projects, and this is another reason for not taking them into account when determining the emission factor.

In an attempt to include all generating sources, project developers considered the option to research for available, but non-official data, to supply the existing gap. The solution found was the International Energy Agency database built when carrying out the study "Road-Testing Baselines For Greenhouse Gas Mitigation Projects in the Electric Power Sector", published in October 2002. Merging ONS data with the IEA data in a spreadsheet, project proponents have been able to consider all generating sources connected to the relevant grids in order to determine the emission factor. The emission factor calculated was found more conservative when considering ONS data only, as the table below shows the build margin in both cases.

IEA/ONS Merged Data Build Margin	ONS Data Build Margin		
(tCO2/MWh)	(tCO2/MWh)		
0,205	0,1045		

Therefore, considering all the rationale explained, project developers decided for the database considering ONS information only, as it was capable of properly addressing the issue of determining the emission factor and doing it in the most conservative way.



The fossil fueled plants efficiencies were also taken from the IEA paper. This was done considering the lack of more detailed information on such efficiencies from public, reliable and credible sources.

From the mentioned reference:

The fossil fuel conversion efficiency (%) for the thermal power plants was calculated based on the installed capacity of each plant and the electricity actually produced. For most of the fossil fuel power plants under construction, a constant value of 30% was used as an estimate for their fossil fuel conversion efficiencies. This assumption was based on data available in the literature and based on the observation of the actual situation of those kinds of plants currently in operation in Brazil. The only 2 natural gas plants in combined cycle (totaling 648 MW) were assumed to have a higher efficiency rate, i.e. 45%.

Therefore only data for plants under construction in 2002 (with operation start in 2002, 2003 and 2004) was estimated. All others efficiencies were calculated. To the best of our knowledge there was no retrofit/modernization of the older fossil-fuelled power plants in the analyzed period (2002 to 2004). For that reason project participants find the application of such numbers to be not only reasonable but the best available option.

The aggregated hourly dispatch data got from ONS was used to determine the lambda factor for each of the years with data available (2002, 2003 and 2004). The Low-cost/Must-run generation was determined as the total generation minus fossil-fuelled thermal plants generation, this one determined through daily dispatch data provided by ONS. All this information has been provided to the validators, and extensively discussed with them, in order to make all points crystal clear.

On the following pages, a summary of the analysis is provided. First, the table with the 130 plants dispatched by the ONS are provided. Then, a table with the summarized conclusions of the analysis, with the emission factor calculation displayed. Finally, the load duration curves for the S-SE-MW system are presented.

ONS Dispatched Plants



page 38

/	Subsystem*	Fuel source**	Power plant	Operation start [2, 4, 5]	Installed capacity (MW) [1]	Fossil fuel conversion	Carbon emission factor (tC/TJ) [3]	Fraction carbon oxidized [3]	Emission factor (tCO2/MWh)
1	S-SE-CO S-SE-CO	H H	Jauru Gauporé	Sep-2003 Sep-2003	121.5 120.0	efficiency (%) [2] 1	0.0	0.0%	0.000
3	S-SE-CO S-SE-CO	G	Três Lagoas Funil (MG)	Aug-2003 Jan-2003	306.0 180.0	0.3	15.3 0.0	99.5%	0.670
5	S-SE-CO S-SE-CO	H	Itiquira I Araucária	Sep-2002 Sep-2002	156.1 484.5	1	0.0	0.0%	0.000
7	S-SE-CO S-SE-CO	G	Canoas Piraiu	Sep-2002 Sep-2002	160.6 81.0	0.3	15.3	99.5%	0.670
9 10	S-SE-CO S-SE-CO	G	Nova Piratininga PCT CGTEE	Jun-2002 Jun-2002	384.9 5.0	0.3	15.3 20.7	99.5% 99.0%	0.670
11	S-SE-CO S-SE-CO	H	Rosal Ibirité	Jun-2002 May-2002	55.0 226.0	1	0.0	0.0%	0.000
13 14	S-SE-CO S-SE-CO	H	Cana Brava Sta. Clara	May-2002 Jan-2002	465.9 60.0	1	0.0	0.0%	0.000
15 16	S-SE-CO S-SE-CO	H	Machadinho Juiz de Fora	Jan-2002 Nov-2001	1,140.0 87.0	1 0.28	0.0	0.0%	0.000
17 18	S-SE-CO S-SE-CO	G H	Macaé Merchant Lajeado (ANEL res. 402/2001)	Nov-2001 Nov-2001	922.6 902.5	0.24	15.3 15.3 0.0	99.5% 0.0%	0.837
19	S-SE-CO S-SE-CO	G H G	Eletrobolt Porto Estrela	Oct-2001 Sep-2001	379.0 112.0 529.2	0.24	15.3	99.5% 0.0% 99.5%	0.837 0.000 0.670
22	S-SE-CO S-SE-CO S-SE-CO	G	Cuiaba (Mario Covas) W. Arjona Uruguaiana	Aug-2001 Jan-2001 Jan-2000	529.2 194.0 639.9	0.3 0.25 0.45	15.3 15.3 15.3	99.5% 99.5%	0.804
24 25	S-SE-CO S-SE-CO	H	S. Caxias Canoas I	Jan-1999 Jan-1999	1,240.0 82.5	1	0.0	0.0%	0.000
26 27	S-SE-CO S-SE-CO	H	Canoas II Igarapava	Jan-1999 Jan-1999	72.0 210.0	1	0.0	0.0%	0.000
28 29	S-SE-CO S-SE-CO	H	Porto Primavera Cuiaba (Mario Covas)	Jan-1999 Oct-1998	1,540.0 529.2	0.27	0.0 20.2	0.0%	0.000
30 31	S-SE-CO S-SE-CO	H	Sobragi PCH EMAE	Sep-1998 Jan-1998	60.0 26.0	1	0.0	0.0%	0.000
32 33	S-SE-CO S-SE-CO	н	PCH CEEE PCH ENERSUL	Jan-1998 Jan-1998	25.0 43.0	1	0.0	0.0%	0.000
34 35	S-SE-CO S-SE-CO	н	PCH CEB PCH ESCELSA	Jan-1998 Jan-1998	15.0 62.0	1	0.0	0.0%	0.000
36 37 38	S-SE-CO S-SE-CO S-SE-CO	H	PCH CELESC PCH CEMAT PCH CELG	Jan-1998 Jan-1998 Jan-1998	50.0 145.0 15.0	1	0.0 0.0 0.0	0.0%	0.000
38 39 40	S-SE-CO S-SE-CO S-SE-CO	н	PCH CEEG PCH CERJ PCH COPEL	Jan-1998 Jan-1998 Jan-1998	59.0 70.0	1	0.0	0.0%	0.000
40	S-SE-CO S-SE-CO	н	PCH CEMIG PCH CEFL	Jan-1998 Jan-1998	84.0	1	0.0	0.0%	0.000
43	S-SE-CO S-SE-CO	H	S. Mesa PCH EPAULO	Jan-1998 Jan-1998	1,275.0	1	0.0	0.0%	0.000
45 46	S-SE-CO S-SE-CO	н	Guilmam Amorim Corumbá	Jan-1997 Jan-1997	140.0	1	0.0	0.0%	0.000
47	S-SE-CO S-SE-CO	н	Miranda Noav Ponte	Jan-1997 Jan-1994	408.0 510.0	1	0.0	0.0%	0.000
49	S-SE-CO S-SE-CO	H	Segredo (Gov. Nøy Braga) Taquaruçu	Jan-1992 Jan-1989	1,260.0	1	0.0	0.0%	0.000
51 52	S-SE-CO S-SE-CO	H H	Manso D. Francisca	Jan-1988 Jan-1987	210.0 125.0	1	0.0	0.0%	0.000
53 54	S-SE-CO S-SE-CO	н	Itá Rosana	Jan-1987 Jan-1987	1,450.0 369.2	1	0.0	0.0%	0.000
55 56 57	S-SE-CO S-SE-CO S-SE-CO	N H H	Angra T. Irmãos Itaipu 60 Hz	Jan-1985 Jan-1985 Jan-1983	1,874.0 807.5 6,300.0	1	0.0 0.0 0.0	0.0%	0.000 0.000 0.000
58 59	S-SE-CO S-SE-CO	н	Itaipu 50 Hz Emborcação	Jan-1983 Jan-1982	5,375.0	1	0.0	0.0%	0.000
60 61	S-SE-CO S-SE-CO	н	Nova Avanhandava Gov. Bento Munhoz - GBM	Jan-1982 Jan-1980	347.4	1	0.0	0.0%	0.000
62	S-SE-CO S-SE-CO	н	S.Santiago Itumbiara	Jan-1980 Jan-1980	1,420.0	1	0.0	0.0%	0.000
64 65	S-SE-CO S-SE-CO	O H	lgarapé Itauba	Jan-1978 Jan-1978	131.0 512.4	0.3	20.7 0.0	99.0% 0.0%	0.902
66 67	S-SE-CO S-SE-CO	н	A. Vermelha (Jose E. Moraes) S.Simão	Jan-1978 Jan-1978	1,396.2	1	0.0	0.0%	0.000
68 69	S-SE-CO S-SE-CO	H H	Capivara S.Osório	Jan-1977 Jan-1975	640.0 1,078.0	1	0.0	0.0%	0.000
70 71 72	S-SE-CO S-SE-CO S-SE-CO	H H C	Marimbondo Promissão Pres. Medici	Jan-1975 Jan-1975 Jan-1974	1,440.0 264.0 446.0	1 1 0.26	0.0 0.0 26.0	0.0% 0.0% 98.0%	0.000 0.000 1.294
73	S-SE-CO S-SE-CO	н	Volta Grande Porto Colombia	Jan-1974 Jun-1973	380.0	1	0.0	0.0%	0.000
75	S-SE-CO S-SE-CO	Н	Passo Fundo Passo Real	Jan-1973 Jan-1973	220.0 158.0	1	0.0	0.0%	0.000
77 78	S-SE-CO S-SE-CO	H	Iha Solteira Mascarenhas	Jan-1973 Jan-1973	3,444.0 131.0	1	0.0	0.0%	0.000
79 80	S-SE-CO S-SE-CO	H	Gov. Parigot de Souza - GPS Chavantes	Jan-1971 Jan-1971	252.0 414.0	1	0.0	0.0%	0.000
81 82	S-SE-CO S-SE-CO	H	Jaguara Sá Carvalho	Jan-1971 Apr-1970	424.0 78.0	1	0.0	0.0%	0.000
83 84	S-SE-CO S-SE-CO	H	Estreito (Luiz Carlos Barreto) Ibitinga	Jan-1969 Jan-1969	1,050.0 131.5	1	0.0	0.0%	0.000
85 86	S-SE-CO S-SE-CO	Н	Jupiá Alegrete	Jan-1969 Jan-1968	1,551.2 66.0	0.26	0.0 20.7	0.0%	0.000
87 88	S-SE-CO S-SE-CO	G	Campos (Roberto Silveira) Santa Cruz (RJ)	Jan-1968 Jan-1968	30.0 766.0	0.24 0.31	15.3 15.3	99.5% 99.5%	0.837
89 90 91	S-SE-CO S-SE-CO S-SE-CO	H H H	Paraibuna Limoeiro (Armando Sales de Olviera) Caconde	Jan-1968 Jan-1967 Jan-1966	85.0 32.0 80.4	1	0.0 0.0 0.0	0.0%	0.000
91 92 93	S-SE-CO	H C C	J.Lacerda C	Jan-1965	363.0	0.25	26.0	98.0%	1.345
93 94 95	S-SE-CO S-SE-CO S-SE-CO	C C H	J.Lacerda B J.Lacerda A Bafiri (Alvaro de Souza Lima)	Jan-1965 Jan-1965 Jan-1965	262.0 232.0 143.1	0.21 0.18 1	26.0 26.0 0.0	98.0% 98.0% 0.0%	1.602 1.869 0.000
95 96 97	S-SE-CO S-SE-CO S-SE-CO	H	Banni (Alvaro de Souza Lina) Funil (RJ) Figueira	Jan-1965 Jan-1965 Jan-1963	143.1 216.0 20.0	1 1 0.3	0.0	0.0%	0.000
97 98 99	S-SE-CO S-SE-CO S-SE-CO	н	Fumas Barra Bonita	Jan-1963 Jan-1963	1,216.0	1	0.0	0.0%	0.000
100 101	S-SE-CO S-SE-CO	C H	Charqueadas Jurumirim (Armando A. Laydner)	Jan-1962 Jan-1962	72.0	0.23	26.0	98.0%	1.462
102 103	S-SE-CO S-SE-CO	н	Jacui Pereira Passos	Jan-1962 Jan-1962	180.0 99.1	1	0.0	0.0%	0.000
104 105	S-SE-CO S-SE-CO	H	Tres Marias Euclides da Cunha	Jan-1962 Jan-1960	396.0 108.8	1	0.0	0.0%	0.000
106	S-SE-CO S-SE-CO	H	Camargos Santa Branca	Jan-1960 Jan-1960	46.0 56.1	1	0.0	0.0%	0.000
108 109	S-SE-CO S-SE-CO	HHH	Cachoeira Dourada Salto Grande (Lucas N. Garcez) Salto Grande (MG)	Jan-1959 Jan-1958	658.0 70.0 102.0	1	0.0 0.0 0.0	0.0%	0.000
110 111 112	S-SE-CO S-SE-CO S-SE-CO	H H H	Salto Grande (MG) Mascarenhas de Moraes (Peixoto) Itutinga	Jan-1956 Jan-1956 Jan-1955	102.0 478.0 52.0	1	0.0	0.0%	0.000 0.000 0.000
112 113 114	S-SE-CO	H C O	S. Jerônimo	Jan-1954	20.0	0.26	26.0	98.0%	1.294
114 115 116	S-SE-CO S-SE-CO S-SE-CO	0 0 H	Carioba Piratininga Canastra	Jan-1954 Jan-1954 Jan-1953	36.2 472.0 42.5	0.3	20.7 20.7 0.0	99.0% 99.0% 0.0%	0.902
116 117 118	S-SE-CO S-SE-CO S-SE-CO	H	Canastra Nilo Peçanha Fontes Nova	Jan-1953 Jan-1953 Jan-1940	42.5 378.4 130.3	1	0.0	0.0%	0.000
119	S-SE-CO S-SE-CO S-SE-CO	н	Henry Borden Sub. Henry Borden Ext.	Jan-1940 Jan-1926 Jan-1926	420.0	1	0.0	0.0%	0.000
120	S-SE-CO S-SE-CO	н	I. Pombos Jaguari	Jan-1924 Jan-1917	189.7	1	0.0	0.0%	0.000
				Total (MW) =			0.0	0.078	0.000
" Fue	I source (C, bituminous		natural gas; H, hydro; N, nuclear; O, residual						
[11] Agencia Nacional de Sergia Eliterica. Sarco de Informações da Garação (http://www.amandago.br/, dita cidencia in novertez 2004) Informação - Particida Regularização - Particida									

0.670



page 39

UNFCCC

Summary table

Emission factors for the Brazilian South-Southeast-Midwest interconnected grid									
Baseline (including imports)	EF _{OM} [tCO2/MWh]	Load [MWh]	LCMR [GWh]	Imports [MWh]					
2002	0,8504	275.402.896	258.720	1.607.395					
2003	0,9378	288.493.929	274.649	459.586					
2004	0,8726	297.879.874	284.748	1.468.275					
	Total (2001-2003) =	861.776.699	818.118	3.535.256					
	EF OM, simple-adjusted [tCO2/MWh]	EF BM,2004	Lambda						
	0,4310	0,1045	λ_{2002}						
	Alternative weights	Default weights	0,5053						
	$w_{OM} = 0,75$	$w_{OM} = 0,5$	λ 20	2003					
	$W_{BM} = 0,25$	$w_{BM} = 0,5$	0,5312						
	EF CM [tCO2/MWh]	Default EF OM [tCO2/MWh]	λ_{2004}						
	0,3494	0,2677	0,5041						

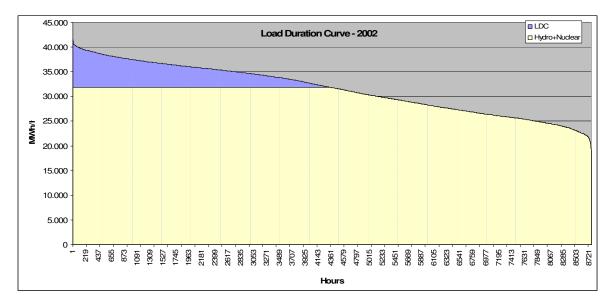


Figure 4. Load duration curve for the S-SE-MW system, 2002



page 40

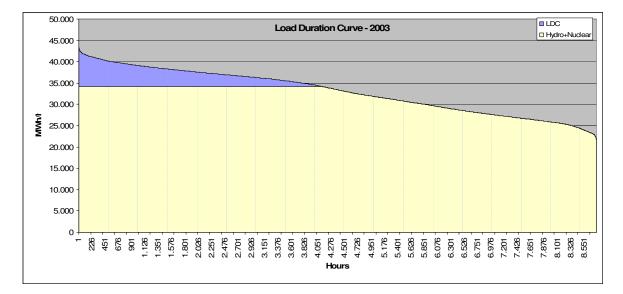


Figure 5. Load duration curve for the S-SE-MW system, 2003

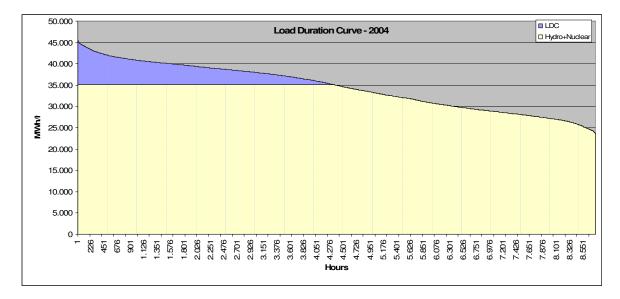


Figure 6. Load duration curve for the S-SE-MW system, 2004

UNFCCC



page 41

Annex 4

MONITORING PLAN

According to the section D of this document, the only variable that will be monitored in this project activity is the quantity of energy exported to the grid, from year 2002 up to the end of the last crediting period. Since no leakage nor any off-grid emissions change were identified in this project activity, there will be no need to monitor the variables for these cases. The monitoring will occur as follows:

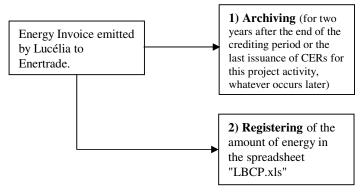


Figure 7: Monitoring procedures for Lucélia

The quantity of energy exported to the grid will be monitored through the energy invoice emitted by Lucélia to Enertrade, the energy distributor. The archiving will occur up to two years after the end of the crediting period or the last issuance of CERs for this project activity, whatever occurs later. The amount of energy will be registered in the spreadsheet "LBCP.xls", which shall be the instrument for the further Verification.

Paid invoices are archived by the accountancy department of the mill, as this has to be kept for taxing purposes. The Brazilian legislation requires that at least such documents are kept for a 5-year period. Considering there is a CDM project associated with the electricity generation, the invoices will be kept up to two years after the end of the crediting period.