



**CLEAN DEVELOPMENT MECHANISM  
PROJECT DESIGN DOCUMENT FORM (CDM-PDD)  
(Version 02 - in effect as of: 1 July 2004)**

**CONTENTS**

- A. General description of project activity
- B. Application of a baseline methodology
- C. Duration of the project activity / Crediting period
- D. Application of a monitoring methodology and plan
- E. Estimation of GHG emissions by sources
- F. Environmental impacts
- G. Stakeholders' comments

**Annexes**

- Annex 1: Contact information on participants in the project activity
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring plan

**SECTION A. General description of project activity****A.1 Title of the project activity:**

Cerradinho Bagasse Cogeneration Project (CBCP)

**A.2. Description of the project activity:**

This project activity consists of increasing efficiency in the bagasse (a renewable fuel source, residue from sugarcane processing) cogeneration facility of **Usina Cerradinho Açúcar e Alcool S/A** (Cerradinho), a Brazilian sugar mill. With the implementation of this project, the mill has been able to sell electricity to the national grid, avoiding that fossil-fuelled thermal plants dispatch the same amount of energy to that grid. By that, the initiative avoids CO<sub>2</sub> emissions, also contributing to the regional and national sustainable development.

By investing to increase steam efficiency in the sugar and alcohol production and increase the efficiency at burning the bagasse (more efficient boilers), Cerradinho generates surplus steam and use it exclusively for electricity production (through turbo-generators).

The sponsors of the CBCP are concerned that bagasse cogeneration is a sustainable source of energy that brings not only advantages for mitigating global warming, but also creates a sustainable competitive advantage for the agricultural production in the sugarcane industry in Brazil. Using the available natural resources in a more efficient way, the Cerradinho project activity helps to enhance the consumption of renewable energy. Besides that, it is used to demonstrate the feasibility of electricity generation as a side-business source of revenue for the sugar industry. It is worthy to highlight that out of approximately 320 sugar mills in Brazil, the great majority produces energy for on-site use only, and not for grid supply, which is mainly due to the low-efficiency cogeneration equipment installed on those sugar mills.

Furthermore, bagasse cogeneration also plays an important role on the country's economic development, as Brazil's sugarcane-based industry provides for approximately 1 million jobs and represents one of the major agribusiness products within the trade balance of the country. The Brazilian heavy industry has developed the technology to supply the sugarcane industry with equipments to provide expansion for the cogeneration, therefore such heavy industry development also helps the country creating jobs and achieving the sustainable development.

Bagasse cogeneration is important for the energy strategy of the country. Cogeneration is an alternative to postpone the installation and/or dispatch of electricity produced by fossil-fuelled generation utilities. The sale of the CER generated by the project will boost the attractiveness of bagasse cogeneration projects, helping to increase the production of this energy and decrease dependency on fossil fuel.

Cerradinho also believes that sustainable development will be achieved not only by the implementation of a renewable energy production facility, but carrying out activities which corresponds to the company social and environmental responsibilities, as described below:

**Social Contribution**

Cerradinho consider its employees to be its most valuable and most important resource and therefore stimulates them to be deeply engaged with the results of the company. Cerradinho has always



supported the development of human resources. The employees' contribution to increase the quality of the products is heavily dependent on their quality of life. In order to achieve a higher quality human resource management, the company focuses special attention on the social responsibility, work safety and health care.

Cerradinho truly believes that taking care of its employees provides consistent results and therefore promotes many company social responsibility programs such as continued education scholarship program for technical, undergrad and post-graduation studies, Sugar and Alcohol Laboratory and Technical formation on a local school, on-site training and classes, Catanduva theatre sponsorship and school material supply. Moreover, Cerradinho provides sports facilities, library and medical care to any children from Catanduva and Cantingá, providing them also courses within music, handcraft, and citizenship among many other safety and social programs. The company is socially oriented, and very focused on to its surrounding areas' children, what can be seen in the annexed "Corporation children friend" seal it has received from the UNICEF supported institution Abrinq<sup>1</sup>. Social investments accounted for R\$ 786.000 in 2002.

The total jobs, directly and indirectly, Cerradinho had during the year-crop 2001 were about 2.000 people. Considering the great number of farmers that benefit from the company, who employ some other people to maintain their cane plantation, it is possible to say that Cerradinho is one of the most important job creators in that 105.000 people city where the company is located.

Increasing the firm's annual revenues due to CERs commercialization adds substantial value to the direct employees of the firm, its sugarcane providers, their families and the local community.

### **Environmental contribution**

Besides reducing the GHG emissions by the construction of its projects, Cerradinho has also been developing the following environmental programs:

- Environmental education for the community and incentives for ecological track and donation of seeds to entities;
- Maintenance of an own nursery of native species for reforestation with 700 thousand of trees in 7 years, aiming the preservation of flora, fauna, contributing with the maintenance and improvement of the water resources and of the air quality;
- In the management of the industrial and agricultural processes, applies the optimization of the use of the water, superficial and subterranean water monitoring, controlled irrigation, biological control of pests, aiming to reduce the use of toxic products in the agriculture.

#### **A.3. Project participants:**

Usina Cerradinho Açúcar e Alcool S/A (Cerradinho), a Brazilian private company.  
Econergy Brasil Ltda (Econergy), a Brazilian private company.

#### **A.4. Technical description of the project activity:**

##### **A.4.1. Location of the project activity:**

<sup>1</sup> <http://www.fundabrinq.org.br/>

**A.4.1.1. Host Party(ies):**

Brazil

**A.4.1.2. Region/State/Province etc.:**


São Paulo

**A.4.1.3. City/Town/Community etc:**

Catanduva

**A.4.1.4. Detail of physical location, including information allowing the unique identification of this project activity (maximum one page):**

Catanduva is located in northeastern State of São Paulo, about 378 kilometers (km) far from the state capital, São Paulo, in the agricultural region of Catanduva, as can be seen in Figure 1. The region holds an ample availability of manpower, and communication and transport infrastructures, and can be accessed through a direct highway from São Paulo, “Rodovia Washington Luiz” (SP-310).

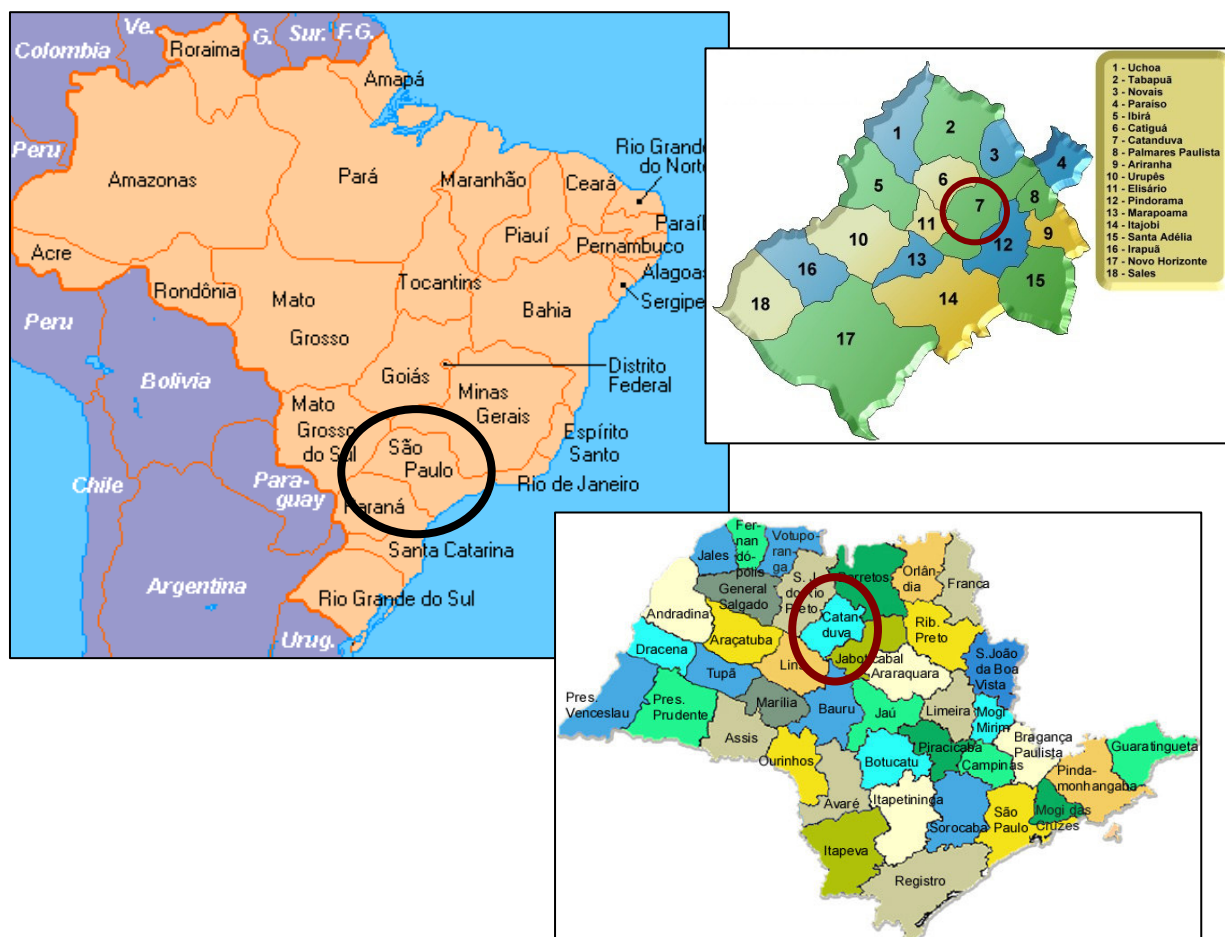

Source: Elaborated from Coordenadoria de Assistência Técnica Integral (CATI)

**Figure 1: Geographical position of the city of Catanduva****A.4.2. Category(ies) of project activity:**

Sectorial Scope: 1-Energy industries (renewable / non-renewable sources)

**A.4.3. Technology to be employed by the project activity:**


The predominant technology in all parts of the world today for generating megawatt (MW) levels of electricity from biomass is the steam-Rankine cycle, which consists of direct combustion of biomass in a boiler to generate steam, which is then expanded through a turbine. Most steam cycle plants are located at industrial sites, where the waste heat from the steam turbine is recovered and used for meeting industrial-process heat needs. Such combined heat and power (CHP), or cogeneration, systems provide greater levels of energy services per unit of biomass consumed than systems that generate electric power only.

The steam-Rankine cycle involves heating pressurized water, with the resulting steam expanding to drive a turbine-generator, and then condensing back to water for partial or full recycling to the boiler. A heat exchanger is used in some cases to recover heat from flue gases to preheat combustion air, and a de-aerator must be used to remove dissolved oxygen from water before it enters the boiler.

Steam turbines are designed as either "backpressure" or "condensing" turbines. CHP applications typically employ backpressure turbines, wherein steam expands to a pressure that is still substantially above ambient pressure. It leaves the turbine still as a vapor and is sent to satisfy industrial heating needs, where it condenses back to water. It is then partially or fully returned to the boiler. Alternatively, if process steam demands can be met using only a portion of the available steam, a condensing-extraction steam turbine (CEST) might be used. This design includes the capability for some steam to be extracted at one or more points along the expansion path for meeting process needs (Figure 2). Steam that is not extracted continues to expand to sub-atmospheric pressures, thereby increasing the amount of electricity generated per unit of steam compared to the backpressure turbine. The non-extracted steam is converted back to liquid water in a condenser that utilizes ambient air and/or a cold water source as the coolant<sup>2</sup>.

---

<sup>2</sup> Williams & Larson, 1993 and Kartha & Larson, 2000, p.101

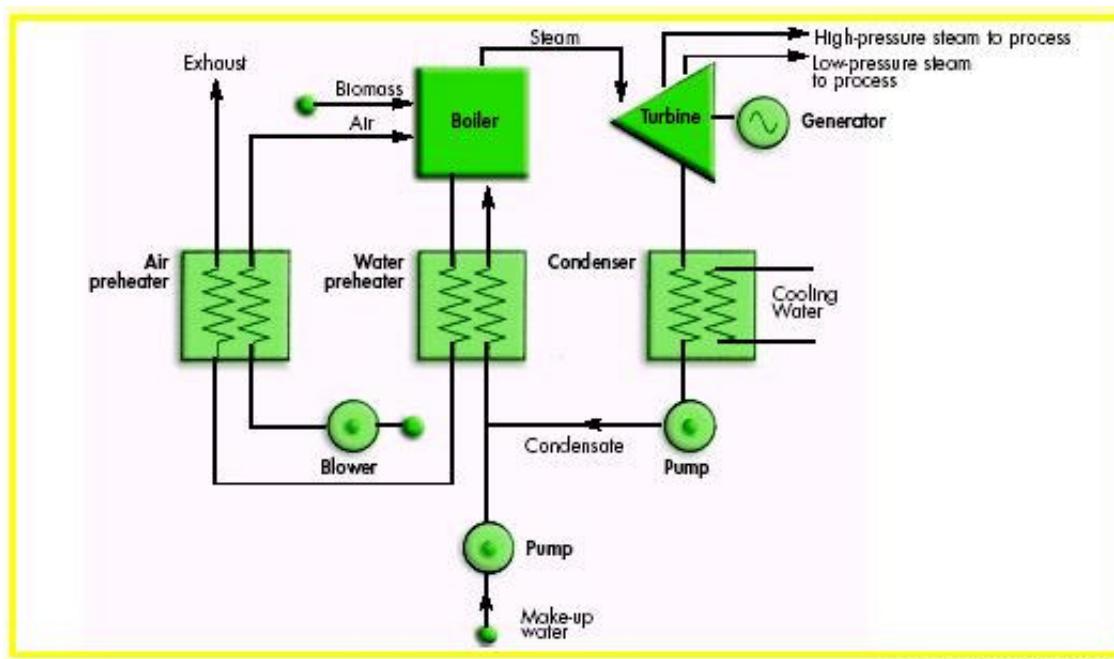

**Figure 2: Schematic diagram of a biomass-fired steam-Rankine cycle for cogeneration using a condensing-extraction steam turbine**

The steam-Rankine cycle uses different boiler designs, depending on the scale of the facility and the characteristics of the fuel being used. The initial pressure and temperature of the steam, together with the pressure to which it is expanded, determine the amount of electricity that can be generated per kilogram of steam. In general, the higher the peak pressure and temperature of the steam, the more efficient, sophisticated, and costly the cycle is.

Using steam-Rankine cycle as the basic technology of its cogeneration system, for achieving an increasing amount of surplus electricity to be generated, Cerradinho began its efforts in two phases, which are:

**Phase 1 (2002):** Installation of a high efficiency 62 kgf/cm<sup>2</sup> pressure boiler providing 150 ton of steam per hour at 450 °C therefore consuming less bagasse per ton of steam generated. Installed also a new backpressure 25 MW turbo-generator; CBCP built up also a new powerhouse, a sub-station and a transmission line, increasing the efficiency to exploit biomass energy significantly. A 1,2MW turbo-generator was deactivated when 2002's harvest season ends.

For this first phase there is an intention to annually supply the grid with renewable energy around the amount of 52,000MWh during the harvest season of 2003/2004. For the local utility company it is an advantage to buy energy produced by a sugar mill, as the baseload for the utilities in Brazil is supported mainly through hydro generation, and the sugarcane crop season is during the dry period. Eletropaulo is the utility that has signed a ten years contract with Cerradinho.


**Phase 2 (2006):** By the year 2006, the CBCP is considering to continue the investment from the year 2002, to reach a higher installed capacity and efficiency for exploiting biomass through the acquisition of an additional 30MW condensing type, with steam extraction (21kgf/cm<sup>2</sup>), turbo generator and another 62 kgf/cm<sup>2</sup> pressure boiler, operating at 480°C producing 200 tons of steam per hour.

The two old boilers that operate at 21 kgf/cm<sup>2</sup> are going to be deactivated and the 4MW generator that was installed before Phase 1 will be put into standby position.

Second phase investments are expected to be approximately R\$ 30 million and funding is still being negotiated. Long-term finance in Brazil is provided mainly by BNDES, the Brazilian development bank. This is the case for several energy projects, not only in the sugar industry. The bank has no interest whatsoever in subsidizing this sort of initiatives. The interest rate to be applied is composed by a so-called 'long-term interest rate', which the bank makes publicly available, plus the spread applied by a local bank, which works as intermediary of the resources.

Moreover, the technology for expanding the electricity availability from biomass in the sugar industry is, for the local utility companies, an advantage, as the baseload for the utilities in Brazil are supported mainly with hydro-generation and the Sugar Mill, coincidentally, supplies electricity during the dry season.

The **Figure 3** shows the detailed location of the project activity installed equipments on Cerradinho's site and installed electric engines.

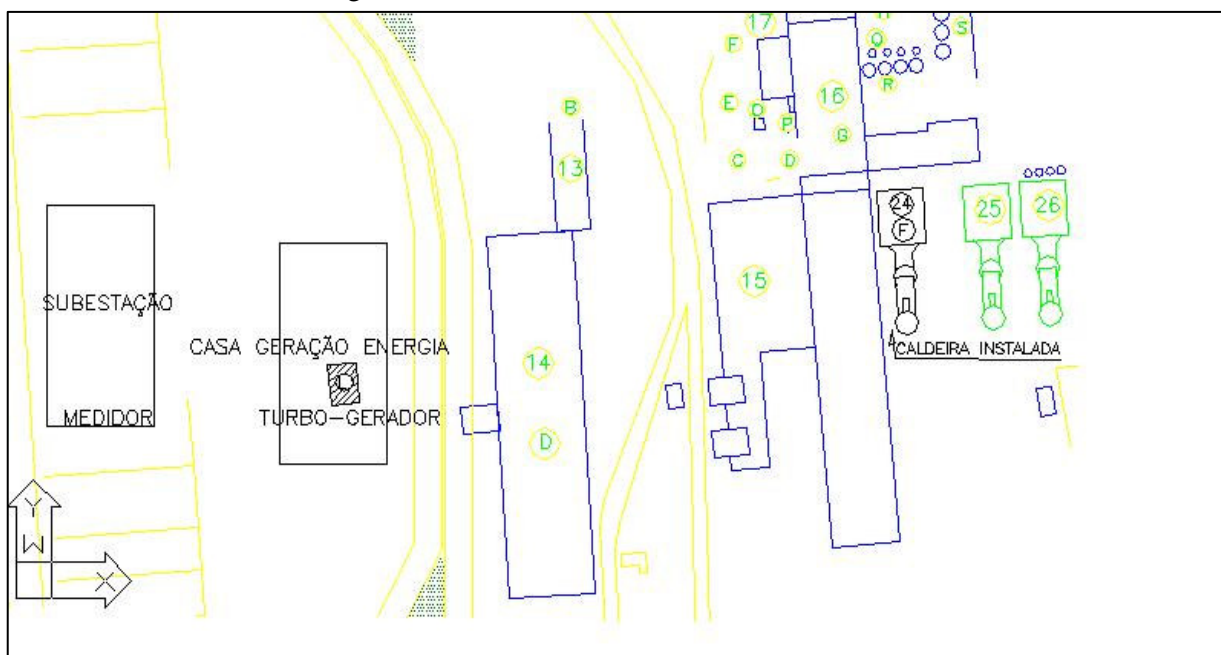

**Figure 3: Location of installed equipments for bagasse cogeneration at Cerradinho site - Lay out**



Tabela 1 shows project activity implementation schedule for bagasse cogeneration project.

**Table 1: Cerradinho Bagasse Cogeneration Project Technical Data**

	Active / Activating			Stand by / Deactivated	
Before the Expansion Plan 2001	One 1,2 MW backpressure turbo generator	One 4 MW backpressure turbo generator			
	Two 21 kgf/cm <sup>2</sup> pressure boilers				
Phase 1 2002	One 25 MW backpressure turbo generator	One 4 MW backpressure turbo generator		One 1,2 MW backpressure turbo generator	
	One 62 kgf/cm <sup>2</sup> pressure boiler	Two 21 kgf/cm <sup>2</sup> pressure boilers			
Phase 2 2006	One 30 MW condensing type turbo generator	One 25 MW backpressure turbo generator		One 4 MW backpressure turbo generator	One 1,2 MW backpressure turbo generator
	One 62 kgf/cm <sup>2</sup> pressure boiler	One 62 kgf/cm <sup>2</sup> pressure boiler		Two 21 kgf/cm <sup>2</sup> pressure boilers	

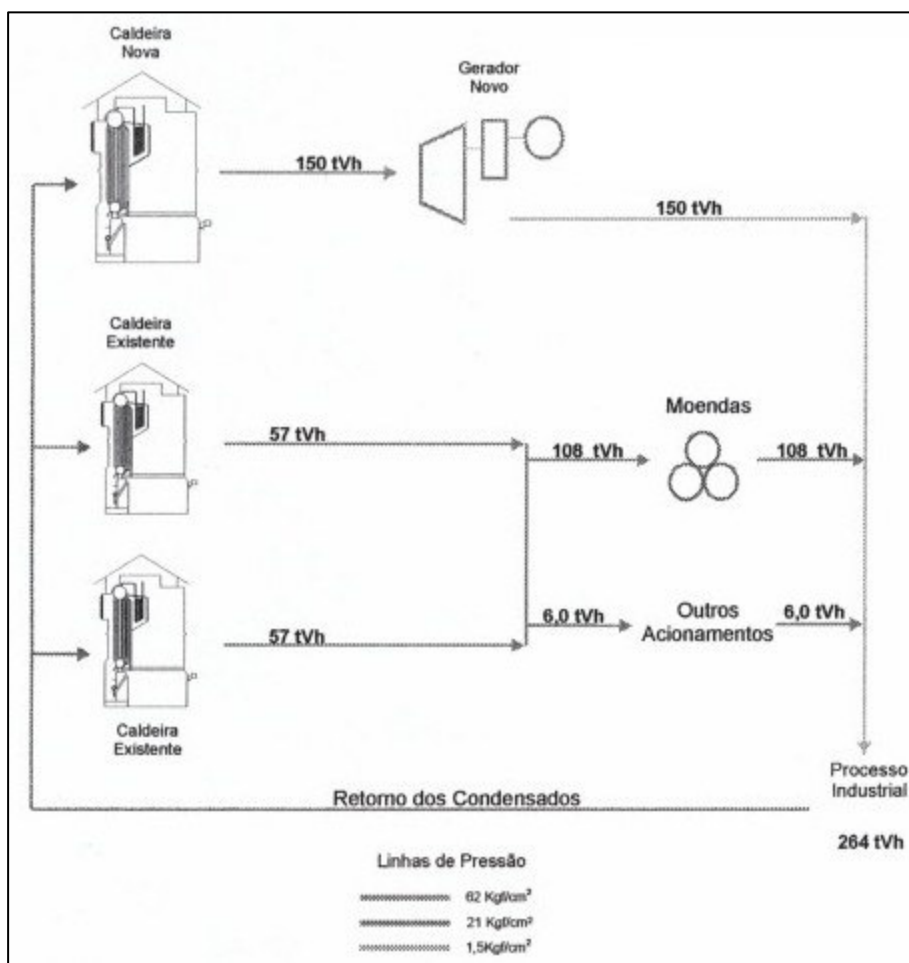


Figure 4: Energy Balance Diagram for Phase 1

Further, as bagasse cogeneration requires a constant bagasse supply to the sugar mill's boilers, if there is an interruption in bagasse supply, for example due to an interruption in sugarcane supply to the mill, the boilers would not be able to produce the steam required by both the sugar/ethanol production process and the power-generation. Therefore, in order to avoid power-generation interruptions, the cogeneration expansion plan in CBCP includes investments in the sugar/ethanol production process that reduce the steam consumption in the sugar and ethanol production processes. This fine-tune improvement is necessary in order to drive as much steam as possible to the cogeneration project. Consequently, the greater the quantity of electricity production, the higher the investment per MWh produced is sought.

**A.4.4. Brief explanation of how the anthropogenic emissions of anthropogenic greenhouse gas (GHGs) by sources are to be reduced by the proposed CDM project activity, including why the emission reductions would not occur in the absence of the proposed project activity, taking into account national and/or sectoral policies and circumstances:**

By dispatching renewable electricity to a grid, electricity that would otherwise be produced using fossil fuel is displaced. This electricity displacement will occur in the system's margin, i.e. this CDM project will displace electricity that is produced by marginal sources (mainly fossil fueled thermal plants), which have higher electricity dispatching costs and are solicited only over the hours that



baseload sources (low-cost or must-run sources) cannot supply the grid (due to higher marginal dispatching costs or fuel storage – in case of hydro sources – constraints).

Bagasse is a fibrous biomass by-product from sugarcane processing, which accounts for about 25 percent on weight of fresh cane and approximately one third of the cane's energy content. In a typical Brazilian sugarcane mill, burning bagasse for generation of process heat and power production is a practice already established. It is estimated that over 700 MW of bagasse-based power capacity are currently installed in the state of São Paulo only<sup>3</sup>. The energy produced from these facilities is almost all consumed for their on purpose. Because of constraints that limited the access of independent power producers to the electric utilities market, there is no incentive for sugarcane mills to operate in a more efficient way. Low-pressure boilers, very little concern with optimal use and control of steam, crushers mechanically activated by steam, energy intensive distillation methods, are a few examples of inefficient methods applied to the sugar industry as normal routine.

The Brazilian electric sector legislation currently recognizes the role of independent power producers, which has triggered interest in improving boiler efficiency and increasing electricity generation at mills, allowing the production of enough electricity not only to satisfy sugar mills' need but also a surplus amount for selling to the electricity market. Furthermore, the ever increasing electricity demand opens an opportunity for some bagasse cogeneration power plants in Brazil. Additionally, the feature of electricity generation from sugarcane coinciding with dry months of the year, when hydroelectric generation system - the most important electricity source in the country - is under stress, should provide a considerable complementary energy and make the bagasse cogeneration electricity attractive for any potential purchasers.

Nevertheless, some barriers pose a challenge for implementation of this kind of projects. In most cases, the sponsors' culture in the sugar industry is very much influenced by the commodities – sugar and ethanol – market. Therefore, they need an extra incentive to invest in electricity production due to the fact that it is a product that can never be stored in order to speculate in price. The Power Purchase Agreement (PPA) requires different negotiation skills, which is not the core of the sugar industry. For instance, when signing a long-term electricity contract, the PPA, a given sugar mill has to be confident that it will produce sufficient biomass to supply its cogeneration project. Although it seems easy to predict, the volatility of sugarcane productivity may range from 75 to 120 ton of sugarcane per hectare annually depending on the rainfall. So, the revenue from GHG emission reductions and other benefits associated with CDM certification offer a worthy financial comfort for the sugar mills, like Cerradinho, which is investing to expand its electric power generation capacity and to operate in a more rationale way under the above mentioned new electric sector circumstances.

This project activity is to reduce **226.204 tCO<sub>2</sub>e** over 7 years.

#### **A.4.4.1. Estimated amount of emission reductions over the chosen crediting period:**

<b>1st Crediting Period</b>	<b>Phase 1 01/07/2002</b>	<b>2003</b>	<b>2004</b>	<b>2005</b>	<b>Phase 2 2006</b>	<b>2007</b>	<b>2008</b>	<b>30/06/2009</b>	<b>Total CERs</b>
<b>Total CO<sub>2</sub> emissions reductions, tCO<sub>2</sub>e/year</b>	<b>10.685</b>	<b>13.104</b>	<b>13.886</b>	<b>18.675</b>	<b>39.840</b>	<b>53.535</b>	<b>53.535</b>	<b>22.944</b>	<b>226.204</b>

CERs produced until nov/2004. Data for Dec/2004 and on are estimates.

<sup>3</sup> São Paulo. Secretary of Energy, 2001.

**A.4.5. Public funding of the project activity:**

There is no public funding from Parties included in Annex I in this project activity.

**SECTION B. Application of a baseline methodology****B.1. Title and reference of the approved baseline methodology applied to the project activity:**

AM0015: Bagasse-based cogeneration connected to an electricity grid.

**B.1.1. Justification of the choice of the methodology and why it is applicable to the project activity:**

This methodology is applicable to CBCP due to the fact that (i) the bagasse is produced and consumed in the same facility – Cerradinho -; (ii) the project would never be implemented by the public sector, as well as it would not be implemented in the absence of CDM, as shown in the additionality chapter following; (iii) there is not increase on the bagasse production due to the project activity itself/ and (iv) there will be not bagasse storage for more than one year.

**B.2. Description of how the methodology is applied in the context of the project activity:**

The project activity follows the steps provided by the methodology taking into account the (b) Simple Adjusted OM calculation for the STEP 1, since the would be no available data for applying to the preferred option – (c) *Dispatch Data Analysis OM*. For STEP 2, the option 1 was chosen. The following table presents the key information and data used to determine the baseline scenario.



ID number	Data type	Value	Unit	Data Source
1. $EG_y$	Electricity supplied to the grid by the Project.	Obtained throughout project activity lifetime.	MWh	Project owner
2. $EF_y$	CO <sub>2</sub> emission factor of the Grid.	0,249	tCO <sub>2</sub> e/MWh	Calculated
3. $EF_{OM,y}$	CO <sub>2</sub> Operating Margin emission factor of the grid.	0,404	tCO <sub>2</sub> e/MWh	This value was calculated using data information from ONS, the Brazilian electricity system manager.
4. $EF_{BM,y}$	CO <sub>2</sub> Build Margin emission factor of the grid.	0,094	tCO <sub>2</sub> e/MWh	This value was calculated using data information from ONS, the Brazilian electricity system manager.
10. $\lambda_y$	Fraction of time during which low-cost/ must-run sources are on the margin.	$\lambda_{2001} = 0,520$ $\lambda_{2002} = 0,505$ $\lambda_{2003} = 0,531$	-	This value was calculated using data information from ONS, the Brazilian electricity system manager.

**B.3. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM project activity:****Application of the Tool for the demonstration and assessment of additionality of Cerradinho.****Step 0. Preliminary screening based on the starting date of the project activity**

(a) The starting date of this project falls after 1 January 2000, which is evidenced by the invoice of one of the equipments that have initiated the project (the turbo-generator), emitted in 17<sup>th</sup> April 2002.

(b) Cerradinho would not initiate CBCP without the CDM. The Mechanism has been considered as a new source of funding since the beginning of its renewable energy project, after the mill got to know about the opportunity through Informação UNICA, the newsletter from the state of São Paulo sugar mill association. In fact, Econergy has had contacts with Cerradinho since the beginning of 2002/end of 2001, with the agreed business proposal to develop a CDM project being delivered on the 20<sup>th</sup> of February 2002, thus before the start of the project activity.

**Step 1. Identification of alternatives to the project activity consistent with current laws and regulations.****Sub-step 1a: Define alternatives to the project activity**

1. There were only two possibilities to implement this project activity: one was to continue the current situation of the sugar mill, focusing only on the production of sugar and alcohol and thus investing to enhance the efficiency and increasing the scale of its core business. The other option was the project activity undertaken, which is the investment made to increase steam efficiency and production for electricity sales purposes by acquiring high-efficiency boilers and turbo-generators.

**Sub-step 1b: Enforcement of applicable laws and regulations**

2. The alternative, which is to continue with the BAU situation before the decision of implementing this CDM project activity is consistence with the applicable laws and regulations.

3. Non applicable.

4. Both the project activity and the alternative scenario are in compliance with all regulations.

**Step 3. Barrier analysis****Sub-step 3a: Identify barriers that would prevent the implementation of type of the proposed project activity**



**1. and 2.** According to COELHO (1999)<sup>4</sup>, “large scale cogeneration program in sugar-alcohol sector has not yet occurred, due to several barriers, mainly economic, political and institutional”, such as:

### **I. Technological Barriers**

Technological barriers represent a very important issue for increasing bagasse cogeneration in Brazil, for despite of the fact that Rankine-cycle is a well known technology, the cogeneration units operate with low-efficiency and are not competitive comparing to other generation options. In this way there is a tricky issue about technology and economic value for such technology. Although this technology is well developed, the economic value for its application is not for projects on the scale similar to the sugar mills in Brazil. COELHO (1999) justifies that by highlighting that the unitary costs (\$/installed MW) are significantly influenced by scale-effect. As the bagasse cogeneration unit should have a small scale due to the high cost for transportation of the fuel (bagasse), investments are high. Therefore, as a lower cost of capital is wanted, the result is a simplified installation and lower efficiency.

COELHO (1999) also states that the great majority of the sugar mills still rely on inefficient technology, such as on 22 bar pressure boilers, even in the state of São Paulo, the most industrialized in Brazil. Moreover, when there is a necessity to change equipments, it is usual not consider purchasing high-efficiency boilers due to conservativeness, lack of knowledge or even lack of interest to generate surplus steam for electricity sales purposes.

Moreover, SWISHER (1997)<sup>5</sup> considers difficult to convince the local distributor that the energy to be acquired, generally generated during the harvest season, is sufficiently reliable to be accounted in the distributor's planning.

### **II. Institutional and Political Barriers**

From the electric sector point of view, according COELHO (1999), acquiring electricity other than hydroelectric would not be a priority, arguing that for the electricity is generated only during the harvest season, no firm energy could be offered. However, the biggest advantage of the bagasse based electricity is that it is produced during the period where hydroelectric plants face difficulties due to the low level of rains. As a result, COELHO (1999) suggests that there is a significant prejudice and conservativeness of the distributors when deciding whether to purchase or not bagasse based energy.

From the sugar mill point of view, save rare exceptions, COELHO (1999) says that the great majority of sugar mills do not consider investments in cogeneration (for electricity sale) as a priority. The sector “even in the new political context, does not seem to have motivation to invest in a process that it sees with mistrust and no guarantees that the product will have a safe market in the future. Moreover, it is a fact that “the sugar mills are essentially managed by families, which

---

<sup>4</sup> Coelho, S. T. *Mecanismos para Implementação da Cogeração de Eletricidade a partir de biomassa. Um Modelo para os Estado de São Paulo*. Programa Interunidades de pós-graduação em Energia. São Paulo, Agosto de 1999.

<sup>5</sup> Swisher, J. *Using Area-Specific Cost Analysis to Identify low Incremental-cost Renewable Energy Options: A Case Study of Co-generation Using Bagasse in the State of São Paulo*. Prepared for Global Environment Facility (GEF) Secretariat, Washington DC, 1997.



hurdles the association with external financial agents”, and allowing the sector to be more competitive and diversifying its investment.

From the point of view of the economic agents, the excessive level of the guarantees required to finance the projects, commonly is a barrier to achieve a financial feasibility stage, deeply discussed in SWISHER (1997).

Other barriers have more to do with the lack of adequate commercial contractual agreements from the energy buyers (i.e. bankable long-term contracts and payment guarantee mechanisms for non-creditworthy local public-sector and private customers) and that influences directly making more difficult to obtain a long-term financing from a bank and/or development bank. Some other financing barriers occur simply due to prohibitively high transaction costs, which include the bureaucracy to secure the environmental license.

Since 1997, according to SWISHER (1997), the announcement of a Cogeneration Decree has been awaited, and that was supposed to have this positive influence on corporate decision-making with respect to biomass project implementation. The original Cogeneration Decree proposal, which was never approved, called for mandatory purchase by the regional utilities - “*concessionárias*” - from cogenerating and self-generating facilities<sup>6</sup>. Instead of renewable energy, the government expansion plan for electric energy, approved in February 2000 is based on fossil fuel – Natural Gas. This expansion plan called Thermoelectricity Priority Plan (PPT) became a reality right before the energy crisis. The Thermoelectricity Priority Plan beneficiaries, which were mainly natural gas thermal plants, through the Ministry of Mines and Energy (MME) Decree 3.371 from February 2000, counted on guaranteed, long term and attractive price conditions on Natural Gas supply and Energy sales, together with financing from the national development bank BNDES. And though the PPT plan is not likely to be fully implemented, the public-sector policies for renewable energy are not considered reliable enough by the executives of the private sector to support cogeneration expansion in the sugar mills. This assumption is clearly shown in the following list of rules and/or regulations to the energy sector that have been set in the last 10 years:

- **March 1993:** Law 8.631 sets a tariff regulation for electric energy;
- **February 1995:** Law 8.987 establish public concession for energy;
- **July 1995:** Law 9.074 regulates concession for electric energy sector;
- **December 1996:** Law 9.427 creates National Energy Agency (ANEEL);
- **August 1997:** Law 9.478 sets the National Council for Energy Planning (CNPE);
- **October 1997:** Decree 2.335 regulates the ANEEL task;
- **December 1997:** Implements ANEEL;
- **May 1998:** Law 9.648 establishes the Spot Market for Electric Energy (MAE) and the Operator National System (ONS);

---

<sup>6</sup> Presidential Decree on the co-generation of electric energy, draft of 5 August 1997.



- **July 1998:** Decree 2.655 regulates MAE and ONS tasks;
- **December 2000:** Decree 3.371 regulates the Thermoelectricity Priority Plan (PPT);
- **April 2002:** Law 10.438 sets the Program for Incentive Alternative Energy (PROINFA), stating that contracts shall be signed within 24 months from its date and that there will be different economic values for the acquisition of 3.300MW of electricity capacity from renewable sources by the state owned Eletrobrás, for plants starting operations before December 30, 2006;
- **August 2002:** MP 64 is a presidential act to change the constitution in order to permit the energy sector regulation including the PROINFA;
- **December 2002:** Resolution 4.541 from ANEEL regulates the implementation of PROINFA, stating that economic values would be defined within 90 days;
- **March 2003:** Decree 4.644 postponed for 180 days, from its date, the economic value and operational guidelines announcement;
- **June 2003:** Decree 4.758 indefinitely postponed the date for the economic value and operational guidelines announcement and revoked the above mentioned Decree 4.644.
- **November 2003:** Law 10.762 of 11 November/03 revised Law 10.438 of 26 April 2002 institutes PROINFA.
- **March 2004:** Decree 5.025 regulates the Law 10.438 as of 26 April 2002.

For this CDM project analysis purposes, by the time the project started there were no institutional incentive like PROINFA to be considered. Therefore, the company's decision on signing a long-term PPA with the local distributor undoubtedly represented a significant risk that the mill was willing to risk.

### III. Economic and Investment Barriers

"There are several reasons for the Brazilian utilities' reluctance to offer higher prices for co-generated power. One important reason stems from their assumption that their costs are geographically uniform – i.e., that there is essentially a single value for their avoided cost in the industrial sector. If this cost value does not indicate that sufficient savings are available from buying co-generated power, and then there is little economic motivation, under either a public monopoly or a privatized competitive structure, for a utility to pay enough for co-generation to satisfy potential investors' financial criteria"<sup>7</sup> as stated by SWISHER (1997). In fact, the economic cost is the reason that Brazilian utilities do not buy cogeneration electricity energy, at least, while the energy sector regulation does not guarantee them the right to pass such cost through the end user tariff. The cost of cogeneration electricity ranges from US\$ 35 to US\$ 105 per MWh,

---

<sup>7</sup> Joel Swisher personal communication with Rolls Royce Power Ventures project manager. Mark Croke, August 26, 1997. Swisher J. 1997 pg. 76.



according to the Expansion Plan 2001-2010 from Brazil Government, which is described as higher than the marginal cost for electricity expansion in the system – US\$ 33/MWh<sup>8</sup>.

COELHO (1999) also highlights one of the major problems of selling surplus energy to the grid as being the economic value paid to the sugar mills as not enough to remunerate the capital invested in the expansion of a cogeneration project. Furthermore, “the fee for accessing the grid does not contribute for making feasible the sale of the surplus energy to the distributors”.

Summarizing, SWISHER (1997) considers that the main difficulties are found in: (a) **small sizes of projects and installation costs**: despite of the high cost for installation, the fix cost component is high and cannot be absorbed by the global economic project. (b) **availability of long-term financing**: traditionally, infrastructure projects use to have a wider access to long-term financing, situation that has changed after the electric sector privatization. (c) **lack of guarantees**: besides technical guarantees, investors require commercial guarantees establishing a paradox: privatization is to foster a market based economy but banks still require governmental guarantees to ensure long-term investments in the private sector, (d) **lack of local funding**: lack of familiarity with project finance tools and due to the high interest rates in Brazil.

#### IV. Cultural Barrier

Due to the nature of the business in the sugar industry the marketing approach is narrowed focused on commodity type of transaction. Therefore, the electricity transaction based on long-term contract (Power Purchase Agreement) represents a significant breakthrough on their business model. In this case, the electricity transaction has to represent a safe investment opportunity from both economical and social-environmental perspective for convincing the sugar mills to invest in.

There are also questions regarding the managerial capacity of the companies that comprise the Brazilian sugarcane industry. In many cases, they have demonstrated the will to undertake investments in new technologies, but without sufficient financial and entrepreneurial capacity to complete such projects, according to WALTER (1994)<sup>9</sup>.

**Sub-step 3b: Show that the identified barriers would not prevent the implementation of at least one of the alternatives (except the proposed project activity).**

The other alternative to this project activity was to keep the current situation and focus strictly in its core business which is the production of sugar and alcohol. Therefore, as the barriers mentioned above are directly related to entering into a new business (electricity sale), there is no impediment for sugar mills to maintain (or even invest in) its core business.

#### Step 4. Common practice analysis.

##### Sub-step 4a: Analyze other activities similar to the proposed project activity

---

“As may be seen, the unit costs of the alternative sources of energy are still high compared to the marginal cost of expanding the system, nowadays calculated as US\$33/MWh”. Translation by Eenergy Brasil. IN: BRAZIL, Ministry of Mines and Energy, 2001, pg. 80.

<sup>9</sup> Walter, A.C.S. *Viabilidade e Perspectivas da Co-geração e Geração Termelétrica no Setor Sucro-alcooleiro*. Tese de Doutorado. UNICAMP, Campinas, 1994.



The sugar sector, historically, always exploited its biomass (bagasse) in an inefficient manner by making use low-pressure boilers. Although they consume almost all of their bagasse for self-energy generation purposes, it is done in such a manner that no surplus electric energy is available for sale, and no sugar company has ventured in the electricity market until the recent years.

Similar project activities have been implemented by leading companies in this industry, mainly after Vale do Rosário started to implement its project that clearly served as a sector benchmark. However, these are few examples in a universe of about 320 sugar mills. Currently, the other similar project activities under implementation are, for example, Santa Cândida, Moema, Equipav, Nova América. All together the similar projects in the sugar industry in Brazil are restricted to approximately 10% of the sugar industry, since the other 90% are still burning their bagasse for on-site use only in the old-fashioned inefficient way. That clearly shows that just a small part of this sector is willing to invest in cogeneration projects. Moreover, the majority of the similar projects, which are currently being implemented, are carried out as CDM project activities. So far, Econergy Brasil has reported at least 26 CDM bagasse cogeneration projects in Brazil.

#### **Sub-step 4b: Discuss any similar options that are occurring**

This project activity type is not considered as a widely spread activity in Brazil for only a small portion of the existing sugar mills in the country actually produce electricity for sale purposes. Also, most of the existing similar activities are being developed as CDM project activities.

#### **Step 5. Impact of CDM registration**

The impact of registration of this CDM project activity will contribute to overcome all the barriers described in this Tool: technological, institutional and political, economic and investment and cultural barriers by bringing more solidity to the investment itself and, therefore, fostering and supporting the project owners' decision to the breakthrough on their business model. In this way, the project activity is already engaged in a deal to sell its expected CERs.

Notwithstanding, the benefits and incentives mentioned in the text of the Tool for demonstration and assessment of additionality, published by the CDM-EB, will be experienced by the project activities such as: the project will achieve the aim of anthropogenic GHG reductions; financial benefit of the revenue obtained by selling CERs will bring more robustness to the project's financial situation; and its likely to attract new players and new technology (there are companies currently developing new type of boilers – extra-efficient – and the purchase of such equipment is to be fostered due to CER sales revenue) and reducing the investor's risk.

<b>B.4. Description of how the definition of the <u>project boundary</u> related to the <u>baseline methodology</u> selected is applied to the <u>project activity</u>:</b>
---

The definition of the project boundary related to the baseline methodology is applied to the project activity in the following way:

**Baseline energy grid:** For CBCP, the South-Southeast and Midwest subsystem of the Brazilian grid is considered as a boundary, since it is the system to which Cerradinho is connected and therefore receives all the bagasse-based produced electricity.



**Bagasse cogeneration plant:** the bagasse cogeneration plant considered as boundary comprises the whole site where the cogeneration facility is located.

**B.5. Details of baseline information, including the date of completion of the baseline study and the name of person (s)/entity (ies) determining the baseline:**

1. Date of completing the final draft of this baseline section: 30/06/2005.
2. Name of person/entity determining the baseline

ECONERGY BRASIL (Contact information in Annex 1), which is a participant in this project, is responsible for the technical services related to GHG emission reductions, and is therefore, in behalf of Cerradinho, the developer of this document, and all its contents.

**SECTION C. Duration of the project activity / Crediting period**

**C.1 Duration of the project activity:**

**C.1.1. Starting date of the project activity:**

01/07/2002

**C.1.2. Expected operational lifetime of the project activity:**

25y-0m.<sup>10</sup>

**C.2 Choice of the crediting period and related information:**

**C.2.1. Renewable crediting period**

**C.2.1.1. Starting date of the first crediting period:**

01/07/2002

**C.2.1.2. Length of the first crediting period:**

7y-0m

**C.2.2. Fixed crediting period:**

**C.2.2.1. Starting date:**

NA

**C.2.2.2. Length:**

NA

<sup>10</sup> Specialists from the Brazilian National Agency of Electric Power (ANEEL - *Agência Nacional de Energia Elétrica*) suggest using 25 years of lifetime for steam turbines, combustion turbines, combined cycle turbines and nuclear power plants, according to Bosi, 2000, p. 29.



**SECTION D. Application of a monitoring methodology and plan**

**D.1. Name and reference of approved monitoring methodology applied to the project activity:**

Approved monitoring methodology AM0015: “Bagasse-based cogeneration connected to an electricity grid”

**D.2. Justification of the choice of the methodology and why it is applicable to the project activity:**

The monitoring methodology was designed to be applied to the Vale do Rosario CDM Project, however, due to the great project similarity, the same methodology was chosen in order to monitor the emissions reduction of this project activity.

The applicability of the methodology is described in the paragraph B.1.1 of this document.

**D.2. 1. Option 1: Monitoring of the emissions in the project scenario and the baseline scenario**

There is no project emission to be considered in this project activity.

**D.2.1.1. Data to be collected in order to monitor emissions from the project activity, and how this data will be archived:**

ID number (Please use numbers to ease cross-referencing to D.3)	Data variable	Source of data	Data unit	Measured (m), calculated (c) or estimated (e)	Recording frequency	Proportion of data to be monitored	How will the data be archived? (electronic/ paper)	Comment

**D.2.1.2. Description of formulae used to estimate project emissions (for each gas, source, formulae/algorithm, emissions units of CO<sub>2</sub> equ.)**

Not Applicable

**D.2.1.3. Relevant data necessary for determining the baseline of anthropogenic emissions by sources of GHGs within the project boundary and how such data will be collected and archived :**

ID number (Please use numbers to ease cross-referencing to table D.3)	Data variable	Source of data	Data unit	Measured (m), calculated (c), estimated (e),	Recording frequency	Proportion of data to be monitored	How will the data be archived? (electronic/ paper)	Comment
1. EG <sub>y</sub>	Electricity supplied to the grid by the Project.	Readings of the energy metering connected to the grid and Receipt of Sales.	MWh	<i>M</i>	Monthly	100%	Electronic and paper	Double check by receipt of sales. Will be archived according to internal procedures, until 2 years after the end of the crediting period.



2. $EF_y$	CO <sub>2</sub> emission factor of the Grid.	Calculated	tCO <sub>2</sub> e/MWh	C	At the validation and yearly after registration	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.
3. $EF_{OM,y}$	CO <sub>2</sub> Operating Margin emission factor of the grid.	Factor calculated from ONS, the Brazilian electricity system manager.	tCO <sub>2</sub> e/MWh	C	At the validation and yearly after registration	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.
4. $EF_{BM,y}$	CO <sub>2</sub> Build Margin emission factor of the grid.	Factor calculated from ONS, the Brazilian electricity system manager.	tCO <sub>2</sub> e/MWh	C	At the validation and yearly after registration	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.
10. $\lambda_y$	Fraction of time during which low-cost/ must-run sources are on the margin.	Factor calculated from ONS, the Brazilian electricity system manager.	index	C	At the validation and yearly after registration	0%	Electronic and paper	Will be archived according to internal procedures, until 2 years after the end of the crediting period.

**D.2.1.4. Description of formulae used to estimate baseline emissions (for each gas, source, formulae/algorithm, emissions units of CO<sub>2</sub> equ.)**

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.



$EF_{OM, simple\_adjusted, y} = (1 - \lambda_y) \frac{\sum_j F_{i,j,y} \cdot COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \frac{\sum_k F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}} \text{ (tCO}_2\text{e/GWh)}$ $EF_{BM} = \frac{\sum_{i,m} F_{i,m,y} \cdot COEF_{i,m}}{\sum_m GEN_{m,y}} \text{ (tCO}_2\text{e/GWh)}$ $EF_{electricity} = \frac{EF_{OM} + EF_{BM}}{2} \text{ (tCO}_2\text{e/GWh)}$ $BE_{electricity,y} = EF_{electricity} \cdot EG_y$	<p><math>F_{i,j(or m),y}</math> Is the amount of fuel <math>i</math> (in a mass or volume unit) consumed by relevant power sources <math>j</math> in year(s) <math>y</math></p> <p><math>j,m</math> Refers to the power sources delivering electricity to the grid, not including low-operating cost and must-run power plants, and including imports<sup>4</sup> from the grid</p> <p><math>COEF_{i,j(or m),y}</math> Is the CO<sub>2</sub> emission coefficient of fuel <math>i</math> (tCO<sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources <math>j</math> (or <math>m</math>) and the percent oxidation of the fuel in year(s) <math>y</math>, <math>a</math></p> <p><math>GEN_{j(or m),y}</math> Is the electricity (MWh) delivered to the grid by source <math>j</math> (or <math>m</math>)</p> <p><math>BE_{electricity,y}</math> Are the baseline emissions due to displacement of electricity during the year <math>y</math> in tons of CO<sub>2</sub></p> <p><math>EG_y</math> Is the net quantity of electricity generated in the bagasse-based cogeneration plant due to the project activity during the year <math>y</math> in MWh, and</p> <p><math>EF_{electricity,y}</math> Is the CO<sub>2</sub> baseline emission factor for the electricity.</p>
---	---

#### D. 2.2. Option 2: Direct monitoring of emission reductions from the project activity (values should be consistent with those in section E).

##### D.2.2.1. Data to be collected in order to monitor emissions from the project activity, and how this data will be archived:

ID number (Please use numbers to ease cross-referencing to table D.3)	Data variable	Source of data	Data unit	Measured (m), calculated (c), estimated (e),	Recording frequency	Proportion of data to be monitored	How will the data be archived? (electronic/ paper)	Comment

**D.2.2.2. Description of formulae used to calculate project emissions (for each gas, source, formulae/algorithm, emissions units of CO<sub>2</sub> equ.):**

Not Applicable

**D.2.3. Treatment of leakage in the monitoring plan****D.2.3.1. If applicable, please describe the data and information that will be collected in order to monitor leakage effects of the project activity**

ID number (Please use numbers to ease cross-referencing to table D.3)	Data variable	Source of data	Data unit	Measured (m), calculated (c) or estimated (e)	Recording frequency	Proportion of data to be monitored	How will the data be archived? (electronic/paper)	Comment

**D.2.3.2. Description of formulae used to estimate leakage (for each gas, source, formulae/algorithm, emissions units of CO<sub>2</sub> equ.)**

Not Applicable

**D.2.4. Description of formulae used to estimate emission reductions for the project activity (for each gas, source, formulae/algorithm, emissions units of CO<sub>2</sub> equ.)**

$$ER_y = BE_{\text{thermal}, y} + BE_{\text{electricity}, y} - PE_y - L_y$$

$$BE_{\text{thermal}, y} = 0$$

$$PE_y = 0$$

$$L_y = 0$$

$$BE_{\text{electricity}, y} = EF_{\text{electricity}} \cdot EG_y$$

ER<sub>y</sub>: are the emissions reductions of the project activity during the year y in tons of CO<sub>2</sub>

BE<sub>electricity,y</sub>: Are the baseline emissions due to displacement of electricity during the year y in tons of CO<sub>2</sub>

BE<sub>thermal,y</sub>: Are the baseline emissions due to displacement of thermal energy during the year y in tons of CO<sub>2</sub>

PE<sub>y</sub>: Are the project emissions during the year y in tons of CO<sub>2</sub>.



$L_y$ : Are the leakage emissions during the year y in tons of CO<sub>2</sub>.

### D.3. Quality control (QC) and quality assurance (QA) procedures are being undertaken for data monitored

Data (Indicate table and ID number e.g. 3.-1.; 3.2.)	Uncertainty level of data (High/Medium/Low)	Explain QA/QC procedures planned for these data, or why such procedures are not necessary.
1	Low	These data will be directly used for calculation of emission reductions. Sales record and other records are used to ensure the consistency.
2	Low	Data does not need to be monitored
3	Low	Data does not need to be monitored
4	Low	Data does not need to be monitored
10	Low	Data does not need to be monitored

### D.4 Please describe the operational and management structure that the project operator will implement in order to monitor emission reductions and any leakage effects, generated by the project activity

The structure for monitoring this project activity will basically consist of registering the amount of energy sold to the grid (EG<sub>y</sub>). There are two operations that the project operators must perform in order to ensure data consistency, despite of the fact that this will actually consist of the monitoring of one single variable.

1. The monthly readings of the calibrated meter equipment must be recorded in an electronic spreadsheet
2. Sales receipt must be archived for double checking the data. In case of inconsistency, these are the data to be used.

Moreover, according to the law, the meter equipment shall be periodically calibrated to comply with the regulations for independent power producers connected to the regional grid.



**D.5 Name of person/entity determining the monitoring methodology:**

ECONERGY BRASIL (Contact information in Annex 1), which is a participant in this project, is the responsible for the technical services related to GHG mission reductions, and is therefore, in behalf of Cerradinho, the developer of this document, and all its contents.

**SECTION E. Estimation of GHG emissions by sources****E.1. Estimate of GHG emissions by sources:**

This project activity does not burn any additional quantity of fossil fuel due to the project implementation, the variable  $PE_y$ , presented in the methodology, does not need to be monitored.

Thus,  $PE_y = 0$

**E.2. Estimated leakage:**

Cerradinho did not used to sold sugarcane bagasse before the implementation of the project.

Thus,  $L_y = 0$

**E.3. The sum of E.1 and E.2 representing the project activity emissions:**

$L_y + PE_y = 0$

**E.4. Estimated anthropogenic emissions by sources of greenhouse gases of the baseline:**

The baseline methodology considers the determination of the emissions factor for the grid to which the project activity is connected as the core data to be determined in the baseline scenario. In Brazil, there are two main grids, South-Southeast-Midwest and North-Northeast, therefore the South-Southeast-Midwest Grid is the relevant one for this project.

The method that will be chosen to calculate the Operating Margin (OM) for the electricity baseline emission factor is the option (b) *Simple Adjusted OM*, since the preferable choice (c) *Dispatch Data Analysis OM* would face the barrier of data availability in Brazil.

In order to calculate the Operating Margin, daily dispatch data from the Brazilian electricity system manager (ONS) needed to be gathered. ONS does not regularly provide such information, which implied in getting it through communicating directly with the entity.

The provided information comprised years 2001, 2002 and 2003, and is the most recent information available at this stage (At the end of 2004 ONS supplied raw dispatch data for the whole interconnected grid in the form of daily reports<sup>11</sup> from Jan. 1, 2001 to Dec. 31, 2003, the most recent information available at this stage).

**Simple Adjusted Operating Margin Emission Factor Calculation**

According to the methodology, the project is to determine the Simple Adjusted OM Emission Factor ( $EF_{OM, \text{ simple adjusted, } y}$ ). Therefore, the following equation is to be solved:

---

<sup>11</sup> *Acompanhamento Diário da Operação do Sistema Interligado Nacional*. ONS-CNOS, Centro Nacional de Operação do Sistema. Daily reports on the whole interconnected electricity system from Jan. 1, 2001 to Dec. 31, 2003.



$$EF_{OM, simple\_adjusted, y} = (1 - \lambda_y) \frac{\sum_{i,j} F_{i,j,y} \cdot COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \frac{\sum_{i,k} F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}} \text{ (tCO}_2\text{e/GWh)}$$

It is assumed here that all the low-cost/must-run plants produce zero net emissions.

$$\frac{\sum_{i,k} F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}} = 0 \text{ (tCO}_2\text{e/GWh)}$$

Please refer to the methodology text or the explanations on the variables mentioned above.

The ONS data as well as the spreadsheet data with the calculation of emission factors have been provided to the validator (DOE). In the spreadsheet, the dispatch data is treated as to allow calculation of the emission factor for the most three recent years with available information, which are 2001, 2002 and 2003.

The Lambda factors were calculated in accordance with methodology requests. More detailed information is provided in Annex 3. The table below presents such factors.

Year	Lambda
2001	0,5204
2002	0,5053
2003	0,5312

Electricity generation for each year needs also to be taken into account. This information is provided in the table below.

Year	Electricity Load (MWh)
2001	263.706.242
2002	275.402.896
2003	288.493.929

Using therefore appropriate information for  $F_{i,j,y}$  and  $COEF_{i,j}$ , OM emission factors for each year can be determined, as follows.

$$EF_{OM, simple\_adjusted, 2001} = (1 - \lambda_{2001}) \frac{\sum_{i,j} F_{i,j,2001} \cdot COEF_{i,j}}{\sum_j GEN_{j,2001}} \therefore EF_{OM, simple\_adjusted, 2001} = 0,3524 \text{ tCO}_2\text{/MWh}$$

$$EF_{OM, simple\_adjusted, 2002} = (1 - \lambda_{2002}) \frac{\sum_{i,j} F_{i,j,2002} \cdot COEF_{i,j}}{\sum_j GEN_{j,2002}} \therefore EF_{OM, simple\_adjusted, 2002} = 0,4207 \text{ tCO}_2\text{/MWh}$$



$$EF_{OM, simple\_adjusted, 2003} = (1 - \lambda_{2003}) \frac{\sum_{i,j} F_{i,j,2003} \cdot COEF_{i,j}}{\sum_j GEN_{j,2003}} \therefore EF_{OM, simple\_adjusted, 2003} = 0,4396 \text{ tCO}_2/\text{MWh}$$

Finally, to determine the baseline *ex-ante*, the mean average among the three years is calculated, finally determining the  $EF_{OM, simple\_adjusted}$ .

$$EF_{OM, simple\_adjusted\ 2001-2003} = 0,404 \text{ tCO}_2/\text{MWh}$$

According to the methodology used, a Build Margin emission factor also needs to be determined.

$$EF_{BM, y} = \frac{\sum_{i,m} F_{i,m,y} \cdot COEF_{i,m}}{\sum_m GEN_{m,y}}$$

Electricity generation in this case means 20% of total generation in the most recent year (2003), as the 5 most recent plants built generate less than such 20%. Calculating such factor one reaches:

$$EF_{BM, 2003} = 0,094 \text{ tCO}_2/\text{MWh}$$

Finally, the electricity baseline emission factor is calculated through a weighted-average formula, considering both the OM and the BM, being the weights 50% and 50% by default. That gives:

$$EF_{electricity, 2001-2003} = 0,5 * 0,404 + 0,5 * 0,094 = 0,249 \text{ tCO}_2/\text{MWh}$$

It is important to note that adequate considerations on the above weights are currently under study by the Meth Panel, and there is a possibility that such weighing changes in the methodology applied here.

The baseline emissions would be then proportional to the electricity delivered to the grid throughout the project's lifetime. Baseline emissions due to displacement of electricity are calculated by multiplying the electricity baseline emissions factor ( $EF_{electricity, 2001-2003}$ ) with the electricity generation of the project activity.

$$BE_{electricity, y} = EF_{electricity, 2001-2003} \cdot EG_y$$

Therefore, for the first crediting period, the baseline emissions will be calculated as follows:

$$BE_{electricity, y} = 0,249 \text{ tCO}_2/\text{MWh} \cdot EG_y \text{ (in tCO}_2\text{e)}$$

**E.5. Difference between E.4 and E.3 representing the emission reductions of the project activity:**

The emissions reduction of this project activity is

$$ER = BE_{electricity, y} - (L_y + PE_y) = 0,249 \text{ tCO}_2/\text{MWh} \cdot EG_y - 0 \rightarrow ER = 0,249 \text{ tCO}_2/\text{MWh} \cdot EG_y$$

**E.6. Table providing values obtained when applying formulae above:**



Cerradinho Bagasse Cogeneration Project										
Grid-Connected Emission Reduction	Item	Phase 1 1/7/2002	2003	2004	2005	Phase 2 2006	2007	2008	30/6/2009	Total CERs
	Installed Capacity, MW	30,2	29	29	29	59	59	59	59	
	Electric energy to be sold to Eletropaulo MWh/year	42.913	52.627	55.768	75.000	160.000	215.000	215.000	92.143	
	Baseline emission factor tCO2e/MWh	0,249	0,249	0,249	0,249	0,249	0,249	0,249	0,249	
	Total CO2 emissions reductions, tCO2e/year	10.685	13.104	13.886	18.675	39.840	53.535	53.535	22.944	226.204
Electricity produced until Nov/04. Data for Dec/04 and on are estimates.										

## SECTION F. Environmental impacts

### F.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:

According to the Brazilian laws, the possible environmental impacts are to be analyzed by the State Secretary of Environment (Secretaria de Estado do Meio Ambiente) through CETESB (Companhia de Tecnologia de Saneamento Ambiental). CERRADINHO has applied for and been granted the installation license for the project. The Official Operating License has not been granted yet since the RAP and a technical measurement of particulates emitted by the boiler's chimneys are still being analyzed by CETESB, but a temporary Operating License has been issued.

There will be no transboundary impacts resulting from CBCP. All the relevant impacts occur within Brazilian borders and have been mitigated to comply with the environmental requirements for project's implementation. Therefore CBCP will not affect by any means any country surrounding Brazil.

### F.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:

The possible environmental impacts of CBCP project activity are to be analyzed by the State Secretary of Environment (SMA - *Secretaria de Estado do Meio Ambiente*) through a report called "Preliminary Environmental Report" (RAP - *Relatório Ambiental Preliminar*) prepared by the company and sent to the state environmental agency (*Companhia de Tecnologia de Saneamento Ambiental* - CETESB).

The official Operating License is being issued on May 2003, however, Cerradinho must comply with some demands from the environmental agency in order to proceed with the installation of the project, being:

- If any electrical installation is to be set in permanent preservation areas, another licensing procedure must be carried within DEPRN (Departamento Estadual de Proteção aos Recursos Naturais), a state department in charge of protecting state of São Paulo's natural resources;
- Bagasse storage must be done in a way that avoids its carriage by wind and rain;
- Water quality monitoring must be done downstream the mill in Córrego dos Tenentes, a river flow in Cerradinho area;



- Until the water recirculation system is implemented, water used for cooling purposes must comply with national environmental regulation, stating discharged waters must not exceed the receiving body's temperature in more than 3°C.
- Implement an use and re-use water plan in order to preserve the original characteristics of Córrego dos Tenentes, downstream CERRADINHO;
- Present a technical report, signed by a professional with accreditation to do it, on the operational conditions of burning bagasse in the boilers, as well as the flue gases washer, in order to show the emissions from this step in the process are controlled during the harvest season. This report is to be sent regularly to CETESB, with periodicity not less than 12 months. The sampling must be done using a methodology accepted by CETESB.

**SECTION G. Stakeholders' comments****G.1. Brief description how comments by local stakeholders have been invited and compiled:**

In the case of CBCP, Cerradinho took to the public the initiative of expanding its cogeneration facilities in order to supply electricity to the grid. It published an announcement in two newspapers: in 16<sup>th</sup> of May edition of the local one "O Regional" – from the municipality of Catanduva – and in the 15<sup>th</sup> of May edition of the D. O. E (state of São Paulo public owned official newspaper). Cerradinho did not get any reply on the announcements regarding the expansion of its facilities to cogenerate electricity, and therefore assumed it to be in accordance with the general public expectations regarding the development needs of the region.

Also, as a requirement of the Brazilian Interministerial Commission on Global Climate Change, the Brazilian DNA, Cerradinho invited several organizations and institutions to comment the CDM project being developed. Letters<sup>12</sup> were sent to the following recipients:

- Prefeitura do Município de Catanduva – SP / *Municipal Administration of Catanduva - SP*
- Prefeitura do Município de Catiguá – SP / *Municipal Administration of Catiguá - SP*
- Câmara dos Vereadores de Catanduva – SP / *Municipal Legislation Chamber of Catanduva –SP*
- Câmara dos Vereadores de Catiguá – SP / *Municipal Legislation Chamber of Catiguá -SP*
- Ministério Público do Estado de São Paulo / *Public Ministry of São Paulo State*
- Fórum Brasileiro de ONGs / *Brazilian NGO Forum*
- Fundo Social de Solidariedade de Catiguá - SP / *Social Fund of Solidarity of Catiguá –SP*
- Companhia de Tecnologia de Saneamento Ambiental (CETESB) / *State Environmental Agency*
- Vital Flora Associação de Reflorestamento do Nordeste do Estado de São Paulo / *Vital Flora Association of Reforestation of the Northeast of São Paulo State*

<sup>12</sup> The copy of these invitations are available in hold of Project participants.



**G.2. Summary of the comments received:**

No comments were received.

**G.3. Report on how due account was taken of any comments received:**

No comments were received.

Annex 1**CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY****1.1 Project Developer Responsible for the CDM Project Activity**

Organization:	Econergy Brasil Ltda.
Street/P.O.Box:	Rua Pará, 76 cj 41
Building:	Higienópolis Office Center
City:	São Paulo
State/Region:	SP
Postfix/ZIP:	01243-020
Country:	Brazil
Telephone:	+ 55 (11) 3219-0068
FAX:	+55 (11) 3219-0693
E-Mail:	-
URL:	<a href="http://www.econergy.com.br">http://www.econergy.com.br</a>
Represented by:	
Title:	Mr.
Salutation:	
Last Name:	Diniz Junqueira
Middle Name:	Schunn
First Name:	Marcelo
Department:	-
Mobile:	+55 (11) 8263-3017
Direct FAX:	Same above
Direct tel:	+ 55 (11) 3219-0068 ext 25 and/or mobile
Personal E-Mail:	<a href="mailto:junqueira@econergy.com.br">junqueira@econergy.com.br</a>

**1.2 Project Activity Host Company**

Organization:	Usina Cerradinho Açúcar e Álcool S/A
Street/P.O.Box:	Rod. Vicinal José Fernandes S/N Km 1+881m Caixa Postal 62 and 64
Building:	
City:	Catanduva
State/Region:	SP
Postfix/ZIP:	15800-000
Country:	Brazil
Telephone:	+55 (17) 531-2000
FAX:	+55 (16) 531-2041
E-Mail:	<a href="mailto:usinacerradinho@cerradinho.com.br">usinacerradinho@cerradinho.com.br</a>
URL:	<a href="http://www.Cerradinho.com.br">http://www.Cerradinho.com.br</a>
Represented by:	
Title:	Mrs.
Salutation:	
Last Name:	Fernandes
Middle Name:	Sanchez
First Name:	Andrea
Department:	Directory
Mobile:	-
Direct FAX:	Same above
Direct tel:	Same above
Personal E-Mail:	<a href="mailto:usinacerradinho@cerradinho.com.br">usinacerradinho@cerradinho.com.br</a>

Annex 2**INFORMATION REGARDING PUBLIC FUNDING**

There is no Annex I public funding involved in CBCP project activity.

Annex 3**BASELINE INFORMATION**

The Brazilian electricity system has been historically divided into two subsystems: the North-Northeast (N-NE) and the South-Southeast-Midwest (S-SE-CO). This is due mainly to the historical evolution of the physical system, which was naturally developed nearby the biggest consuming centers of the country.

The natural evolution of both systems is increasingly showing that integration is to happen in the future. In 1998, the Brazilian government was announcing the first leg of the interconnection line between S-SE-CO and N-NE. With investments of around US\$700 million, the connection had the main purpose, in the government's view, at least, to help solve energy imbalances in the country: the S-SE-CO region could supply the N-NE in case it was necessary and vice-versa.

Nevertheless, even after the interconnection had been established, technical papers still divided the Brazilian system in two (Bosi, 2000)<sup>13</sup>:

“... where the Brazilian Electricity System is divided into three separate subsystems:

- (i) The South/Southeast/Midwest Interconnected System;
- (ii) The North/Northeast Interconnected System; and
- (iii) The Isolated Systems (which represent 300 locations that are electrically isolated from the interconnected systems)”

Moreover, Bosi (2000) gives a strong argumentation in favor of having so-called *multi-project baselines*:

“For large countries with different circumstances within their borders and different power grids based in these different regions, multi-project baselines in the electricity sector may need to be disaggregated below the country-level in order to provide a credible representation of ‘what would have happened otherwise’”.

Finally, one has to take into account that even though the systems today are connected, the energy flow between N-NE and S-SE-CO is heavily limited by the transmission lines capacity. Therefore, only a fraction of the total energy generated in both subsystems is sent one way or another. It is natural that this fraction may change its direction and magnitude (up to the transmission line's capacity) depending on the hydrological patterns, climate and other uncontrolled factors. But it is not supposed to represent a significant amount of each subsystem's electricity demand. It has also to be considered that only in 2004 the interconnection between SE and NE was concluded, i.e., if project proponents are to be coherent with the generation database they have available as of the time of the PDD submission for validation, a situation where the electricity flow between the subsystems was even more restricted is to be considered.

---

<sup>13</sup> Bosi, M. *An Initial View on Methodologies for Emission Baselines: Electricity Generation Case Study*. International Energy Agency. Paris, 2000.



The Brazilian electricity system nowadays comprises of around 91,3 GW of installed capacity, in a total of 1,420 electricity generation enterprises. From those, nearly 70% are hydropower plants, around 10% are natural gas-fired power plants, 5.3% are diesel and fuel oil plants, 3.1% are biomass sources (sugarcane bagasse, black liquor, wood, rice straw and biogas), 2% are nuclear plants, 1.4% are coal plants, and there are also 8,1 GW of installed capacity in neighboring countries (Argentina, Uruguay, Venezuela and Paraguay) that may dispatch electricity to the Brazilian grid. (<http://www.aneel.gov.br/aplicacoes/capacidadebrasil/OperacaoCapacidadeBrasil.asp>). This latter capacity is in fact comprised by mainly 6,3 GW of the Paraguayan part of *Itaipu Binacional*, a hydropower plant operated by both Brazil and Paraguay, but whose energy almost entirely is sent to the Brazilian grid.

Approved methodologies AM0015 and ACM0002 ask project proponents to account for “all generating sources serving the system”. In that way, when applying one of these methodologies, project proponents in Brazil should search for, and research, all power plants serving the Brazilian system.

In fact, information on such generating sources is not publicly available in Brazil. The national dispatch center, ONS – *Operador Nacional do Sistema* – argues that dispatching information is strategic to the power agents and therefore cannot be made available. On the other hand, ANEEL, the electricity agency, provides information on power capacity and other legal matters on the electricity sector, but no dispatch information can be got through this entity.

In that regard, project proponents looked for a plausible solution in order to be able to calculate the emission factor in Brazil in the most accurate way. Since real dispatch data is necessary after all, the ONS was contacted, in order to let participants know until which degree of detail information could be provided. After several months of talks, plants’ daily dispatch information was made available for years 2001, 2002 and 2003.

Project proponents, discussing the feasibility of using such data, concluded it was the most proper information to be considered when determining the emission factor for the Brazilian grid. According to ANEEL, in fact, ONS centralized dispatched plants accounted for 75,547 MW of installed capacity by 31/12/2004, out of the total 98,848.5 MW installed in Brazil by the same date ([http://www.aneel.gov.br/arquivos/PDF/Resumo Gráficos mai 2005.pdf](http://www.aneel.gov.br/arquivos/PDF/Resumo_Gr%C3%A1ficos_mai_2005.pdf)), which includes capacity available in neighboring countries to export to Brazil and emergency plants, that are dispatched only during times of electricity constraints in the system. Therefore, even though the emission factor calculation is carried out without considering all generating sources serving the system, about 76.4% of the installed capacity serving Brazil is taken into account, which is a fair amount if one looks at the difficulty in getting dispatch information in Brazil. Moreover, the remaining 23.6% are plants that do not have their dispatch coordinated by ONS, since: either they operate based on power purchase agreements which are not under control of the dispatch authority; or they are located in non-interconnected systems to which ONS has no access. In that way, this portion is not likely to be affected by the CDM projects, and this is another reason for not taking them into account when determining the emission factor.

In an attempt to include all generating sources, project developers considered the option to research for available, but non-official data, to supply the existing gap. The solution found was the International Energy Agency database built when carrying out the study “Road-Testing Baselines For Greenhouse Gas Mitigation Projects in the Electric Power Sector”, published in October 2002. Merging ONS data with the IEA data in a spreadsheet, project proponents have been able to consider all generating sources connected to the relevant grids in order to determine the emission factor. The emission factor calculated



was found more conservative when considering ONS data only, as the table below shows the build margin in both cases.

IEA/ONS Merged Data Build Margin (tCO <sub>2</sub> /MWh)	ONS Data Build Margin (tCO <sub>2</sub> /MWh)
0,205	0,0937

Therefore, considering all the rationale explained, project developers decided for the database considering ONS information only, as it was capable of properly addressing the issue of determining the emission factor and doing it in the most conservative way.

The aggregated hourly dispatch data got from ONS was used to determine the lambda factor for each of the years with data available (2001, 2002 and 2003). The Low-cost/Must-run generation was determined as the total generation minus fossil-fuelled thermal plants generation, this one determined through daily dispatch data provided by ONS. All this information has been provided to the validators, and extensively discussed with them, in order to make all points crystal clear.

On the following pages, a summary of the analysis is provided. First, the table with the 122 plants dispatched by the ONS are provided. Then, a table with the summarized conclusions of the analysis, with the emission factor calculation displayed. Finally, the load duration curves for the S-SE-MW system are presented.



## ONS Dispatched Plants

Subsystem*	Fuel source**	Power plant	Operation start [2, 4, 5]	Installed capacity (MW) [1]	Fossil fuel conversion efficiency (%) [2]	Carbon emission factor (tCO <sub>2</sub> /tJ) [3]	Fraction carbon oxidized [3]	Emission factor (tCO <sub>2</sub> /MWh)
1	S-SECO	H	Jauru	Sep-2003	121.5	1	0.0	0.000
2	S-SECO	H	Gaúchos	Sep-2003	120.0	1	0.0	0.000
3	S-SECO	G	Não Legados	Aug-2003	396.0	0.3	15.3	99.5%
4	S-SECO	H	Furni (MG)	Jan-2003	180.0	1	0.0	0.000
5	S-SECO	H	Niquira I	Sep-2002	156.1	1	0.0	0.000
6	S-SECO	G	Araucária	Sep-2002	484.5	0.3	15.3	99.5%
7	S-SECO	G	Canasvieiras	Sep-2002	160.5	0.3	15.3	99.5%
8	S-SECO	H	Piraju	Sep-2002	61.0	1	0.0	0.000
9	S-SECO	G	Novo Piratininga	Jun-2002	384.9	0.3	15.3	99.5%
10	S-SECO	O	PCT CGTEE	Jun-2002	5.0	0.3	20.7	99.0%
11	S-SECO	H	Renas	Jun-2002	55.0	1	0.0	0.000
12	S-SECO	G	Ibirá	May-2002	226.0	0.3	15.3	99.5%
13	S-SECO	H	Caná Brava	May-2002	465.9	1	0.0	0.000
14	S-SECO	H	São Clara	Jan-2002	60.0	1	0.0	0.000
15	S-SECO	H	Machadinho	Jan-2002	1,140.0	1	0.0	0.000
16	S-SECO	G	Juiz de Fora	Nov-2001	87.0	0.28	15.3	99.5%
17	S-SECO	G	Maclei Merchant	Nov-2001	522.6	0.24	15.3	99.5%
18	S-SECO	H	Luzardo (ANEEL res. 469/2001)	Nov-2001	992.5	1	0.0	0.000
19	S-SECO	G	Eletrobrás	Oct-2001	379.0	0.24	15.3	99.5%
20	S-SECO	H	Porto Estrela	Sep-2001	112.0	1	0.0	0.000
21	S-SECO	G	Cristina (Mato Grosso)	Aug-2001	529.2	0.3	15.3	99.5%
22	S-SECO	G	W. Aringa	Jan-2001	194.0	0.25	15.3	99.5%
23	S-SECO	G	Uruguaiana	Jan-2000	639.9	0.45	15.3	99.5%
24	S-SECO	H	S. Carlos	Jan-1999	1,240.0	1	0.0	0.000
25	S-SECO	H	Canasvieiras II	Jan-1999	82.5	1	0.0	0.000
26	S-SECO	H	Canasvieiras III	Jan-1999	72.0	1	0.0	0.000
27	S-SECO	H	Igarapava	Jan-1999	210.0	1	0.0	0.000
28	S-SECO	H	Porto Primavera	Jan-1999	1,540.0	1	0.0	0.000
29	S-SECO	H	Quilmea (Mato Grosso)	Oct-1998	529.2	0.27	20.2	99.0%
30	S-SECO	H	Sobral	Sep-1998	60.0	1	0.0	0.000
31	S-SECO	H	PCH EMMAE	Jan-1998	26.0	1	0.0	0.000
32	S-SECO	H	PCH CEE	Jan-1998	25.0	1	0.0	0.000
33	S-SECO	H	PCH ENERSUL	Jan-1998	43.0	1	0.0	0.000
34	S-SECO	H	PCH CEB	Jan-1998	15.0	1	0.0	0.000
35	S-SECO	H	PCH ESSELDA	Jan-1998	62.0	1	0.0	0.000
36	S-SECO	H	PCH CELESTO	Jan-1998	50.0	1	0.0	0.000
37	S-SECO	H	PCH CEMAT	Jan-1998	145.0	1	0.0	0.000
38	S-SECO	H	PCH CELG	Jan-1998	15.0	1	0.0	0.000
39	S-SECO	H	PCH CEM	Jan-1998	59.0	1	0.0	0.000
40	S-SECO	H	PCH COPEL	Jan-1998	70.0	1	0.0	0.000
41	S-SECO	H	PCH CEMIG	Jan-1998	84.0	1	0.0	0.000
42	S-SECO	H	PCH CPFL	Jan-1998	55.0	1	0.0	0.000
43	S-SECO	H	S. Maria	Jan-1998	1,275.0	1	0.0	0.000
44	S-SECO	H	PCH EPAULO	Jan-1998	25.0	1	0.0	0.000
45	S-SECO	H	Gulman Amorim	Jan-1997	140.0	1	0.0	0.000
46	S-SECO	H	Corumbá	Jan-1997	375.0	1	0.0	0.000
47	S-SECO	H	Miranda	Jan-1997	468.0	1	0.0	0.000
48	S-SECO	H	Novo Ponte	Jan-1994	510.0	1	0.0	0.000
49	S-SECO	H	Sagrado (Gov. Ney Braga)	Jan-1992	1,260.0	1	0.0	0.000
50	S-SECO	H	Itaquinguçu	Jan-1989	654.0	1	0.0	0.000
51	S-SECO	H	Manoá	Jan-1988	210.0	1	0.0	0.000
52	S-SECO	H	D. Francisca	Jan-1987	125.0	1	0.0	0.000
53	S-SECO	H	Itá	Jan-1987	1,450.0	1	0.0	0.000
54	S-SECO	H	Rosana	Jan-1987	369.2	1	0.0	0.000
55	S-SECO	N	Angra	Jan-1985	1,874.0	1	0.0	0.000
56	S-SECO	H	T. Imbá	Jan-1985	807.5	1	0.0	0.000
57	S-SECO	H	Itaipu 50 Hz	Jan-1983	5,330.0	1	0.0	0.000
58	S-SECO	H	Itaipu 50 Hz	Jan-1983	5,375.0	1	0.0	0.000
59	S-SECO	H	Emboacanga	Jan-1982	1,192.0	1	0.0	0.000
60	S-SECO	H	Novo Avenidas	Jan-1982	347.4	1	0.0	0.000
61	S-SECO	H	Gov. Bento Munhoz - GBM	Jan-1980	1,676.0	1	0.0	0.000
62	S-SECO	H	S. Santiago	Jan-1980	1,420.0	1	0.0	0.000
63	S-SECO	H	Itumbara	Jan-1980	2,280.0	1	0.0	0.000
64	S-SECO	H	Passo Real	Jan-1978	131.0	0.3	20.7	99.0%
65	S-SECO	H	Itauba	Jan-1978	512.4	1	0.0	0.000
66	S-SECO	H	A. Vermelha (Jose E. Moraes)	Jan-1978	1,396.2	1	0.0	0.000
67	S-SECO	H	S. Simão	Jan-1978	1,710.0	1	0.0	0.000
68	S-SECO	H	Canasvieiras	Jan-1977	640.0	1	0.0	0.000
69	S-SECO	H	S. Osório	Jan-1975	1,078.0	1	0.0	0.000
70	S-SECO	H	Marimbondo	Jan-1975	1,440.0	1	0.0	0.000
71	S-SECO	H	Promissão	Jan-1975	254.0	1	0.0	0.000
72	S-SECO	C	Pres. Medici	Jan-1974	446.0	0.26	26.0	98.0%
73	S-SECO	H	Volta Grande	Jan-1974	380.0	1	0.0	0.000
74	S-SECO	H	Porto Colômbia	Jan-1973	320.0	1	0.0	0.000
75	S-SECO	H	Passo Fundo	Jan-1973	220.0	1	0.0	0.000
76	S-SECO	H	Passo Real	Jan-1973	158.0	1	0.0	0.000
77	S-SECO	H	Ita Solteira	Jan-1973	3,444.0	1	0.0	0.000
78	S-SECO	H	Mascarenhas	Jan-1973	131.0	1	0.0	0.000
79	S-SECO	H	Gov. Patrigot de Souza - GPS	Jan-1971	252.0	1	0.0	0.000
80	S-SECO	H	Chavantes	Jan-1971	414.0	1	0.0	0.000
81	S-SECO	H	Jaguari	Jan-1971	424.0	1	0.0	0.000
82	S-SECO	H	S. C. Canabarro	Apr-1970	78.0	1	0.0	0.000
83	S-SECO	H	Estreito (Luz Carlos Barreto)	Jan-1969	1,050.0	1	0.0	0.000
84	S-SECO	H	Itatinga	Jan-1969	131.5	1	0.0	0.000
85	S-SECO	H	Jupia	Jan-1969	1,551.2	1	0.0	0.000
86	S-SECO	O	Altofonte	Jan-1968	66.0	0.26	20.7	99.0%
87	S-SECO	G	Campos (Roberto Silveira)	Jan-1968	30.0	0.24	15.3	99.5%
88	S-SECO	G	Santa Cruz (RJ)	Jan-1968	766.0	0.31	15.3	99.5%
89	S-SECO	H	Parabuna	Jan-1968	85.0	1	0.0	0.000
90	S-SECO	H	Limoeiro (Armando Sales de Oliveira)	Jan-1967	32.0	1	0.0	0.000
91	S-SECO	H	Caconde	Jan-1966	80.4	1	0.0	0.000
92	S-SECO	C	J. Lacerda C	Jan-1965	363.0	0.25	26.0	98.0%
93	S-SECO	C	J. Lacerda B	Jan-1965	282.0	0.21	26.0	98.0%
94	S-SECO	C	J. Lacerda A	Jan-1965	232.0	0.18	26.0	98.0%
95	S-SECO	H	Barão (Alvaro de Souza Lima)	Jan-1965	143.1	1	0.0	0.000
96	S-SECO	H	Pontal (RJ)	Jan-1965	216.0	1	0.0	0.000
97	S-SECO	C	Figueira	Jan-1963	20.0	0.3	26.0	98.0%
98	S-SECO	H	Pumas	Jan-1963	1,216.0	1	0.0	0.000
99	S-SECO	H	Serra Bonita	Jan-1963	140.8	1	13.0	0.000
100	S-SECO	C	Cherqueiras	Jan-1962	72.0	0.23	26.0	98.0%
101	S-SECO	H	Jurumirim (Armando A. Laydner)	Jan-1962	97.7	1	0.0	0.000
102	S-SECO	H	Jacuí	Jan-1962	180.0	1	0.0	0.000
103	S-SECO	H	Petropolis Passos	Jan-1962	99.1	1	0.0	0.000
104	S-SECO	H	Tres Marias	Jan-1962	388.0	1	0.0	0.000
105	S-SECO	H	Euclydes da Cunha	Jan-1960	108.8	1	0.0	0.000
106	S-SECO	H	Camargos	Jan-1960	46.0	1	0.0	0.000
107	S-SECO	H	Santa Branca	Jan-1960	58.1	1	0.0	0.000
108	S-SECO	H	Cachoeira Dourada	Jan-1959	658.0	1	0.0	0.000
109	S-SECO	H	Salto Grande (Lucas N. Garcez)	Jan-1958	70.0	1	0.0	0.000
110	S-SECO	H	Salto Grande (MG)	Jan-1956	102.0	1	0.0	0.000
111	S-SECO	H	Mascarenhas de Moraes (Peixoto)	Jan-1956	476.0	1	0.0	0.000
112	S-SECO	H	Itutinga	Jan-1955	52.0	1	0.0	0.000
113	S-SECO	C	S. Jerônimo	Jan-1954	20.0	0.26	26.0	98.0%
114	S-SECO	O	Caranda	Jan-1954	36.2	0.3	20.7	99.0%
115	S-SECO	O	Piratininga	Jan-1954	472.0	0.3	20.7	99.0%
116	S-SECO	H	Canastra	Jan-1953	42.5	1	0.0	0.000
117	S-SECO	H	Nova Pegarim	Jan-1953	378.4	1	0.0	0.000
118	S-SECO	H	Fortale Nova	Jan-1940	130.3	1	0.0	0.000
119	S-SECO	H	Henry Borden Sub.	Jan-1926	420.0	1	0.0	0.000
120	S-SECO	H	Henry Borden Ext.	Jan-1926	469.0	1	0.0	0.000
121	S-SECO	H	Pombos	Jan-1924	189.7	1	0.0	0.000
122	S-SECO	H	Jaguari	Jan-1917	11.8	1	0.0	0.000
Total (MW) =				64,478.6				

\* Subsystem S - south, SECO - Southeast-Midwest

\*\* Fuel source C: bituminous coal; D: diesel oil; G: natural gas; H: hydro; N: nuclear; O: residual fuel oil.

[1] Agência Nacional de Energia Elétrica - Banco de Informações de Geração (http://www.aneel.gov.br), data collected in november 2004

[2] Bosi, M. A., Laurence, P., Maldonado, R., Schaeffer, A. F., Simoes, H., Wenker and J.M. Lukamba. Road testing baselines for GHG mitigation projects in the electric power sector. OECD/IEA information paper, October 2002.

[3] Intergovernmental Panel on Climate Change. Revised 1996 Guidelines for National Greenhouse Gas Inventories.

[4] Operador Nacional do Sistema Elétrico. Centro Nacional de Operação do Sistema. Acompanhamento Diário da Operação do SIN (daily reports from Jan. 1, 2001 to Dec. 31, 2003).

[5] Agência Nacional de Energia Elétrica. Superintendência de Regulação dos Serviços de Geração. Resumo Geral dos Movimentos de Geração (http://www.aneel.gov.br), data collected in november 2004.



## Summary table

Baseline (including imports)	Emission factors for the Brazilian South-Southeast-Midwest interconnected grid			
	$EF_{OM}$ [tCO <sub>2</sub> /MWh]	Load [MWh]	LCMR [MWh]	Imports [MWh]
2001	0.7350	263.706.242	244.665.786	5.493.162
2002	0.8504	275.402.896	258.720.232	1.607.395
2003	0.9378	288.493.929	274.649.425	459.586
	Total (2001-2003) =	827.603.067	778.035.443	7.560.143
	$EF_{OM, simple-adjusted}$ [tCO <sub>2</sub> /MWh]	$EF_{BM, 2003}$	from ONS-Lambda SSECO 2001-2003.xls	
	0,4043	0,0937	$\lambda_{2001}$	
	Default weights		0,5204	
	$w_{OM} = 0,5$		$\lambda_{2002}$	
	$w_{BM} = 0,5$		0,5053	
	$EF$ [tCO <sub>2</sub> /MWh]		$\lambda_{2003}$	
	0,2490		0,5312	

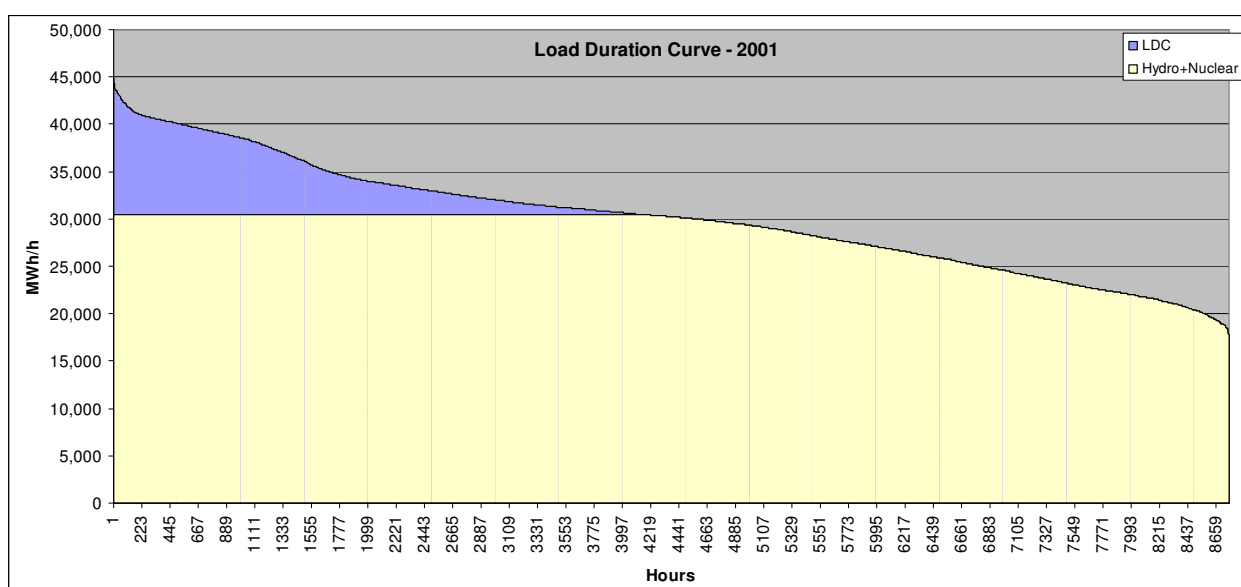


Figure 5. Load duration curve for the S-SE-MW system, 2001

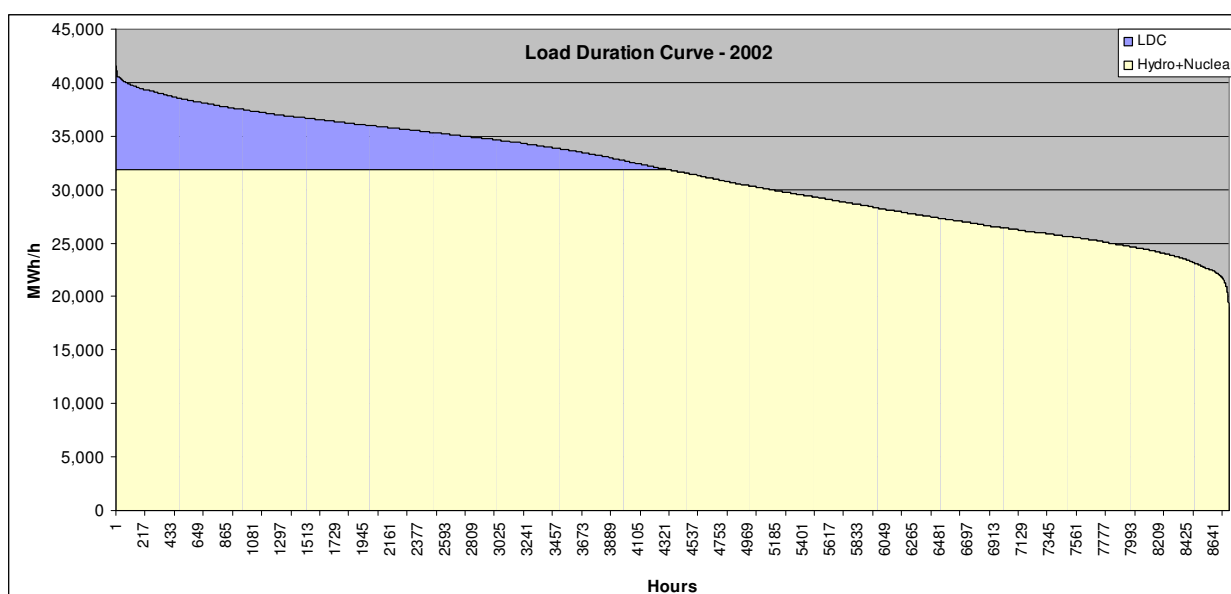


Figure 6. Load duration curve for the S-SE-MW system, 2002

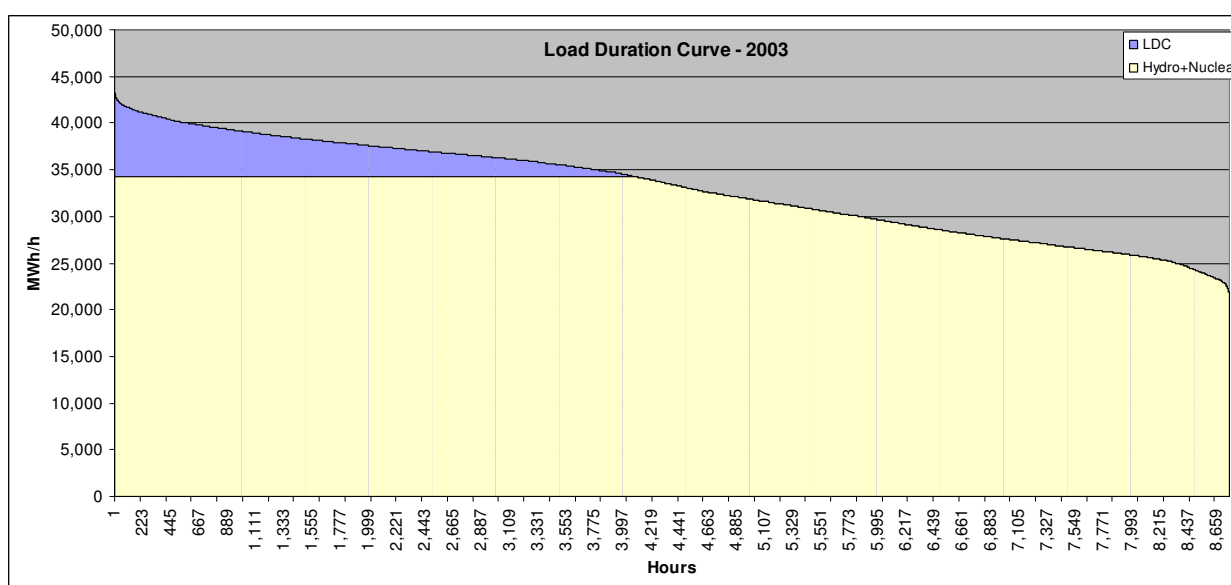



Figure 7. Load duration curve for the S-SE-MW system, 2003

#### Annex 4

### MONITORING PLAN

According to the section D of this document, the only variable that will be monitored in this project activity is the quantity of energy exported to the grid, from year 2002 up to the end of the last crediting period. Since no leakage nor any off-grid emissions change were identified in this project activity, there will be no need to monitor the variables for these cases. The monitoring will occur as follows:

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.

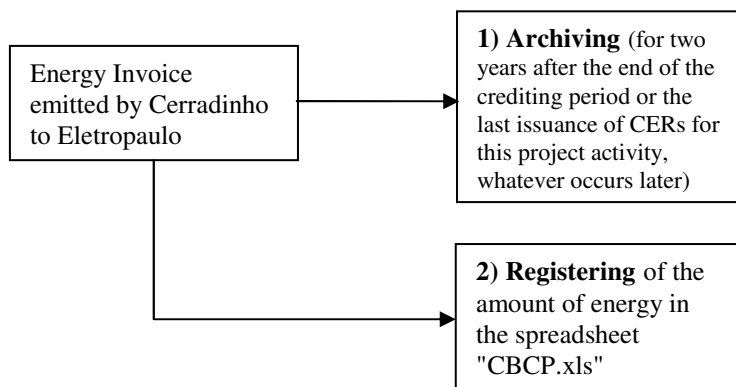

**Figure 8: Monitoring procedures for Cerradinho**

The quantity of energy exported to the grid will be monitored through the energy invoice emitted by Cerradinho to Eletropaulo, the energy distributor. The archiving will occur up to two years after the end of the crediting period or the last issuance of CERs for this project activity, whatever occurs later. The amount of energy will be registered in the spreadsheet "CBCP.xls", which shall be the instrument for the further Verification.