

**CLEAN DEVELOPMENT MECHANISM  
PROJECT DESIGN DOCUMENT FORM (CDM-SSC-PDD)  
Version 03 - in effect as of: 22 December 2006**

**CONTENTS**

- A. General description of the small scale project activity
- B. Application of a baseline and monitoring methodology
- C. Duration of the project activity / crediting period
- D. Environmental impacts
- E. Stakeholders' comments

**Annexes**

- Annex 1: Contact information on participants in the proposed small scale project activity
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring Information

**Revision history of this document**

<b>Version Number</b>	<b>Date</b>	<b>Description and reason of revision</b>
01	21 January 2003	Initial adoption
02	8 July 2005	<ul style="list-style-type: none"><li>• The Board agreed to revise the CDM SSC PDD to reflect guidance and clarifications provided by the Board since version 01 of this document.</li><li>• As a consequence, the guidelines for completing CDM SSC PDD have been revised accordingly to version 2. The latest version can be found at <a href="http://cdm.unfccc.int/Reference/Documents">http://cdm.unfccc.int/Reference/Documents</a>.</li></ul>
03	22 December 2006	<ul style="list-style-type: none"><li>• The Board agreed to revise the CDM project design document for small-scale activities (CDM-SSC-PDD), taking into account CDM-PDD and CDM-NM.</li></ul>

CDM – Executive Board

**SECTION A. General description of small-scale project activity**
**A.1 Title of the small-scale project activity:**

&gt;&gt;

JOSAPAR Pelotas Biomass Electricity Generation Project

Version 7

Date: 16/07/2007

**A.2. Description of the small-scale project activity:**

&gt;&gt;

**Purpose**

The JOSAPAR Pelotas Biomass Electricity Generation Project, developed by JOSAPAR, is a project for installation in the Pelotas city, Rio Grande do Sul state, Brazil. JOSAPAR is a rice mill company, of which the core business is the production of paddy and parboiled rice to internal and exporting markets. JOSAPAR is placed 2<sup>nd</sup> company in the ranking of rice companies in Brazil (Brazilian Rice Year Book 2005, pg. 59)<sup>1</sup>.

The project eliminates JOSAPAR's electricity demand from the grid, will sell the small surplus generated electricity to the grid and provide process steam to the rice mill.

**Project description**

The main activity in the region where the project will be located is rice production and industrialization. Rice mills generate huge amounts of biomass residues (rice husks), and the Brazilian and local state legislation prohibits the unlicensed displacement and/or uncontrolled burning of rice husks, and restricts the land filling of it, allowing the displacement only in previously licensed areas. As a result, the rice mills have huge amounts of biomass that are left for decay.

The JOSAPAR project will be the solution for the high costs associated to electricity consumption in rice production. A better quality and control of the steam supplied to the process is targeted with the project implementation.

The JOSAPAR's project consists of a turn-key biomass electricity co-generation unit, with 8 MWe and 17.6 MW<sub>thermal</sub> of installed capacity using only rice husks as fuel, complying with all the JOSAPAR's demand and exporting the surplus power to the grid. With this new thermal power plant, JOSAPAR will deactivate the old boiler used only to produce process steam. This old boiler already uses biomass as fuel but it does not generate electricity.

The only biomass that JOSAPAR is going to use are its own rice mill residues as fuel for the boiler. The amount of biomass used by third suppliers is null, once the company doesn't depend on external sources

---

<sup>1</sup> Rosa, Gilson R. Da Et. Al., Anuário Brasileiro do Arroz 2005, Gazeta Santa Cruz, Santa Cruz do Sul, Brasil, 2005, pg 59

## CDM – Executive Board

of biomass to maintain the power plant operational. Internal transportation of the fuel is facilitated by electrical screws, conveyors and elevators.

At the present time a considerable amount of surplus rice husks of the company is sold for other companies in the region, which is used at other companies' boilers. The project activity avoids the emissions related to the transport of 22 trucks of rice husks per day, but causes emissions related to a much smaller number of trucks for ash removal.

**Contribution of the project to sustainable development**

The project is promoting sustainable development to the Host Country, providing:

- Increases in employment in the area where the plant is located;
- Diversification in the sources of electricity generation;
- Uses of clean and efficient technologies, and conserving natural resources, thus the project will be meeting the Agenda 21 and Sustainable Development Criteria of Brazil;
- Actions as a clean technology demonstration project, encouraging development of modern and more efficient generation of electricity and thermal energy using biomass fuel throughout the Country;
- Optimisation in the use of natural resources, avoid new uncontrolled waste disposal places, using a large amount of rice residues from region.

**A.3. Project participants:**

&gt;&gt;

<b>Name of Party involved (*) ((host) indicates a host Party)</b>	<b>Private and/or public entity(ies) project participants (*) (as applicable)</b>	<b>Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No)</b>
Brazil (host)	JOSAPAR – Joaquim Oliveira S.A.Participações	No
Brazil (host)	PTZ Bioenergy Fontes Alternativas de Energia Indústria, Comércio e Serviços Ltda.	No
The Netherlands	Bioheat International B.V.	No

(\*)In accordance with the CDM modalities and procedures, at the time of making the CDM-PDD public at the stage of validation, a Party involved may or may not have provided its approval. At the time of requesting registration, the approval by the Party(ies) involved is required.

**A.4. Technical description of the small-scale project activity:****A.4.1. Location of the small-scale project activity:**

&gt;&gt;

**A.4.1.1. Host Party(ies):**

&gt;&gt;

Brazil

CDM – Executive Board

<b>A.4.1.2. Region/State/Province etc.:</b>
---

&gt;&gt;

Rio Grande do Sul State

<b>A.4.1.3. City/Town/Community etc:</b>
--

&gt;&gt;

Pelotas

<b>A.4.1.4. Details of physical location, including information allowing the unique identification of this <u>small-scale project activity</u> :</b>
--

&gt;&gt;

JOSAPAR-Pelotas rice mill is located in Pelotas City, in the southern region of Rio Grande do Sul State. Address: BR 116, km 512, 240 km from Porto Alegre, the capital city of the state.

<b>A.4.2. Type and category(ies) and technology/measure of the <u>small-scale project activity</u>:</b>
---

&gt;&gt;

As per appendix B of the simplified modalities and procedures for small-scale CDM project activities, the project activity falls under the following category:

**Type I; Category I.D.: Grid connected renewable electricity generation**

**Reference:** version 10: of Appendix B of the simplified modalities and procedures for small scale CDM project activities.

**Justification of how the proposed CDM project adheres to the applicability criteria of the selected project categories.**Type I; Category I.D.: Grid connected renewable electricity generation

Type I project activities are defined as renewable energy project activities with a maximum output capacity equivalent to up to 15 megawatts (or an appropriate equivalent) (decision 17/CP.7, paragraph 6 (c) (i)). The project comprises combustion of renewable rice husks in a biomass boiler for electricity generation. The nominal capacity of the installation is 8,0 MWe, which is below the limit for type I projects.

**Use of environmentally sound technologies and transfer of know how**

The JOSAPAR project will operate using state of art conventional Rankine steam cycle technology. The combustion will be performed with proven technologies like a high pressured boiler (65 bar). The power plant control will be supervised by a high standard automation set of LPCs and computers.

A condensing steam turbine drives an electrical generator. The energy is managed by control panels and devices that keep a steady condition of voltage, frequency and load. Under current operational conditions, the boiler produces up to 40,000 kg/h of steam at 65 bar and 520°C while it consumes 11.0 t/h of rice husks. The steam feeds a multistage steam condensing turbine at 0.09 bar. Before the turbine

## CDM – Executive Board

inlet, up to 50% of total steam generated is deviated to process heat. The steam turbine drives a 3 phase synchronous generator producing up to 8,000 kW<sub>e</sub> at 13,800 V and 60 Hz.

An integration panel allows synchronicity and full load control for the auxiliary power plant services, rice mill and export to the grid. Electricity is sent to the utility distribution lines through a transformer of 13.8 kV. The project already has obtained all necessary licences to be installed and complies with the Brazilian and State environmental standards, mainly regarding to the control flue gas emissions and wastes. The ash from the plant can be sold as a beneficial by-product, however it was not considered in the feasibility study aiming a conservative scenario.

The project uses the above described environmentally safe and sound technology, which leads to replacement of carbon based electricity generation. PTZ Bioenergy Fontes Alternativas de Energia Indústria, Comércio e Serviços Ltda. already has accumulated a large experience in engineering, projecting and constructing power plants at rice industries with conventional high pressure boilers in co-generation, with a similar concept of process engineering. Similar technology has been used by PTZ Bioenergy Fontes Alternativas de Energia Indústria, Comércio e Serviços Ltda. to combust rice husks at the CAMIL rice mill project (2001), a 4.2 MWe power plant in Itaquí-RS, Brazil, and a 3.0 MWe project at the URBANO rice mill Project (1999) in Jaraguá do Sul city, Santa Catarina State, Brazil, differing only in the equipment's scale.

**A.4.3 Estimated amount of emission reductions over the chosen crediting period:**

&gt;&gt;

**Table 1: Net emission reduction by the grid connected renewable electricity generation (tonnes CO<sub>2</sub> equivalent per year)**

Year	Estimation of annual emission reductions in tonnes of CO <sub>2</sub> e
<b>1 Dec - 31 Dec 2009</b>	<b>889</b>
<b>2010</b>	<b>10,664</b>
<b>2011</b>	<b>10,664</b>
<b>2012</b>	<b>10,664</b>
<b>2013</b>	<b>10,664</b>
<b>2014</b>	<b>10,664</b>
<b>2015</b>	<b>10,664</b>
<b>1 Jan - 30 Nov 2016</b>	<b>9,775</b>
<b>Total estimated reductions (tonnes of CO<sub>2</sub> e)</b>	<b>74,648</b>
<b>Total number of crediting years</b>	<b>7</b>

**A.4.4. Public funding of the small-scale project activity:**

&gt;&gt;

There will be no public funding to the project.

**A.4.5. Confirmation that the small-scale project activity is not a debundled component of a large scale project activity:**

&gt;&gt;

---

CDM – Executive Board

According to paragraph 2 of Appendix C to the Simplified Modalities and Procedures for Small-Scale CDM project activities, a small-scale project is considered a debundled component of a large project activity if there is a registered small-scale activity or an application to register another small-scale activity:

- With the same project participants;
- In the same project category and technology/measure; and
- Registered within the previous 2 years; and
- Whose project boundary is within 1 km of the project boundary of the proposed small-scale activity at the closest point.

There is no other small-scale activity that meets the above mentioned criteria. Accordingly, the proposed project activity is not a debundled component of a larger project activity.

CDM – Executive Board

**SECTION B. Application of a baseline and monitoring methodology**
**B.1. Title and reference of the approved baseline and monitoring methodology applied to the small-scale project activity:**

&gt;&gt;

**Type I; Category I.D.: Grid connected renewable electricity generation (Version 10)**

**Reference:** Appendix B of the simplified modalities and procedures for small-scale CDM project activities (version 10).

**B.2 Justification of the choice of the project category:**

&gt;&gt;

The applicability criteria of the Category I.D. 'Grid connected renewable electricity generation' are:

Technology/measure

1. This category comprises renewable energy generation units, such as photovoltaics, hydro, tidal/wave, wind, geothermal, and renewable biomass, that supply electricity to and/or displace electricity from an electricity distribution system that is or would have been supplied by at least one fossil fuel fired generating unit.
2. If the unit added has both renewable and non-renewable components (e.g. a wind/diesel unit), the eligibility limit of 15MW for a small-scale CDM project activity applies only to the renewable component. If the unit added co-fires fossil fuel, the capacity of the entire unit shall not exceed the limit of 15MW.
3. Biomass combined heat and power (co-generation) systems that supply electricity to and/or displace electricity from a grid are included in this category. To qualify under this category, the sum of all forms of energy output shall not exceed 45 MW<sub>thermal</sub>. E.g., for a biomass based co-generating system the rating for all the boilers combined shall not exceed 45 MW<sub>thermal</sub>.
4. In the case of project activities that involve the addition of renewable energy generation units at an existing renewable power generation facility, the added capacity of the units added by the project should be lower than 15 MW and should be physically distinct<sup>1</sup> from the existing units.
5. Project activities that seek to retrofit or modify an existing facility for renewable energy generation are included in this category. To qualify as a small scale project, the total output of the modified or retrofitted unit shall not exceed the limit of 15 MW.

<sup>1</sup> Physically distinct units are those that are capable of generating electricity without the operation of existing units, and that do not directly affect the mechanical, thermal, or electrical characteristics of the existing facility. For example, the addition of a steam turbine to an existing combustion turbine to create a combined cycle unit would not be considered "physically distinct".

The project conforms to the above mentioned conditions in the following ways:

- Ad. 1. The project comprises the use of rice husks, which is a renewable biomass to be used to supply electricity to and/or displace electricity from the south-southeast-midwest Brazilian electricity distribution system. Rio Grande do Sul and Santa Catarina States are the only two states in Brazil who presents coal fired power plants complementing the energy demand in the integrated electrical south-southeast-midwest Brazilian grid. Thus the project activity replaces the use of at least one fossil fuel.
- Ad. 2. The unit uses only rice husks, which is renewable biomass.

## CDM – Executive Board

Ad. 3. The plant has a maximum output of heat (17.6 MW<sub>thermal</sub>) and power (8.0 MW<sub>electrical</sub>). The sum of these outputs is below the limit of 45 MW<sub>thermal</sub>.

Ad. 4. The biomass power plant is the first one to be installed in JOSAPAR. The maximum output power of 8.0 MWe is below the limit of 15 MW established to be qualified as a small scale CDM project activity.

Ad. 5. The project is not a retrofitted or modified facility. The biomass power plant will be a new facility that will produce a maximum of 8.0 MWe that is below the limit of 15 MW.

It is concluded that category AMS I.D. is applicable to the small-scale project activity.

### Assumptions of the baseline methodology

To estimate the baseline emissions related to grid connected renewable electricity generation the baseline calculations as indicated under category I.D. of Appendix B are applied. The combined margin (CM), consisting of the combination of operating margin (OM) and build margin (BM), was calculated according to the procedures prescribed in the approved methodology ACM0002. The option for the ex-ante estimation of the Simple Adjusted OM and the Build Margin (BM) was chosen.

### B.3. Description of the project boundary:

>>

According to category I.D. the project boundary encompasses the physical, geographical site of the renewable generation source.

The rice husks are combusted for electricity generation at the site of the rice mill. This is also the location where the rice husks are produced from the rice milling process.

### B.4. Description of baseline and its development:

>>

This scenario represents continuation of the current practices. No electricity is produced with rice husks, consequently all needed -fossil fuel based- electricity is delivered by the grid.

### Category I.D.

The baseline is the kWh produced by the renewable generating unit multiplied by an emission coefficient (measured in kg CO<sub>2</sub>equ/kWh) calculated in a transparent and conservative manner.

The baseline emissions (*BE<sub>y</sub>*) resulting from the electricity supplied and/or not consumed from the grid is calculated as follows, where *EG<sub>y</sub>* is the annual net electricity generated from the Project.

$$BE_y = EG_y * EF_y$$

The baseline emissions factor (*EF<sub>y</sub>*) is a weighted average of the *EF<sub>OMy</sub>* and *EF<sub>BM<sub>y</sub></sub>*:

$$EF_y = (\omega_{OM} * EF_{OMy}) + (\omega_{BM} * EF_{BM_y})$$

where the weights  $\omega_{OM}$  and  $\omega_{BM}$  are by default 0.5.

## CDM – Executive Board

**The Operating Margin emission factor ( $EF_{OMy}$ )** is calculated according to the procedures prescribed in the approved methodology ACM0002 – option (b):

*Simple Adjusted OM:*

$$EF_{OM, \text{simple\_adjusted}, y} = (1 - \lambda_y) \cdot \frac{\sum_j F_{i,j,y} \cdot COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \cdot \frac{\sum_k F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}}$$

Where:

$k$	low-cost/must-run power sources;
$j$	power sources delivering electricity to the grid, not including low-operating cost and must-run power plants, and including imports to the grid;
$F_{i,j,y}$	is the amount of fuel $i$ (in a mass or volume unit) consumed by relevant power sources $j$ in year(s) $y$ ;
$F_{i,k,y}$	is the amount of fuel $i$ (in a mass or volume unit) consumed by relevant power sources $k$ in year(s) $y$ ;
$COEF_{i,j,y}$	is the CO <sub>2</sub> emission coefficient of fuel $i$ (tCO <sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources $j$ and the percent oxidation of the fuel in year(s) $y$ ;
$COEF_{i,k,y}$	is the CO <sub>2</sub> emission coefficient of fuel $i$ (tCO <sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources $k$ and the percent oxidation of the fuel in year(s) $y$ ;
$GEN_{j,y}$	is the electricity (MWh) delivered to the grid by source $j$ .
$GEN_{k,y}$	is the electricity (MWh) delivered to the grid by source $k$ .

$$\lambda_y = \frac{\text{"number of hours per year for which low - cost / must - run sources are on margin"}}{\text{"8760 hours per year"}}$$

Lambda ( $\lambda_y$ ) should be calculated as follows:

- Step i) Plot a Load Duration Curve. Collect chronological load data (typically in MW) for each hour of a year, and sort load data from highest to lowest MW level. Plot MW against 8760 hours in the year, in descending order.
- Step ii) Organize Data by Generating Sources. Collect data for, and calculate total annual generation (in MWh) from low-cost/must-run resources (i.e.  $\sum_k GEN_{k,y}$ ).
- Step iii) Fill Load Duration Curve. Plot a horizontal line across load duration curve such that the area under the curve (MW times hours) equals the total generation (in MWh) from lowcost/must-run resources (i.e.  $\sum_k GEN_{k,y}$ ).
- Step iv) Determine the "Number of hours per year for which low-cost/must-run sources are on the margin". First, locate the intersection of the horizontal line plotted in step (iii) and the load duration curve plotted in step (i). The number of hours (out of the total of 8760 hours) to the right of the intersection is the number of hours for which low-cost/must-run sources are on the margin. If the lines do not intersect, then one may conclude that lowcost/must-run sources do not appear on the margin and  $\lambda_y$  is equal to zero. Lambda ( $\lambda_y$ ) is the calculated number of hours divided by 8760.

## CDM – Executive Board

The CO<sub>2</sub> emission coefficient  $COEF_i$  is obtained as:

$$COEF_i = NCV_i \cdot EF_{CO_2,i} \cdot OXID_i$$

where:

- $NCV_i$  is the net calorific value (energy content) per mass or volume unit of a fuel  $i$ ;  
 $OXID_i$  is the oxidation factor of the fuel (see page 1.29 in the 1996 Revised IPCC Guidelines for default values);  
 $EF_{CO_2,i}$  is the CO<sub>2</sub> emission factor per unit of energy of the fuel  $i$ .

Where available, local values of  $NCV_i$  and  $EF_{CO_2,i}$  should be used. If no such values are available, country-specific values (see e.g. IPCC Good Practice Guidance) are preferable to IPCC world-wide default values.

The *Simple Adjusted OM* was calculated using the following data vintage:

(*Ex-ante*) the full generation-weighted average for the most recent 3 years for which data are available at the time of PDD submission

**The Build Margin emission factor ( $EF_{BM_y}$ )** is the weighted average emission factor of a sample of power plants  $m$ :

$$EF_{BM_y} (tCO_2 / MWh) = \frac{\left[ \sum_{i,m} F_{i,m,y} * COEF_{i,m} \right]}{\left[ \sum_m GEN_{m,y} \right]}$$

where  $F_{i,m,y}$ ,  $COEF_{i,m}$  and  $GEN_m$  are analogous to the *OM* calculation above.

The option 1 was selected to calculate the Build Margin emission factor:

*Ex-ante* based on the most recent information available on plants already built for sample group  $m$  at the time of PDD submission. The sample group  $m$  consists of either the five power plants that have been built most recently, or the power plant capacity additions in the electricity system that comprise 20% of the system generation (in MWh) and that have been built most recently. Project participants should use from these two options that sample group that comprises the larger annual generation.

### Additional Formulae

$$F_{i,y} = GEN_{j,y} / (\eta_i \cdot NCV_i)$$

where:

- $GEN_{j,y}$  is the electricity (MWh) delivered to the grid by source  $i$   
 $\eta_i$  is the fossil fuel conversion efficiency for the source  $i$   
 $NCV_i$  is the net calorific value (energy content) per mass or volume unit of a fuel  $i$

As recommended by the Executive Board, the fossil fuel conversion efficiency provided by national sources, where available, was used to calculate the Build Margin parameters once it provides a more conservative emission factor.

---

CDM – Executive Board

$$EF_{CO2,I} = EF_{C,i} * 44/12$$

where:

$EF_{C,i}$  is the carbon emission factor

44/12 is the carbon to carbon dioxide conversion factor

### Assumption

The evaluation of the Operating Margin emission factor was conducted in a conservative way using the following consideration:

$$COEF_k = 0 \quad \therefore$$

$$\frac{\sum_{(i,k)} F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}} = 0$$

## CDM – Executive Board

**Table 2: Emission reduction by grid connected renewable electricity generation**

Indicator	Abbreviation	Value	Unit	Source of data
Low-cost/must-run power sources	$k$	See annex 3	Dimensionless	ONS
Power sources delivering electricity to the grid excluding low cost/must run power plants	$j$	See annex 3	Dimensionless	ONS
Amount of fuel $i$ consumed by relevant power sources $j$ in year(s) $y$	$F_{i,j,y}$	See annex 3	t/ year	Calculated
Amount of fuel $i$ consumed by relevant power sources $k$ in year(s) $y$	$F_{i,k,y}$	See annex 3	t/ year	Calculated
Net calorific value of a fuel $i$	$NCV_i$	See annex 3	TJ/kt	IPCC and Brazilian Ministry of Mine and Energy <sup>2</sup>
Oxidation factor of the fuel $i$	$OXID_i$	See annex 3	Dimensionless	IPCC default values
CO <sub>2</sub> emission factor of the fuel $i$	$EF_{CO_2,i}$	See annex 3	Dimensionless	Calculated
CO <sub>2</sub> emission coefficient of fuel $i$	$COEF_{i,j,y}$	See annex 3	tCO <sub>2</sub> /t	Calculated
electricity delivered to the grid by source $j$	$GEN_{j,y}$	See annex 3	MWh/year	ONS
electricity delivered to the grid by source $k$	$GEN_{k,y}$	See annex 3	MWh/year	ONS
Fossil fuel conversion efficiency for the source $i$ to calculate EF_OM	$\eta_{i,OM}$	See annex 3	Dimensionless	IPCC
Fossil fuel conversion efficiency for the source $i$ to calculate EF_BM	$\eta_{i,BM}$	See annex 3	Dimensionless	IPCC, Eletrobrás <sup>3</sup> and CIMGC <sup>4</sup>
Carbon emission factor	$EF_{C,i}$	See annex 3	Dimensionless	IPCC
Carbon to carbon dioxide conversion factor	-	44/12	Dimensionless	IPCC
Lambda at 2003	$\lambda_{2003}$	0.531	Dimensionless fraction	Calculated
Lambda at 2004	$\lambda_{2004}$	0.506	Dimensionless fraction	Calculated
Lambda at 2005	$\lambda_{2005}$	0.513	Dimensionless fraction	Calculated
Operating margin weight	$\omega_{OM}$	0.5	Dimensionless	IPCC default value
Build margin weight	$\omega_{BM}$	0.5	Dimensionless	IPCC default value
Operating margin emission factor	$EF_{OM,y}$	0.404	tonnes CO <sub>2</sub> /MWh	Calculated
Build margin emission factor	$EF_{BM,y}$	0.092	tonnes CO <sub>2</sub> /MWh	Calculated
Baseline emission factor	$EF_y$	0.248	tonnes CO <sub>2</sub> /MWh	Calculated
Annual net electricity generated by the Project	$EG_y$	43,000	MWh	Calculated
Baseline emissions	$BE_{el}$	10,664	tonnes CO <sub>2</sub> /year	Calculated

<sup>2</sup> Ministério de Minas e Energia - Balanço Energético Nacional 2007: [www.mme.gov.br](http://www.mme.gov.br)

<sup>3</sup> Eletrobrás – [http://www.eletrobras.gov.br/EM\\_atuacao\\_ccc/default.asp](http://www.eletrobras.gov.br/EM_atuacao_ccc/default.asp)

<sup>4</sup> Comissão Interministerial de Mudança Global do Clima – CIMGC; Análise sobre o Setor Energético na Região Sul: [www.mct.gov.br/clima/comunic\\_old/energi41.htm#index](http://www.mct.gov.br/clima/comunic_old/energi41.htm#index)

**B.5. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered small-scale CDM project activity:**

>>

Attachment A to Appendix B indicated that project participants shall provide an explanation to show that the project activity would not have occurred anyway due to at least one of the following barriers:

- (a) Investment barrier: a financially more viable alternative to the project activity would have led to higher emissions;
- (b) Technological barrier: a less technologically advanced alternative to the project activity involves lower risks due to the performance uncertainty or low market share of the new technology adopted for the project activity and so would have led to higher emissions;
- (c) Barrier due to prevailing practice: prevailing practice or existing regulatory or policy requirements would have led to implementation of a technology with higher emissions;
- (d) Other barriers: without the project activity, for another specific reason identified by the project participant, such as institutional barriers or limited information, managerial resources, organizational capacity, financial resources, or capacity to absorb new technologies, emissions would have been higher.

The first step in the process is to list the likely future scenarios. Two scenarios were considered:

Scenario 1 - Continuation of current activities

This scenario represents continuation of the current practices. No electricity is produced with rice husks, consequently all needed -fossil fuel based- electricity is delivered by the grid.

Scenario 2 - Construction of a renewable energy plant

In this scenario, the JOSAPAR biomass electricity generation plant is established. Rice husks will be used to produce heat and power. The power replaces fossil fuel based power formerly delivered by the grid. In addition surplus power will be delivered to the grid, thereby replacing fossil fuel based electricity.

With respect to the **investment** barrier:

- The continuation of current practices (Scenario 1) does not pose any financial/economical barrier to the project developer, and requires no further financing.
- The construction of a renewable energy plant (Scenario 2) faces specific financial/economic barriers due to the fact that the capital costs related to co-generation biomass units are very high. The capital costs involved in the project pose a barrier, especially considering the high interest rates prevalent in developing countries. It is worth noting that there are no direct subsidies or promotional support for the implementation of independent renewable energy plants.

The financial barrier is demonstrated through a financial analysis, which the results are presented in table 3 below. The carbon revenues increase the returns of the project transforming this into an attractive investment for the company and financial agents.

## CDM – Executive Board

**Table 3: Financial Analysis Results**

	With Carbon	Without Carbon
Net Present Value (US\$)	62,646.65	-514,361.95
IRR	10.0%	7.9%
Discount Rate	9.75%	9.75%
Present Value of carbon sold (7 years) US\$	895,776.00	

The Internal rate return and the Net Present Value were obtained based on the power plant cash flow presented in Table 4 below.

**Table 4: Cash Flow**

	Year 1	Year 2	Year 3	Year 4	Year 5	Year 6	Year 7	Year 8	Year 9	Year 10
<b>1. REVENUES</b>										
Electricity revenue price to the grid (USD/MWh)	-	38.00	39.90	41.90	43.99	46.19	48.50	50.92	53.47	56.14
Electricity revenue price to other units (USD/MWh)	-	78.49	82.41	86.54	90.86	95.41	100.18	105.18	110.44	115.97
Electricity revenues to the grid (MWh/year)	-	1,328	15,938	15,938	15,938	15,938	15,938	15,938	15,938	15,938
Electricity revenues other units (MWh/year)	-	328	3934	3934	3934	3934	3934	3934	3934	3934
<b>2. RESULTS</b>										
(+) Electricity revenues	-	76,202	960,145	1,008,152	1,058,560	1,111,488	1,167,062	1,225,415	1,286,686	1,351,020
(-) Variable Costs	-	18,989	250,656	275,722	303,294	333,623	366,985	403,684	444,052	488,458
(-) Taxes	-	286	43,207	45,367	47,635	50,017	52,518	55,144	57,901	60,796
(-) Fixed Costs	-	36,493	481,701	529,871	582,858	641,144	705,258	775,784	853,363	938,699
<b>(=) Gross profit</b>	-	20,435	184,581	157,193	124,773	86,704	42,300	-9,197	-68,630	-136,932
(-) Interest	894,874	1,512,122	1,332,943	1,092,412	851,881	611,350	370,819	130,288	0	0
(-) Depreciation	-	44,784	537,404	537,404	537,404	537,404	537,404	537,404	537,404	537,404
<b>(=) Profit before income tax</b>	-	-1,536,471	-1,685,766	-1,472,624	-1,264,513	-1,062,050	-865,922	-676,889	-606,034	-674,336
(-) Income tax	-	0	0	0	0	0	0	0	0	0
(-) Stop with biomass revenues	-	12,500	157,500	165,375	173,644	182,326	191,442	201,014	211,065	221,618
(+) Electricity save	-	185,328	2,335,132	2,451,889	2,574,484	2,703,208	2,838,368	2,980,286	3,129,301	3,285,766
(+) Carbon Credits	-	10,664	127,968	127,968	127,968	127,968	127,968	127,968	117,304	0
<b>(=) Net profit</b>	-	<b>-1,352,979</b>	<b>619,835</b>	<b>941,858</b>	<b>1,264,295</b>	<b>1,586,799</b>	<b>1,908,971</b>	<b>2,230,352</b>	<b>2,429,506</b>	<b>2,389,811</b>
(+) Depreciation	-	44,784	537,404	537,404	537,404	537,404	537,404	537,404	537,404	537,404
<b>(=) Incomes generated</b>	-	<b>-1,308,195</b>	<b>1,157,239</b>	<b>1,479,263</b>	<b>1,801,699</b>	<b>2,124,203</b>	<b>2,446,375</b>	<b>2,767,756</b>	<b>2,966,910</b>	<b>2,927,215</b>
(-) Loan repayments	-	512,193	1,536,579	1,536,579	1,536,579	1,536,579	1,536,579	1,536,579	0	0
(-) JOSAPAR equity	2,386,166	46,750	0	0	0	0	0	0	0	0
(-) Working Capital	55,482	0	0	0	0	0	0	0	0	0
(+) Current Asset applications	558,707	558,707	0	0	0	0	0	0	0	0
<b>(=) Cash Flow</b>	<b>-2,777,815</b>	<b>-1,308,431</b>	<b>-379,340</b>	<b>-57,316</b>	<b>265,121</b>	<b>587,625</b>	<b>909,797</b>	<b>1,231,177</b>	<b>2,966,910</b>	<b>2,927,215</b>

\*All presented values are in US\$

With respect to the **technological** barrier:

- In the case of Scenario 1 (continuation), there are no technical/technological issues as this simply represents a continuation of current practices and does not involve any new technology or

## CDM – Executive Board

innovation. Indeed, in this scenario there are no technical/technological implications as the scenario calls for continued use of electricity from the grid.

- In the case of Scenario 2, there are no significant technical/technological barriers. All the technologies involved in this scenario are available in the market and commercially proven, and have been used effectively in the Host Country.

With respect to the analysis of **prevailing business practice**:

- The continuation of current practices (Scenario 1) presents no particular obstacles. This practice has been used effectively in the past with good results, and the continued operation of existing facilities and actual practices presents no real barriers. Moreover Brazil has a huge rice industry, with more than 350 rice mills. A considerable fraction, about 60%, of rice production is located in the south region (IRGA 2004)<sup>5</sup>. The south Brazilian region, i.e. the states of Rio Grande do Sul, Santa Catarina and Paraná, have no recorded problems with power supply, even along the electricity crisis observed at 2001. Environmental agencies have been approving new areas for disposing the industrial residues, as rice husks, with clear and effective rules, in such a way that only the distance, and by consequence the costs, will represent obstacles for taking the residues into consideration as a pressure to perform future projects.
- The Brazilian technologies in rice mills are very updated with global technologies employed, representing the state of art on rice mills technology. The efficiency of the process reaches around 98% of the commercial matter in the grain. Usually 78% of the rice is transformed in products. The other 22-23% are rice residues. Given the large number of rice mills in the south region the biomass residue generation is concentrated in the south region, creating an excess of biomass residues that the market cannot absorb. According to CIENTEC<sup>6</sup> more than 59,60 % of residues are not used or sold. Currently only 6 small-scale power plants operate at the south region of Brazil. From 2002, no new plants were build, mainly due to the lack of feasibility. Thus, there are many large biomass piles that are left for decay, generating methane during this process.
- The construction of a new renewable energy plant (Scenario 2) doesn't represent a deviation from the company's core business (rice production) once the energy costs avoided will be utilized to sell benefited rice for a lower price or to increment the profit margin of the product. Therefore, the steam generated by the boiler will be used to achieve a higher quality in the rice process. Currently JOSAPAR has a great amount of rice husks that guaranties the supply for the future plant.

With respect to the analysis of **other barriers**

- In case of scenario 1, no other barriers were identified.
- In case of scenario 2, no other barriers were identified.

Table 5 below summarises the results of the analysis regarding the barriers faced by each of the plausible scenarios. As the table indicates, Scenario 1 faces no barriers, whereas Scenario 2 faces the financial/economic barrier.

---

<sup>5</sup> RUCATTI, Evelyn Gischkow, KAYSER, Victor Hugo, 2004. Produção e Disponibilidade de Arroz por Região Brasileira Instituto Riograndense do Arroz. Rio Grande do Sul, Brasil.

<sup>6</sup> CIENTEC, 1986. Programa Energia: Aproveitamento Energético da Casca de Arroz. Relatório do Projeto de Pesquisa. Porto Alegre, Fundação de Ciência e Tecnologia.

**Table 5: Summary of Barriers Analysis**

Barrier Evaluated	Scenario 1 Continuation of Current Activities	Scenario 2 Construction of a new plant
1. Investment barrier	No	Yes
2. Technological barrier	No	No
3. Prevailing practice	No	No
4. Other barriers	No	No

Because the investment barrier would prevent that the project would have occurred anyway, it is concluded that the project is additional.

The implementation of the project will displace the energy consumed from the grid, consequently reducing the CO<sub>2</sub> emissions, as showed in the following analysis:

- The Baseline Scenario is represented by an old boiler that provides process steam and steam for the rice drying process. This boiler consumes 18,456 tonnes of rice husks per year, 34% of total production. The surplus of biomass, nearly 35,444 tonnes, is sold to industrial plants, to burn in the boilers, only for heat generation in substitution of wood. The industry will continue to use energy from the grid that have a production of CO<sub>2</sub> associated to the MWh produced.
- The Project Scenario is represented by the construction of a new renewable energy plant of 8.0 MWe. This implementation will imply in substitution of the old boiler by a new boiler that will provide steam for the drying rice process, process heat and power generation. The expected amount of rice husks consumed will be 59,125 tonnes per year. The energy imported from the grid, which is partly generated by fossil fuels, will be displaced, contributing to GHG emission reductions. The rice husks transportation will be decreased as well as ash generation will be increased, resulting in a final balance where the diesel consumption is reduced and, consequently, the CO<sub>2</sub> equivalent emissions.

The Project Scenario is environmentally additional in comparison to the baseline scenario, and therefore eligible to receive Certified Emissions Reductions (CERs) under the CDM.

<b>B.6. Emission reductions:</b>
----------------------------------

&gt;&gt;

<b>B.6.1. Explanation of methodological choices:</b>
--

&gt;&gt;

**Category I.D.****Emission reductions**

Emission reduction by grid connected renewable electricity production during a given period equals:

$$ER_{ID} = BE_{el}$$

## CDM – Executive Board

where,

$ER_{ID}$  = emission reduction due to grid connected renewable electricity production (tonnes CO<sub>2</sub>equ)

$BE_{el}$  = Baseline Emissions of electricity generation (tonnes CO<sub>2</sub>eq)

No formula is provided to quantify the emission reduction of electricity generation in the Baseline of category I.D. of appendix B. In words it is described that:

*Baseline emissions*

(...) the baseline is the kWh produced by the renewable generating unit multiplied by an emission coefficient (measured in kg CO<sub>2</sub>equ/kWh) calculated in a transparent and conservative manner as:

- (a) A combined margin (CM), consisting of the combination of operating margin (OM) and build margin (BM) according to the procedures prescribed in the approved methodology ACM0002. Any of the four procedures to calculate the operating margin can be chosen, but the restrictions to use the Simple OM and the Average OM calculations must be considered

OR

- (b) The weighted average emissions (in kg CO<sub>2</sub>equ/kWh) of the current generation mix. The data of the year in which project generation occurs must be used.

The option (a) was chosen to calculate the emission factor.

**The baseline emissions** ( $BE_y$ ) resulting from the electricity supplied and/or not consumed from the grid is calculated as follows, where  $EG_y$  is the annual net electricity generated from the Project.

$$BE_y = EG_y * EF_y$$

**The baseline emissions factor** ( $EF_y$ ) is a weighted average of the  $EF_{OMy}$  and  $EF_{BMy}$ :

$$EF_y = (\omega_{OM} * EF_{OMy}) + (\omega_{BM} * EF_{BMy})$$

where the weights  $\omega_{OM}$  and  $\omega_{BM}$  are by default 0.5.

**The Operating Margin emission factor** ( $EF_{OMy}$ ) is calculated according to the procedures prescribed in the approved methodology ACM0002 – option (b): Simple Adjusted OM.

Option (b) – Simple Adjusted OM – was chosen once low cost/must run resources constitute more than 50% of total grid generation, excluding option (a); not enough data was available to perform option (c) Dispatch Data Analysis, but sufficient data was available to apply the Simple Adjusted OM as recommended in the ACM0002 methodology.

## CDM – Executive Board

Simple Adjusted OM:

$$EF_{OM, \text{simple\_adjusted}, y} = (1 - \lambda_y) \cdot \frac{\sum_j F_{i,j,y} \cdot COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \cdot \frac{\sum_k F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}}$$

Where:

$k$	low-cost/must-run power sources;
$j$	power sources delivering electricity to the grid, not including low-operating cost and must-run power plants, and including imports to the grid;
$F_{i,j,y}$	is the amount of fuel $i$ (in a mass or volume unit) consumed by relevant power sources $j$ in year(s) $y$ ;
$F_{i,k,y}$	is the amount of fuel $i$ (in a mass or volume unit) consumed by relevant power sources $k$ in year(s) $y$ ;
$COEF_{i,j,y}$	is the CO <sub>2</sub> emission coefficient of fuel $i$ (tCO <sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources $j$ and the percent oxidation of the fuel in year(s) $y$ ;
$COEF_{i,k,y}$	is the CO <sub>2</sub> emission coefficient of fuel $i$ (tCO <sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources $k$ and the percent oxidation of the fuel in year(s) $y$ ;
$GEN_{j,y}$	is the electricity (MWh) delivered to the grid by source $j$ .
$GEN_{k,y}$	is the electricity (MWh) delivered to the grid by source $k$ .

$$\lambda_y = \frac{\text{"number of hours per year for which low - cost / must - run sources are on margin"}}{\text{"8760 hours per year"}}$$

Lambda ( $\lambda_y$ ) should be calculated as follows:

- Step i) Plot a Load Duration Curve. Collect chronological load data (typically in MW) for each hour of a year, and sort load data from highest to lowest MW level. Plot MW against 8760 hours in the year, in descending order.
- Step ii) Organize Data by Generating Sources. Collect data for, and calculate total annual generation (in MWh) from low-cost/must-run resources (i.e.  $\sum_k GEN_{k,y}$ ).
- Step iii) Fill Load Duration Curve. Plot a horizontal line across load duration curve such that the area under the curve (MW times hours) equals the total generation (in MWh) from lowcost/must-run resources (i.e.  $\sum_k GEN_{k,y}$ ).
- Step iv) Determine the "Number of hours per year for which low-cost/must-run sources are on the margin". First, locate the intersection of the horizontal line plotted in step (iii) and the load duration curve plotted in step (i). The number of hours (out of the total of 8760 hours) to the right of the intersection is the number of hours for which low-cost/must-run sources are on the margin. If the lines do not intersect, then one may conclude that lowcost/must-run sources do not appear on the margin and  $\lambda_y$  is equal to zero. Lambda ( $\lambda_y$ ) is the calculated number of hours divided by 8760.

The CO<sub>2</sub> emission coefficient  $COEF_i$  is obtained as:

$$COEF_i = NCV_i \cdot EF_{CO_2,i} \cdot OXID_i$$

## CDM – Executive Board

where:

- $NCV_i$  is the net calorific value (energy content) per mass or volume unit of a fuel  $i$ ;  
 $OXID_i$  is the oxidation factor of the fuel (see page 1.29 in the 1996 Revised IPCC Guidelines for default values);  
 $EF_{CO_2,i}$  is the CO<sub>2</sub> emission factor per unit of energy of the fuel  $i$ .

Where available, local values of  $NCV_i$  and  $EF_{CO_2,i}$  should be used. If no such values are available, country-specific values (see e.g. IPCC Good Practice Guidance) are preferable to IPCC world-wide default values.

The Simple Adjusted OM was calculated using the following data vintage:

*Ex-ante*: full generation-weighted average for the most recent 3 years for which data are available at the time of PDD submission.

**The Build Margin emission factor ( $EF_{BM_y}$ )** is the weighted average emission factor of a sample of power plants  $m$ :

$$EF_{BM_y} (tCO_2 / MWh) = \frac{\left[ \sum_{i,m} F_{i,m,y} * COEF_{i,m} \right]}{\left[ \sum_m GEN_{m,y} \right]}$$

where  $F_{i,m,y}$ ,  $COEF_{i,m}$  and  $GEN_m$  are analogous to the OM calculation above.

The option 1 was selected to calculate the Build Margin emission factor:

*Ex-ante* based on the most recent information available on plants already built for sample group  $m$  at the time of PDD submission. The sample group  $m$  consists of either the five power plants that have been built most recently, or the power plant capacity additions in the electricity system that comprise 20% of the system generation (in MWh) and that have been built most recently. Project participants should use from these two options that sample group that comprises the larger annual generation.

### Additional Formulae

$$F_{i,y} = GEN_{j,y} / (\eta_i \cdot NCV_i)$$

where:

- $GEN_{j,y}$  is the electricity (MWh) delivered to the grid by source  $i$   
 $\eta_i$  is the fossil fuel conversion efficiency for the source  $i$   
 $NCV_i$  is the net calorific value (energy content) per mass or volume unit of a fuel  $i$

As recommended by the Executive Board, the fossil fuel conversion efficiency provided by national sources, where available, was used to calculate the Build Margin parameters once it provides a more conservative emission factor.

$$EF_{CO_2,I} = EF_{C,i} * 44/12$$

where:

- $EF_{C,i}$  is the carbon emission factor

CDM – Executive Board

44/12 is the carbon to carbon dioxide conversion factor

### Assumption

The evaluation of the Operating Margin emission factor was conducted in a conservative way using the following consideration:

$COEF_k = 0 \therefore$

$$\frac{\sum_{(i,k)} F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}} = 0$$

### Project emissions

The project emissions are negligible.

### Leakage

No leakage calculation is required, as the renewable energy technology used is not equipment transferred from another activity.

#### B.6.2. Data and parameters that are available at validation:

>>

#### Category I.D.

<b>Data / Parameter:</b>	$NCV_i$
<b>Data unit:</b>	TJ/kt
<b>Description:</b>	Net calorific value of a fuel $i$
<b>Source of data used:</b>	IPCC and Brazilian Ministry of Mine and Energy
<b>Value applied:</b>	See annex 3
<b>Justification of the choice of data or description of measurement methods and procedures actually applied :</b>	Where available, specific NCV was used based in the brazilian fuel characteristics. This data was obtained from Brazilian Ministry of Mine and Energy.  Where not available, IPCC default values were used.
<b>Any comment:</b>	

CDM – Executive Board

<b>Data / Parameter:</b>	$GEN_{j,2003}$
Data unit:	MWh/year
Description:	Electricity delivered to the grid by source $j$ at 2003
Source of data used:	ONS
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Dispatch data.
Any comment:	

<b>Data / Parameter:</b>	$GEN_{j,2004}$
Data unit:	MWh/year
Description:	Electricity delivered to the grid by source $j$ at 2004
Source of data used:	ONS
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Dispatch data.
Any comment:	

<b>Data / Parameter:</b>	$GEN_{j,2005}$
Data unit:	MWh/year
Description:	Electricity delivered to the grid by source $j$ at 2005
Source of data used:	ONS
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Dispatch data.
Any comment:	

CDM – Executive Board

<b>Data / Parameter:</b>	$GEN_{k,2003}$
Data unit:	MWh/year
Description:	Electricity delivered to the grid by source $k$ at 2003
Source of data used:	ONS
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Dispatch data.
Any comment:	

<b>Data / Parameter:</b>	$GEN_{k,2004}$
Data unit:	MWh/year
Description:	Electricity delivered to the grid by source $k$ at 2004
Source of data used:	ONS
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Dispatch data.
Any comment:	

<b>Data / Parameter:</b>	$GEN_{k,2005}$
Data unit:	MWh/year
Description:	Electricity delivered to the grid by source $k$ at 2005
Source of data used:	ONS
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Dispatch data.
Any comment:	

## CDM – Executive Board

<b>Data / Parameter:</b>	$\eta_{i, OM}$
Data unit:	Dimensionless
Description:	Fossil fuel conversion efficiency for the source $i$ to calculate EF_OM
Source of data used:	IPCC
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Conservative values were used as recommend by the Executive Board.
Any comment:	

<b>Data / Parameter:</b>	$\eta_{i, BM}$
Data unit:	Dimensionless
Description:	Fossil fuel conversion efficiency for the source $i$ to calculate EF_BM
Source of data used:	IPCC, Eletrobrás and CIMGC
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Conservative values were used. Dispatched data was used where available.
Any comment:	The fossil fuel conversion efficiency based on national data, where available, was used to obtain a more conservative emission factor as recommended by the Executive Board.

<b>Data / Parameter:</b>	$EF_{C,i}$
Data unit:	Dimensionless
Description:	Carbon emission factor
Source of data used:	IPCC
Value applied:	See annex 3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Conservative values stated by IPCC were used.
Any comment:	

CDM – Executive Board

<b>Data / Parameter:</b>	-
Data unit:	Dimensionless
Description:	Carbon to carbon dioxide conversion factor
Source of data used:	IPCC
Value applied:	44/12
Justification of the choice of data or description of measurement methods and procedures actually applied :	Conversion factor stated by IPCC.
Any comment:	

<b>Data / Parameter:</b>	$\lambda_{2003}$
Data unit:	Dimensionless fraction
Description:	Lambda at 2003
Source of data used:	Calculated
Value applied:	0.531
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

<b>Data / Parameter:</b>	$\lambda_{2004}$
Data unit:	Dimensionless fraction
Description:	Lambda at 2003
Source of data used:	Calculated
Value applied:	0.506
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

## CDM – Executive Board

<b>Data / Parameter:</b>	$\lambda_{2005}$
Data unit:	Dimensionless fraction
Description:	Lambda at 2003
Source of data used:	Calculated
Value applied:	0.513
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

<b>Data / Parameter:</b>	$\lambda$
Data unit:	Dimensionless fraction
Description:	Average between Lambda 2003, 2004 and 2005
Source of data used:	Calculated
Value applied:	0.517
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

<b>Data / Parameter:</b>	$\omega_{OM}$
Data unit:	Dimensionless
Description:	Operating margin weight
Source of data used:	IPCC default value
Value applied:	0.5
Justification of the choice of data or description of measurement methods and procedures actually applied :	Default value for biomass power plants.
Any comment:	

CDM – Executive Board

<b>Data / Parameter:</b>	$\omega_{BM}$
Data unit:	Dimensionless
Description:	Build margin weight
Source of data used:	IPCC default value
Value applied:	0.5
Justification of the choice of data or description of measurement methods and procedures actually applied :	Default value for biomass power plants.
Any comment:	

<b>Data / Parameter:</b>	EF_OMy
Data unit:	tonnes CO <sub>2</sub> /MWh
Description:	Operating margin emission factor
Source of data used:	Calculated
Value applied:	0.404
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

<b>Data / Parameter:</b>	EF_BMy
Data unit:	tonnes CO <sub>2</sub> /MWh
Description:	Build margin emission factor
Source of data used:	Calculated
Value applied:	0.092
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

CDM – Executive Board

<b>Data / Parameter:</b>	EF <sub>y</sub>
Data unit:	tonnes CO <sub>2</sub> /MWh
Description:	Baseline emission factor
Source of data used:	Calculated
Value applied:	0.248
Justification of the choice of data or description of measurement methods and procedures actually applied :	Calculated as described in ACM0002.
Any comment:	

**B.6.3 Ex-ante calculation of emission reductions:**

&gt;&gt;

**Category I.D.****Emission reductions**

Emission reduction by grid connected renewable electricity production during a given period equals:

$$ER_{ID} = BE_{el}$$

where,

ER<sub>ID</sub> = emission reduction due to grid connected renewable electricity production (tonnes CO<sub>2</sub>eq)

BE<sub>el</sub> = Baseline Emissions of electricity generation (tonnes CO<sub>2</sub>eq)

No formula is provided to quantify the emission reduction of electricity generation in the Baseline of category I.D. of appendix B. In words it is described that:

*Baseline emissions*

(...) the baseline is the kWh produced by the renewable generating unit multiplied by an emission coefficient (measured in kg CO<sub>2</sub>eq/kWh) calculated in a transparent and conservative manner as:

(a) A combined margin (CM), consisting of the combination of operating margin (OM) and build margin (BM) according to the procedures prescribed in the approved methodology ACM0002. Any of the four procedures to calculate the operating margin can be chosen, but the restrictions to use the Simple OM and the Average OM calculations must be considered

OR

(b) The weighted average emissions (in kg CO<sub>2</sub>eq/kWh) of the current generation mix. The data of the year in which project generation occurs must be used.

**The baseline emissions (BE<sub>y</sub>)** resulting from the electricity supplied and/or not consumed from the grid is calculated as follows, where EG<sub>y</sub> is the annual net electricity generated from the Project.

$$BE_y = EG_y * EF_y$$

The baseline emissions factor ( $EF_y$ ) is a weighted average of the  $EF_{OMy}$  and  $EF_{BMy}$ :

$$EF_y = (\omega_{OM} * EF_{OMy}) + (\omega_{BM} * EF_{BMy})$$

where the weights  $\omega_{OM}$  and  $\omega_{BM}$  are by default 0.5.

The Operating Margin emission factor ( $EF_{OMy}$ ) is calculated according to the procedures prescribed in the approved methodology ACM0002 – option (b):

Simple Adjusted OM:

$$EF_{OM, \text{simple\_adjusted}, y} = (1 - \lambda_y) \cdot \frac{\sum_j F_{i,j,y} \cdot COEF_{i,j}}{\sum_j GEN_{j,y}} + \lambda_y \cdot \frac{\sum_k F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}}$$

Where:

$k$	low-cost/must-run power sources;
$j$	power sources delivering electricity to the grid, not including low-operating cost and must-run power plants, and including imports to the grid;
$F_{i,j,y}$	is the amount of fuel $i$ (in a mass or volume unit) consumed by relevant power sources $j$ in year(s) $y$ ;
$F_{i,k,y}$	is the amount of fuel $i$ (in a mass or volume unit) consumed by relevant power sources $k$ in year(s) $y$ ;
$COEF_{i,j,y}$	is the CO <sub>2</sub> emission coefficient of fuel $i$ (tCO <sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources $j$ and the percent oxidation of the fuel in year(s) $y$ ;
$COEF_{i,k,y}$	is the CO <sub>2</sub> emission coefficient of fuel $i$ (tCO <sub>2</sub> / mass or volume unit of the fuel), taking into account the carbon content of the fuels used by relevant power sources $k$ and the percent oxidation of the fuel in year(s) $y$ ;
$GEN_{j,y}$	is the electricity (MWh) delivered to the grid by source $j$ .
$GEN_{k,y}$	is the electricity (MWh) delivered to the grid by source $k$ .

$$\lambda_y = \frac{\text{"number of hours per year for which low - cost / must - run sources are on margin"}}{\text{"8760 hours per year"}}$$

Lambda ( $\lambda_y$ ) should be calculated as follows:

Step i) Plot a Load Duration Curve. Collect chronological load data (typically in MW) for each hour of a year, and sort load data from highest to lowest MW level. Plot MW against 8760 hours in the year, in descending order.

Step ii) Organize Data by Generating Sources. Collect data for, and calculate total annual generation (in MWh) from low-cost/must-run resources (i.e.  $\sum_k GEN_{k,y}$ ).

## CDM – Executive Board

Step iii) Fill Load Duration Curve. Plot a horizontal line across load duration curve such that the area under the curve (MW times hours) equals the total generation (in MWh) from lowcost/must-run resources (i.e.  $\sum k GEN_{k,y}$ ).

Step iv) Determine the "Number of hours per year for which low-cost/must-run sources are on the margin". First, locate the intersection of the horizontal line plotted in step (iii) and the load duration curve plotted in step (i). The number of hours (out of the total of 8760 hours) to the right of the intersection is the number of hours for which low-cost/must-run sources are on the margin. If the lines do not intersect, then one may conclude that lowcost/must-run sources do not appear on the margin and  $\lambda_y$  is equal to zero. Lambda ( $\lambda_y$ ) is the calculated number of hours divided by 8760.

The CO<sub>2</sub> emission coefficient  $COEF_i$  is obtained as:

$$COEF_i = NCV_i \cdot EF_{CO_2,i} \cdot OXID_i$$

where:

$NCV_i$  is the net calorific value (energy content) per mass or volume unit of a fuel  $i$ ;  
 $OXID_i$  is the oxidation factor of the fuel (see page 1.29 in the 1996 Revised IPCC Guidelines for default values);  
 $EF_{CO_2,i}$  is the CO<sub>2</sub> emission factor per unit of energy of the fuel  $i$ .

Where available, local values of  $NCV_i$  and  $EF_{CO_2,i}$  should be used. If no such values are available, country-specific values (see e.g. IPCC Good Practice Guidance) are preferable to IPCC world-wide default values.

The *Simple Adjusted OM* was calculated using the following data vintage:

(*Ex-ante*) the full generation-weighted average for the most recent 3 years for which data are available at the time of PDD submission

**The Build Margin emission factor** ( $EF_{BM,y}$ ) is the weighted average emission factor of a sample of power plants  $m$ :

$$EF_{BM,y}(tCO_2 / MWh) = \frac{\left[ \sum_{i,m} F_{i,m,y} * COEF_{i,m} \right]}{\left[ \sum_m GEN_{m,y} \right]}$$

where  $F_{i,m,y}$ ,  $COEF_{i,m}$  and  $GEN_m$  are analogous to the *OM* calculation above.

The option 1 was selected to calculate the Build Margin emission factor:

*Ex-ante* based on the most recent information available on plants already built for sample group  $m$  at the time of PDD submission. The sample group  $m$  consists of either the five power plants that have been built most recently, or the power plant capacity additions in the electricity system that comprise 20% of the system generation (in MWh) and that have been built most recently. Project participants should use from these two options that sample group that comprises the larger annual generation.

---

CDM – Executive Board

### Additional Formulae

$$F_{i,y} = GEN_{j,y} / (\eta_i \cdot NCV_i)$$

where:

$GEN_{j,y}$  is the electricity (MWh) delivered to the grid by source  $i$

$\eta_i$  is the fossil fuel conversion efficiency for the source  $i$

$NCV_i$  is the net calorific value (energy content) per mass or volume unit of a fuel  $i$

As recommended by the Executive Board, the fossil fuel conversion efficiency provided by national sources, where available, was used to calculate the Build Margin parameters once it provides a more conservative emission factor.

$$EF_{CO2,I} = EF_{C,i} * 44/12$$

where:

$EF_{C,i}$  is the carbon emission factor

44/12 is the carbon to carbon dioxide conversion factor

### Assumption

The evaluation of the Operating Margin emission factor was conducted in a conservative way using the following consideration:

$$COEF_k = 0 \quad \therefore$$

$$\frac{\sum_{(i,k)} F_{i,k,y} \cdot COEF_{i,k}}{\sum_k GEN_{k,y}} = 0$$

### Project emissions

The project emissions are negligible.

### Leakage

No leakage calculation is required, as the renewable energy technology used is not equipment transferred from another activity.

CDM – Executive Board

**B.6.4 Summary of the ex-ante estimation of emission reductions:**

&gt;&gt;

**Table 6: Emission reduction by grid connected renewable electricity generation**

Year	Estimation of project activity emissions (tCO <sub>2</sub> e)	Estimation of baseline emissions (tCO <sub>2</sub> e)	Estimation of leakage (tCO <sub>2</sub> e)	Estimation of overall emission reductions (tCO <sub>2</sub> e)
1 Dec - 31 Dec 2009	0	889	0	889
2010	0	10,664	0	10,664
2011	0	10,664	0	10,664
2012	0	10,664	0	10,664
2013	0	10,664	0	10,664
2014	0	10,664	0	10,664
2015	0	10,664	0	10,664
1 Jan - 30 Nov 2016	0	9,775	0	9,775
<b>Total</b> (tonnes of CO <sub>2</sub> e)	0	74,648	0	74,648

**B.7 Application of a monitoring methodology and description of the monitoring plan:****B.7.1 Data and parameters monitored:**

<b>Data / Parameter:</b>	EGy
Data unit:	MWh/year
Description:	Annual net electricity generated from the project activity
Source of data to be used:	Power plants supervisory system
Value of data	43,000
Description of measurement methods and procedures to be applied:	The electricity generated by the project activity will be continuously measured and integrated by the biomass power plant supervisory system. The electricity generated will be electronic registered in a monthly basis. For more details, please refer to section B.7.2.
QA/QC procedures to be applied:	The biomass power plant will be provided by two additional electricity measurement devices which will allows to check the output numbers consistency.
Any comment:	

**B.7.2 Description of the monitoring plan:**

&gt;&gt;

**ROLES AND RESPONSIBILITIES**

Joaquim Oliveira S.A. Participações (JOSAPAR), PTZ Bioenergy Ltda (fully and exclusively authorized to act on the behalf of JOSAPAR regarding this CDM project) and BioHeat International (exclusively authorized to sell the carbon credits from the JOSAPAR project) are all project participants.

## CDM – Executive Board

JOSAPAR operates the plant that is part of the project and will measure the required monitoring data related to the project and is qualified to do so.


PTZ is responsible for interpretation of the monitoring data, and leakage effects, preparation of the monitoring reports and quality assurance. PTZ will provide instructions and training to operators of JOSAPAR and operates as the Project Manager regarding monitoring.

BioHeat International serves as focal point for communication with the UNFCCC and is available as back office to support PTZ.

## MONITORING PROCEDURES

### Category I.D.

Figure 1 shows the location of the three electricity measurement systems (M1, M2 and M3) that will be placed at biomass power plant.

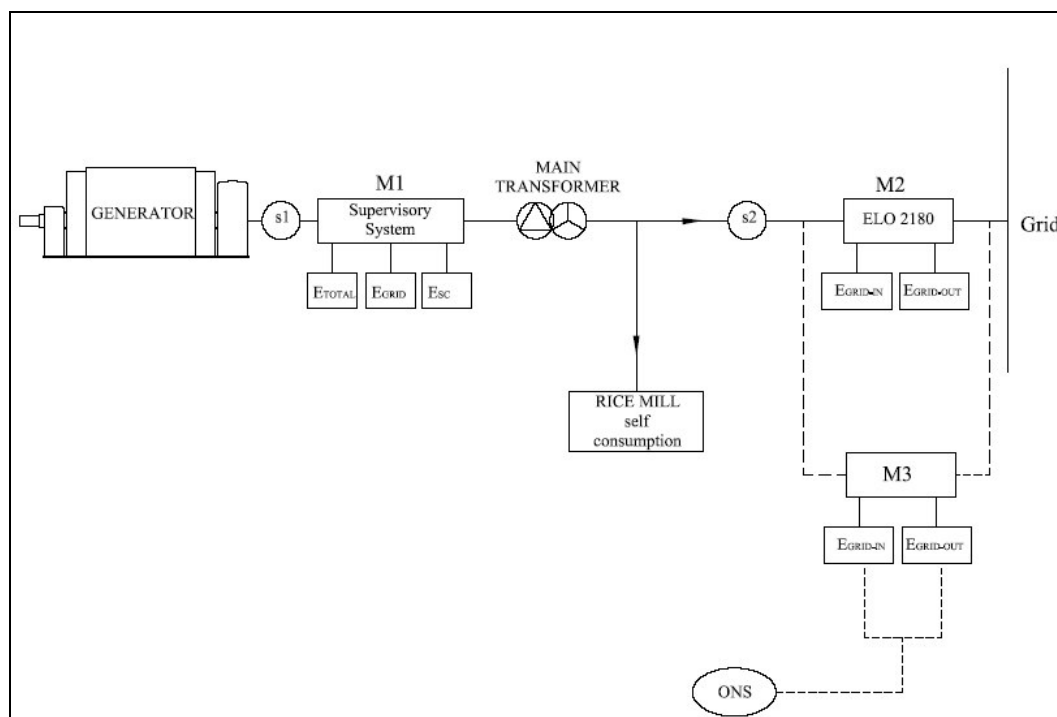

**Figure 1. Diagram of the electricity measurement systems**

### M1

The first electricity measurement system (M1) is located right at the exit of the generator and constantly records the gross ( $E_{TOTAL}$ ) and grid ( $E_{GRID}$ ) electricity generated. It has two sensors, one placed just after the generator (**s1**) and one placed just before the grid (**s2**). By determination the difference between  $E_{TOTAL}$  and  $E_{GRID}$ , the electricity provided for JOSAPAR self-consumption ( $E_{SC}$ ) is obtained.  $E_{TOTAL}$  is the displaced electricity and equals  $EG_v$  (Electricity production by the project activity). The other parameters

---

CDM – Executive Board

are used for quality control and quality assurance. The gross electricity generated is continuously integrated and registered in a monthly basis.

**M2**

The second electricity measure system (M2) registers the electricity exported ( $E_{\text{GRID-OUT}}$ ) to and imported ( $E_{\text{GRID-IN}}$ ) from the grid. This device is identified as ELO 2180 and is actually installed at the measurement cabin. The information generated by M2 is monthly read by the electricity concessionaire, which is responsible to submit the electricity bills. The electrical grid company owns the system.

**M3**

The third electricity measure system (M3) will measure the same data as M2. However, unlike M2, the measured values will be uploaded in real time through internet to ONS, the Brazilian national authority responsible to collect the data about electricity generation/consumption in the country.

**COMMUNICATION**

The project manager will instruct the project owner in how to collect the monitoring data. For this purpose a Monitoring Protocol will be established.

- The monitoring protocol (MP) consists of a (1) data registration form and (2) detailed instructions on the monitoring procedures. The data registration form is used by the monitoring personnel of the project owner to report all project information needed to calculate the avoided greenhouse emissions and other relevant project information to the project manager on a yearly base.
- The project owner can contact the project manager by telephone, email or fax for additional information on the MP.
- The project owner sends the monitoring protocol with monitoring data back to the project manager, covering monitoring data on the previous calendar year.
- Every year the project manager will evaluate the MP. If necessary, the MP will be updated as to reflect:
  - (1) changes as indicated in the verification report of the previous verification;
  - (2) changes initiated by the project manager as to improve data collection quality and communication toward the project owners.

The project manager sends the updated MP as soon as possible to the project owners.
- Beside information supply through the data registration form, which is submitted on a yearly base, the project owner will inform the project manager within two weeks in case:
  - (1) technical problems occur with the installation that could lead to substantial lower electricity production or methane reduction than foreseen.
  - (2) problems occur that could endanger the monitoring data collection (broken measurement equipment, problems with data registration form, etc).
  - (3) the project owner introduces a new contact person for the communication with the project manager.
- In case the project owner introduces a new contact person, the project manager will contact the new contact person and take care that he or she is fully informed about the monitoring procedures. In addition the project manager will advise on the need for training (data collection, processing, and interpretation, knowledge of measurement equipment).
- In case problems occur that could endanger proper monitoring, the troubleshooting procedures will be applied.

## DATA PROCESSING & QUALITY MANAGEMENT

The procedures below are related to the activities of the project manager. Detailed instructions on data collection and processing for the project owner is formulated in the Monitoring Protocol.

- The project manager stores and keeps the contracts, filled in data sheets and additional documentation (for instance confidentially agreements with project owners) in an orderly way, organised either by document type or by subproject.
- The project manager keeps all paper and electronic documents at a safe place during the CDM-project period, and longer if so required according to CDM-regulations.
- The monitoring data collected from the project owners is processed in the following way:
  1. Data is checked on completeness. If the data is not complete, the project manager contacts the project owner by phone, email or fax to ask for additional information.
  2. Data is checked on calculation errors. If calculation errors occur, the project owner is contacted by phone, email or fax and asked for clarification, and if necessary additional explanation is given. This type of errors is noted, and taken into account in the evaluation of the MP.
  3. If uncertainty exists on the monitoring data, a conservative approach will be applied in the interpretation of this data.
  4. Data is entered into the central database, an excel sheet that contains all necessary calculation rules and procedures.
  5. Consistency checks are carried out. If significant inconsistencies are observed, the project owner is asked for clarification. The project owner and project manager will jointly formulate a plausible explanation for the inconsistencies. If this approach does not work, the trouble shooting procedures will be followed.
  6. The calculated emission reductions and other relevant information are reported in the monitoring report and offered to the verification body.
- The project manager carries out corrective actions as stated in validation and/or verification reports, and/or otherwise as requested by the DOE. If appropriate, the project manager takes care that the project owner implements the corrective actions. The results of corrective actions will be described in the monitoring report of the subsequent period, or will be immediately send to the DOE, depending on its urgency.
- The project manager prepares the concept monitoring report and internally checks the report on completeness and quality of data. The concept monitoring report is sent to the project advisor. The project advisor checks the concept monitoring report and the calculations and returns open questions to the project manager. After both project manager and project advisor are fully satisfied with the content of the final monitoring report, the external verification institute (DOE) is requested to verify the monitoring report.

## TROUBLESHOOTING

If problems occur related to the monitoring of the project performance, for instance data collection, measurement equipment, the data registration form, etc. The project manager will execute the following actions if problems are directly related to the monitoring of projects:

- (1) The project manager will try to explain and indicate solutions for problems by phone, email or fax.

## CDM – Executive Board

- (2) If necessary and if it is contributing to the solution of the problem, the project manager will pay a visit to the project site, or the project owner will visit the office of the project manager.
- (3) In case of problems that cannot be easily solved, the project manager will contact the project advisor. They will jointly formulate an approach to solve the problem.
- (4) All disputes that might arise from the contract between Bioheat International B.V. and the project owner will be settled as described in the contract between Bioheat International B.V. and the project owners.

**B.8 Date of completion of the application of the baseline and monitoring methodology and the name of the responsible person(s)/entity(ies)**

&gt;&gt;

Date of completion

16/07/2007

Name of person/entity determining the baseline and monitoring methodology:

- Ricardo Pretz and Diego Silveira from PTZ Bioenergy Fontes Alternativas de Energia Indústria, Comércio e Serviços Ltda. and;
- Martijn Vis from BTG biomass technology group B.V.

Contact details are listed in Annex 1.

CDM – Executive Board

**SECTION C. Duration of the project activity / crediting period****C.1 Duration of the project activity:****C.1.1. Starting date of the project activity:**

&gt;&gt;

01/05/2008

**C.1.2. Expected operational lifetime of the project activity:**

&gt;&gt;

30 years

**C.2 Choice of the crediting period and related information:****C.2.1. Renewable crediting period****C.2.1.1. Starting date of the first crediting period:**

&gt;&gt;

01/12/2009

**C.2.1.2. Length of the first crediting period:**

&gt;&gt;

7 years, 0 months

**C.2.2. Fixed crediting period:****C.2.2.1. Starting date:**

&gt;&gt;

**C.2.2.2. Length:**

&gt;&gt;

CDM – Executive Board

**SECTION D. Environmental impacts**

&gt;&gt;

**D.1. If required by the host Party, documentation on the analysis of the environmental impacts of the project activity:**

&gt;&gt;

The renewable energy plant has received permit for construction from ANEEL, the National Electricity Energy Agency (License ANEEL n°123, published in the Brazilian Official Diary, n° 45 section 1, 7<sup>th</sup> March 2002)

The environmental permit for operation from the Environmental Agency of Rio Grande do Sul State (FEPAM – Fundação Estadual de Proteção Ambiental) has the number 4361, and it was issued on 6<sup>th</sup> April 2004, and is valid until 6<sup>th</sup> April 2006. The JOSAPAR rice mil is accomplished to local environmental license, in such a way, it has authorization for operation according the law.

**Renewable electricity generation**

The project will contribute to displace more carbon-intensive electricity generation sources from the South-Southeast-Midwest grid, promoting the use of renewable fuels (biomass) for electricity generation.

**D.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:**

&gt;&gt;

Environmental impacts are not significant.

**SECTION E. Stakeholders' comments**

&gt;&gt;

**E.1. Brief description how comments by local stakeholders have been invited and compiled:**

&gt;&gt;

According to the Resolution n° 1 dated on 2<sup>nd</sup> December 2003, from the Brazilian Inter-Ministerial Commission of Climate Change - CIMGC, decreed on 7<sup>th</sup> July 1999, any CDM projects must send a letter with description of the project and an invitation for comments by local stakeholders. In this case, letters were sent to the following local stakeholders:

- City Hall of Pelotas;
- Chamber of Pelotas;
- Environment agencies from the state and Local Authority;
- Brazilian Forum of NGOs;
- District Attorney (known in Portuguese as Ministério Público, i.e. the permanent institution essential for legal functions responsible for defending the legal order, democracy and social/individual interests) and;

## CDM – Executive Board

- Local communities associations.

Local stakeholders were invited to raise their concerns and provide comments on the project activity for a period of 30 days after receiving the letter of invitation. PTZ Bioenergy Fontes Alternativas de Energia Indústria, Comércio e Serviços Ltda. and the project developer addressed questions raised by stakeholders during this period.

**E.2. Summary of the comments received:**

&gt;&gt;

Brazilian Forum of NGOs

**E.3. Report on how due account was taken of any comments received:**

&gt;&gt;

The Brazilian Forum of NGOs suggests the “Gold Standard” methodology as more accurate criteria to evaluate the sustainability impacts of the project implementation.

CDM – Executive Board

**Annex 1****CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY****Project participants**

Organization:	JOSAPAR – Joaquim Oliveira S.A. Participações
Street/P.O.Box:	BR 116, km 512
Building:	
City:	Pelotas
State/Region:	Rio Grande do Sul
Postfix/ZIP:	96100-00
Country:	Brazil
Telephone:	++ 55 51 3284 1000
FAX:	++ 55 51 3284 1100
E-Mail:	carlosv@josapar.com.br
URL:	http://www.jospar.com.br
Represented by:	
Title:	Mr.
Salutation:	
Last Name:	Vianna
Middle Name:	Soares
First Name:	Carlos
Department:	Industrial Management
Mobile:	
Direct FAX:	
Direct tel:	
Personal E-Mail:	carlosv@josapar.com.br

## CDM – Executive Board

Organization:	PTZ Bioenergy Fontes Alternativas de Energia Indústria, Comércio e Serviços Ltda.
Street/P.O.Box:	Av. Loureiro da Silva
Building:	2001,Cj. 424
City:	Porto Alegre
State/Region:	Rio Grande do Sul
Postfix/ZIP:	90050-240
Country:	Brazil
Telephone:	+55 51 3028 7858
FAX:	+55 51 3028 7857
E-Mail:	<a href="mailto:ptz@ptz.com.br">ptz@ptz.com.br</a>
URL:	<a href="http://www.ptz.com.br">www.ptz.com.br</a>
Represented by:	
Title:	Director
Salutation:	Mr.
Last Name:	Pretz
Middle Name:	
First Name:	Ricardo
Department:	
Mobile:	+55 51 9974 5486
Direct FAX:	
Direct tel:	
Personal E-Mail:	

Organization:	BioHeat International B.V.
Street/P.O.Box:	Colosseum
Building:	11
City:	Enschede
State/Region:	
Postfix/ZIP:	7521 PV
Country:	The Netherlands
Telephone:	+31 53 486 1186
FAX:	+31 53 486 1180
E-Mail:	<a href="mailto:office@bioheat-international.com">office@bioheat-international.com</a>
URL:	<a href="http://www.bioheat-international.com/">http://www.bioheat-international.com/</a>
Represented by:	
Title:	Director
Salutation:	Mr.
Last Name:	Venendaal
Middle Name:	
First Name:	René
Department:	
Mobile:	
Direct FAX:	
Direct tel:	
Personal E-Mail:	

---

CDM – Executive Board

**Annex 2**

**INFORMATION REGARDING PUBLIC FUNDING**

This project will not receive any public funds.

**Annex 3****BASELINE INFORMATION****Summary Table**Ex-ante estimation

Year	2003	2004	2005	Average
Electricity generated (MWh)	303,759,363	307,901,911	324,700,347	<b>312,120,540</b>
Electricity generated excluding low cost/must-run power sources (MWh)	14,262,645	18,157,904	17,842,905	<b>16,754,485</b>
Emissions (tCO <sub>2</sub> )	12,086,653	14,922,077	14,919,154	<b>13,975,961</b>
$\lambda$	0.531	0.506	0.513	<b>0.517</b>
EF_OM (tCO <sub>2</sub> /MWh)	0.397	0.406	0.407	<b>0.404</b>
20% of Total generated (MWh)	60,751,873	61,580,382	64,940,069	<b>62,424,108</b>
Total generated by the last 5 plants built (MWh)	1,177,754	2,605,422	777,845	<b>1,520,340</b>
EF_BM (tCO <sub>2</sub> /MWh)	0.077	0.102	0.097	<b>0.092</b>
w_OM	0.5	0.5	0.5	<b>0.5</b>
w_BM	0.5	0.5	0.5	<b>0.5</b>
EF (tCO <sub>2</sub> /MWh)	0.237	0.254	0.252	<b>0.248</b>

**Biomass and electricity aspects in the JOSAPAR Pelotas Biomass Electricity Generation Project**

Year	Electricity generated/year (MWh)	Amount of rice husks produced (kg/year)	Amount of rice husks consumed (kg/year)	Amount of rice husks sold to third parties (kg/year)	% Consumed
2008	-	6,540,000	38,715,000	32,175,000	16.9%
2009	3,583	4,927,083	59,125,000	54,197,917	8%
2010	43,000	59,125,000	59,125,000	0	100%
2011	43,000	59,125,000	59,125,000	0	100%
2012	43,000	59,125,000	59,125,000	0	100%
2013	43,000	59,125,000	59,125,000	0	100%
2014	43,000	59,125,000	59,125,000	0	100%
2015	43,000	59,125,000	59,125,000	0	100%
2016	43,000	59,125,000	59,125,000	0	100%
2017	43,000	59,125,000	59,125,000	0	100%
2018	43,000	59,125,000	59,125,000	0	100%
2019	43,000	59,125,000	59,125,000	0	100%
2020	43,000	59,125,000	59,125,000	0	100%

CDM – Executive Board

## BASELINE INFORMATION

The grid factor calculation was conducted with the following databases:

- Efficiency for thermal power plants:

Thermal Power Plant	Efficiency calculation sources
<b>Jorge Lacerda A</b>	Eletrobrás <sup>1</sup> and CIMGC <sup>2</sup>
<b>Jorge Lacerda B</b>	Eletrobrás and CIMGC
<b>Jorge Lacerda C</b>	Eletrobrás and CIMC
<b>Charqueadas</b>	Eletrobrás and CIMGC
<b>P. Medice A</b>	Eletrobrás and CIMGC
<b>P. Medice B</b>	Eletrobrás and CIMGC
<b>P. Medice (A+B)</b>	Eletrobrás and CIMGC
<b>São Jeronimo</b>	Eletrobrás and CIMGC
<b>Figueira</b>	Eletrobrás and CIMGC
<b>Santa Cruz</b>	Eletrobrás and CIMGC
<b>Igarapé</b>	Eletrobrás and CIMGC
<b>Piratininga</b>	Eletrobrás and CIMGC
<b>Nova Piratininga</b>	Eletrobrás and CIMGC

For the other efficiency inputs the Executive Board recommended values were used just for the Build Margin calculation. For the Operating Margin the values adopted were the average as described in the OECD information paper (Bosi, 2002)<sup>3</sup>.

- Electricity Generated at 2003, 2004, 2005:

National Operator from the Electricity System: [www.ons.org.br](http://www.ons.org.br)

<sup>1</sup> Eletrobrás – [http://www.eletrobras.gov.br/EM\\_atuacao\\_ccc/default.asp](http://www.eletrobras.gov.br/EM_atuacao_ccc/default.asp)

<sup>2</sup> Comissão Interministerial de Mudança Global do Clima – CIMGC; Análise sobre o Setor Energético na Região Sul: [www.mct.gov.br/clima/comunic\\_old/energi41.htm#index](http://www.mct.gov.br/clima/comunic_old/energi41.htm#index)

<sup>3</sup> Bosi, M., A. Laurence, P. Maldonado, R. Schaeffer, A.F. Simoes, H. Winkler and J.M. Lukamba. Road testing baselines for GHG mitigation projects in the electric power sector. OECD/IEA information paper, October 2002.

## CDM – Executive Board

ONS Dispatched Data

Year: 2003

GRID	Fuel Source <sup>1</sup>	Power Plant <sup>1</sup>	Start date	GEN <sup>2</sup> MWh/year	Fossil Fuel Conversion Efficiency <sup>3</sup>	BM Fossil Fuel Conversion Efficiency <sup>3</sup>	NCV <sup>4</sup> TJ/kt	F <sub>ij</sub> -OM t/year	F <sub>ij</sub> -BM t/year	OXID <sup>5</sup>	Carbon Emission Factor <sup>6</sup> tCO <sub>2</sub> /tJ	EF <sub>CO2</sub> tCO <sub>2</sub> /tJ	COEF <sub>ij</sub> tCO <sub>2</sub> /t	F <sub>ij</sub> -OM tCO <sub>2</sub> /year	F <sub>ij</sub> -BM tCO <sub>2</sub> /year
SE-CO	H	Jatun	Sep-2003	78,921	1	1	0	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Gauporé	Sep-2003	86,201	1	1	0	0	0	0.0%	0.0	0	0	0	0
SE-CO	G	Três Lagoas	Aug-2003	233,793	0.32	0.32	48.00	54,795	54,795	99.5%	15.3	56.10	2.68	146,815	146,815
SE-CO	H	Furni (MG)	Jan/03	370,111	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Itaipu I	Sep-2002	406,728	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
S	G	Araucária	Sep-2002	22	0.32	0.32	48.00	5	5	99.5%	15.3	56.10	2.68	14	14
S	G	Canas	Sep-2002	182,256	0.32	0.32	48.00	42,716	42,716	99.5%	15.3	56.10	2.68	114,451	114,451
SE-CO	H	Piraju	Sep-2002	417,894	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	G	Nova Pratinha	Jun/02	47,847	0.2197	0.32	52.00	15,077	10,352	99.5%	15.3	56.10	2.90	43,764	30,046
S	O	PCT CGTEE	Jun/02	0	0.33	0.33	40.40	0	0	99.0%	20.7	75.90	3.04	0	0
SE-CO	H	Rosai	Jun/02	316,262	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	G	Itaité	May-2002	530,761	0.32	0.32	48.00	124,397	124,397	99.5%	15.3	56.10	2.68	333,302	333,302
SE-CO	H	Caná Brava	May-2002	2,200,434	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Sta. Clara	Jan/02	169,471	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Machadinho	Jan/02	3,436,304	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	G	Juiz de Fora	Nov/01	5,845	0.32	0.32	48.00	1,370	1,370	99.5%	15.3	56.10	2.68	3,670	3,670
SE-CO	G	Macaé Merchant	Nov/01	2,389,507	0.32	0.32	48.00	560,041	560,041	99.5%	15.3	56.10	2.68	1,500,537	1,500,537
SE-CO	H	Lajeado (ANEEL res. 402/2001)	Nov/01	4,457,790	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	G	Eletrobat	Oct-2001	242,364	0.32	0.32	48.00	56,804	56,804	99.5%	15.3	56.10	2.68	152,197	152,197
SE-CO	H	Porto Estrela	Sep-2001	410,136	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	G	Colaba (Mario Covas)	Aug-2001	2,228,109	0.32	0.32	48.00	522,213	522,213	99.5%	15.3	56.10	2.68	1,399,184	1,399,184
SE-CO	G	W. Arjona	Jan/01	549,729	0.32	0.32	48.00	128,843	128,843	99.5%	15.3	56.10	2.68	345,213	345,213
S	G	Uruguaiana	Jan/00	1,751,486	0.5	0.5	48.00	262,723	262,723	99.5%	15.3	56.10	2.68	703,923	703,923
S	H	S. Carlos	Jan/99	5,556,125	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Canas I	Jan/99	594,298	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Canas II	Jan/99	507,843	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Igarapava	Jan/99	1,140,260	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Porto Primavera	Jan/99	9,059,670	1	1	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	D	Colaba (Mario Covas)	Oct-1998	0	0.32	0.33	43.00	0	0	99.0%	20.2	74.07	3.15	0	0
SE-CO	H	Sobral	Sep-1998	341,073	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH EMAE	Jan/98	103,188	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	POCH CEE	Jan/98	240,724	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	POCH ENERSUL	Jan/98	119,405	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH CEB	Jan/98	76,857	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH ESCELSA	Jan/98	260,910	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	POCH GELESC	Jan/98	442,080	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH CEMAT	Jan/98	966,348	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH CELG	Jan/98	80,656	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH CERU	Jan/98	256,284	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	POCH COPEL	Jan/98	421,439	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH CEMIG	Jan/98	564,461	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH CPFL	Jan/98	328,332	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	S. Mesa	Jan/98	4,490,258	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	POCH EPAULO	Jan/98	0	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Gulmar Amorim	Jan/97	511,414	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Corumbá	Jan/97	1,604,930	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Miranda	Jan/97	1,778,457	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Novo Porte	Jan/94	2,208,901	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Sacreda (Gov. Nery Braga)	Jan/92	5,253,636	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Taquarucu	Jan/89	2,251,810	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Mangó	Jan/88	841,600	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	D. Francisco	Jan/87	895,131	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Itá	Jan/87	5,222,285	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Rosana	Jan/87	2,029,045	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	N	Angra	Jan/85	13,355,432	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	T. Imães	Jan/85	2,453,761	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Itaipu 60 Hz	Jan/83	46,309,279	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Itaipu 50 Hz	Jan/83	36,692,448	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Embarcação	Jan/82	3,628,062	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Nova Avanhandava	Jan/82	1,377,657	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Gov. Bento Munhoz - GBM	Jan/80	4,178,204	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	S. Santiago	Jan/80	6,124,508	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Iumbiara	Jan/80	7,342,183	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	O	Isarapé	Jan/78	33,791	0.2938	-	40.40	10,249	0	99%	20.7	75.90	3.04	31,112	0
S	H	Itauba	Jan/78	1,895,033	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	A. Vermelha (Jose E. Moraes)	Jan/78	7,280,135	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	S. Simão	Jan/78	10,850,060	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Capivara	Jan/77	3,527,028	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	S. Odório	Jan/75	4,305,490	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Marimbondo	Jan/75	6,614,912	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Promissão	Jan/75	958,520	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	C	Pres. Medici	Jan/74	1,306,186	0.2085	-	13.82	*****	0	98%	26	95.33	1.29	2,107,038	0
SE-CO	H	Volta Grande	Jan/74	1,892,826	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Porto Colombia	Jan/73	1,849,042	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Pesso Fundo	Jan/73	1,176,518	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Pesso Real	Jan/73	771,223	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Ilha Solteira	Jan/73	16,060,345	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SE-CO	H	Mascarenhas	Jan/73	777,134	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Gov. Parijat de Souza - GPS	Jan/71	1,001,495	1	-	0.00	0	0	0.0%	0.0	0	0	0	0

## CDM – Executive Board

SECO	H	Chavantes	Jan/71	2,026,711	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Jaguara	Jan/71	2,649,364	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Sã Carvalho	Apr-1970	302,343	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Estreito (Luiz Carlos Barreto)	Jan/69	3,084,368	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Itatinga	Jan/69	600,891	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Jupia	Jan/69	8,944,402	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	O	Alcorta	Jan/68	0	0.26	-	40.40	0	0	99%	20.7	75.90	3.04	0	0
SECO	G	Campos (Roberto Silveira)	Jan/68	0	0.24	-	48.00	0	0	99.5%	15.3	56.10	2.68	0	0
SECO	G	Santa Cruz (RJ)	Jan/68	540,073	0.3314	-	48.00	122,225	0	99.5%	15.3	56.10	2.68	327,483	0
SECO	H	Parabuna	Jan/68	265,809	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Limoeiro (Armando Sal es de Oliveira)	Jan/67	126,521	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Caconde	Jan/66	340,046	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	C	J Lacerda C	Jan/65	1,965,975	0.3395	-	18.84	#####	0	98%	26	95.33	1.76	1,967,467	0
S	C	J Lacerda B	Jan/65	1,126,809	0.2771	-	18.84	777,026	0	98%	26	95.33	1.76	1,367,688	0
S	C	J Lacerda A	Jan/65	583,250	0.2635	-	18.84	422,957	0	98%	26	95.33	1.76	744,470	0
SECO	H	Bariri (Alvaro de Souza Lima)	Jan/65	541,316	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Furil (RJ)	Jan/65	619,432	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	C	Faviera	Jan/63	54,554	0.166	-	23.86	49,585	0	98%	26	95.33	2.23	110,533	0
SECO	H	Furnas	Jan/63	4,499,554	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Barra Bonita	Jan/63	477,594	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	C	Charqueadas	Jan/62	136,595	0.2011	-	12.98	188,387	0	98%	26	95.33	1.21	228,453	0
SECO	H	Jurumirim (Armando A. Laydner)	Jan/62	439,132	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	H	Jacui	Jan/62	1,419,402	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Pereira Passos	Jan/62	326,708	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Tres Marias	Jan/62	1,818,886	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Eucledes da Cunha	Jan/60	419,565	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Camargos	Jan/60	157,100	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Santa Branca	Jan/60	134,029	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Cachoeira Dourada	Jan/59	2,959,147	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Salto Grande (Lucas N. Garcez)	Jan/58	427,192	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Salto Grande (MG)	Jan/56	513,869	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Mascarenhas de Moraes (Peixoto)	Jan/56	2,207,257	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Itatinga	Jan/55	210,152	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
S	C	S. Jerônimo	Jan/54	43,993	0.114	-	17.58	79,025	0	98%	26	95.33	1.64	129,793	0
SECO	O	Caribá	Jan/54	0	0.3	-	40.40	0	0	98%	20.7	75.90	3.01	0	0
SECO	O	Piratininga	Jan/54	289,700	0.2378	-	40.19	109,124	0	99%	20.7	75.90	3.02	329,546	0
S	H	Canastra	Jan/53	237,695	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Nilo Peçanha	Jan/53	2,386,456	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Fontes Nova	Jan/40	719,497	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Henry Borden Sub.	Jan/26	63,638	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Henry Borden Est.	Jan/26	448,291	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	I. Pombo	Jan/24	680,168	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
SECO	H	Jaguari	Jan/17	54,835	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
Importação Internacional	H	-	-	360,234	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
Exportação Internacional	H	-	-	0	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
Importação NNE	H	-	-	89,532	1	-	0.00	0	0	0.0%	0.0	0	0	0	0
Exportação NNE	H	-	-	7,632,626	1	-	0.00	0	0	0.0%	0.0	0	0	0	0

## CDM – Executive Board

Year: 2004

GRID	Fuel Source <sup>1</sup>	Power Plant <sup>1</sup>	Start date	GEN <sup>2</sup> MWh/year	Fossil Fuel Conversion Efficiency <sup>4</sup>	BM Fossil Fuel Conversion Efficiency <sup>5</sup>	NCV <sup>6</sup> TJ/kt	F <sub>CO2</sub> -OM t/year	F <sub>CO2</sub> -BM t/year	OMD	Carbon Emission Factor <sup>7</sup> tCO <sub>2</sub> /t	EF <sub>CO2</sub> <sup>8</sup> tCO <sub>2</sub> /t	COEF <sub>CO2</sub> <sup>9</sup> tCO <sub>2</sub> /t	F <sub>CO2</sub> -COEF <sub>CO2</sub> -OM tCO <sub>2</sub> /year	F <sub>CO2</sub> -COEF <sub>CO2</sub> -BM tCO <sub>2</sub> /year
SE-CO	G	TermoRio	Nov-2004	120,326	0.32	0.32	48.00	28,201	28,201	99.5%	15.3	56.10	2.68	75,561	75,561
SE-CO	H	Candonga	Sep-2004	129,327	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Queimado	May-2004	360,952	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Norte Fluminense	Feb-2004	1,507,181	0.32	0.32	48.00	353,246	353,246	99.5%	15.3	56.10	2.68	946,464	946,464
SE-CO	H	Jauru	Sep-2003	487,636	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Gaúcho	Sep-2003	335,127	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Três Lagoas	Aug-2003	1,419,067	0.32	0.32	48.00	332,594	332,594	99.5%	15.3	56.10	2.68	891,131	891,131
SE-CO	H	Furnil (MG)	Jan/03	667,597	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Itaipua I	Sep-2002	856,539	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	G	Araucária	Sep-2002	22	0.32	0.32	48.00	5	5	99.5%	15.3	56.10	2.68	14	14
S	G	Canas	Sep-2002	527,587	0.32	0.32	48.00	123,653	123,653	99.5%	15.3	56.10	2.68	331,308	331,308
SE-CO	H	Piraju	Sep-2002	466,775	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Nova Pratinha	Jun/02	13,820	0.2197	0.32	48.00	4,354	2,990	99.5%	15.3	56.10	2.90	12,638	8,679
S	O	PCT CGTEE	Jun/02	0	0.33	0.33	40.40	0	0.00	99.0%	20.7	79.90	3.04	0	0
SE-CO	H	Rosai	Jun/02	384,555	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Ibitaré	May-2002	1,245,228	0.32	0.32	48.00	291,850	291,850	99.5%	15.3	56.10	2.68	781,965	781,965
SE-CO	H	Caná Brava	May-2002	2,214,839	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	São Clara	Jan/02	345,880	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	Machadinho	Jan/02	4,337,016	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Juiz de Fora	Nov/01	66,002	0.32	0.32	48.00	15,469	15,469	99.5%	15.3	56.10	2.68	41,447	41,447
SE-CO	G	Masat Merchant	Nov/01	740,098	0.32	0.32	48.00	173,460	173,460	99.5%	15.3	56.10	2.68	464,759	464,759
SE-CO	H	Lajeado (ANIEEL res. 402/2001)	Nov/01	4,331,991	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Eletronil	Oct-2001	1,324,501	0.32	0.32	48.00	310,430	310,430	99.5%	15.3	56.10	2.68	831,746	831,746
SE-CO	H	Porto Estrela	Sep-2001	554,865	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	G	Culaba (Mario Covas)	Aug-2001	1,659,230	0.32	0.32	48.00	388,882	388,882	99.5%	15.3	56.10	2.68	1,041,946	1,041,946
SE-CO	G	W. Azoia	Jan/01	538,087	0.32	0.32	48.00	126,114	126,114	99.5%	15.3	56.10	2.68	337,902	337,902
S	G	Uruguiana	Jan/00	2,270,176	0.5	0.5	48.00	340,526	340,526	99.5%	15.3	56.10	2.68	912,385	912,385
S	H	S. Carlos	Jan/99	6,015,459	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Canas I	Jan/99	576,926	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Canas II	Jan/99	486,299	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Igarapava	Jan/99	1,090,945	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Porto Primavera	Jan/99	9,472,700	1	1	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	D	Culaba (Mario Covas)	Oct-1998	0	0.32	0.33	43.00	0	0.00	99.0%	20.2	74.07	3.15	0	0.0
SE-CO	H	Sobragi	Sep-1998	395,652	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH EMME	Jan/98	137,132	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	PCH CEEE	Jan/98	215,617	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	PCH ENERSUL	Jan/98	174,892	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH CEB	Jan/98	109,606	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH ESCALSA	Jan/98	353,471	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	PCH CELESC	Jan/98	468,240	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH CEMAT	Jan/98	1,353,714	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH CELG	Jan/98	73,309	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH CERJ	Jan/98	297,264	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	PCH COPEL	Jan/98	707,277	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH CEMIG	Jan/98	672,546	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH CPFL	Jan/98	458,822	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	S. Mesa	Jan/98	4,397,135	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	PCH EPAULO	Jan/98	0	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Guilhem Amorim	Jan/97	661,366	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Corumbá	Jan/97	2,163,267	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Miranda	Jan/97	1,069,831	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Nova Ponte	Jan/94	1,302,583	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	Segredo (Gov. Ney Braga)	Jan/92	5,897,593	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Taquarupú	Jan/89	2,022,042	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Manoá	Jan/88	732,036	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	D. Francisca	Jan/87	683,674	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	Itá	Jan/87	6,054,272	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Rosana	Jan/87	1,884,543	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	N	Arara	Jan/85	11,581,987	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	T. Imbós	Jan/85	2,058,733	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Itaipu 60 Hz	Jan/83	46,853,256	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Itaipu 50 Hz	Jan/83	36,935,776	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Emborcação	Jan/82	4,312,481	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Nova Avanhandava	Jan/82	1,406,957	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	Gov. Bento Munhoz - GBM	Jan/80	5,352,443	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	S. Santiago	Jan/80	6,886,744	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Itumbiara	Jan/80	7,854,963	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	O	Itaipu	Jan/78	19,989	0.2908	-	40.40	6,062	0.00	99%	20.7	79.90	3.04	18,406	0.0
S	H	Itaipu	Jan/78	1,233,332	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	A. Vermeilha (Jose E. Moraes)	Jan/78	6,520,363	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	S. Simão	Jan/78	12,205,751	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Capitão	Jan/77	3,302,087	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	S. Osório	Jan/75	484,648	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Marimbondo	Jan/75	6,349,261	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Promissão	Jan/75	1,048,625	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	G	Pres. Medici	Jan/74	1,492,153	0.2178	-	13.82	1,784,555	0.00	98%	26.0	95.33	1.29	2,304,140	0.0
SE-CO	H	Volta Grande	Jan/74	1,793,617	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Porto Colômbia	Jan/73	1,715,325	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	Passo Fundo	Jan/73	705,586	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
S	H	Passo Real	Jan/73	549,702	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Ilha Solteira	Jan/73	15,868,207	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0
SE-CO	H	Mascarenhas	Jan/73	786,612	1	-	0.00	0.00	0.00	0.0%	0.0	0.0	0.0	0.0	0.0

## CDM – Executive Board

S	H	Gov. Parigot de Souza - GPS	Jan/71	1.204.667	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Chavantes	Jan/71	1.935.377	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Jaguara	Jan/71	2.596.033	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Sã Carvalho	Abr-1970	464.819	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Estreito (Luiz Carlos Barreto)	Jan/69	2.948.054	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Itolima	Jan/69	712.124	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Jupia	Jan/69	8.780.288	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
S	O	Alegrete	Jan/68	0	0,26	-	40,40	0	0,00	99%	20,7	75,90	3,04	0	0,0
SE-CO	G	Campos (Roberto Silveira)	Jan/68	0	0,34	-	48,00	0	0,00	99,5%	15,3	56,10	2,68	0	0,0
SE-CO	G	Santa Cruz (RJ)	Jan/68	199.124	0,3349	-	48,00	44.661	0,00	99,5%	15,3	56,10	2,68	119.714	0,0
SE-CO	H	Paraisópolis	Jan/68	199.289	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Limeiro (Amarado Sal e de Oliveira)	Jan/67	165.483	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Caconde	Jan/66	280.607	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
S	C	J.Lacerda C	Jan/65	2.330.323	0,3400	-	18,84	1.309.745	0,00	98%	26,0	95,33	1,76	2.305.359	0,0
S	C	J.Lacerda B	Jan/65	1.304.788	0,2781	-	18,84	896.387	0,00	98%	26,0	95,33	1,76	1.577.783	0,0
S	C	J.Lacerda A	Jan/65	873.490	0,2663	-	18,84	626.692	0,00	98%	26,0	95,33	1,76	1.103.060	0,0
SE-CO	H	Bariri (Alvaro de Souza Lima)	Jan/65	638.646	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Fumil (RJ)	Jan/65	685.740	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
S	C	Figueira	Jan/63	73.448	0,1663	-	23,86	66.631	0,00	98%	26,0	95,33	2,23	148.530	0,0
SE-CO	H	Furnas	Jan/63	4.288.104	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Barra Bonita	Jan/63	567.300	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
S	C	Chapadadas	Jan/62	239.467	0,2016	-	12,98	329.387	0,00	98%	26,0	95,33	1,21	399.441	0,0
SE-CO	H	Jurumirim (Amarado A. Leydiari)	Jan/62	445.781	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
S	H	Jacui	Jan/62	1.178.249	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Pereira Passos	Jan/62	384.696	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Tres Marias	Jan/62	1.892.922	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Euclydes da Cunha	Jan/60	561.413	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Camargos	Jan/60	188.520	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Santa Branca	Jan/60	99.619	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Cachoeira Dourada	Jan/59	3.315.489	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Salto Grande (Lucas N. Garces)	Jan/58	484.648	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Salto Grande (MG)	Jan/56	579.580	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Mascarenhas de Moraes (Peicoto)	Jan/56	2.337.376	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Itulima	Jan/55	239.530	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
S	C	S. Jerônimo	Jan/54	30.845	0,1140	-	17,58	55.421	0,00	98%	26,0	95,33	1,64	91.026	0,0
SE-CO	O	Caribina	Jan/54	0	0,3	-	40,40	0	0,00	98%	20,7	75,90	3,01	0,0	0,0
SE-CO	O	Piratininga	Jan/54	162.952	0,2378	-	40,19	61.378	0,00	99%	20,7	75,90	3,02	185.352	0,0
S	H	Canastra	Jan/53	148.084	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Nilo Peçanha	Jan/53	2.689.893	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Fontes Nova	Jan/40	803.368	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Henry Borden Sub.	Jan/26	5.393	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Henry Borden Ext.	Jan/26	417.167	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	I. Pontões	Jan/24	881.028	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
SE-CO	H	Jaquari	Jan/17	35.455	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
Importação Internacional	H	-	-	189.647	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
Importação Internacional	H	-	-	1.180.606	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
Importação NNE	H	-	-	1.278.428	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0
Exportação NNE	H	-	-	3.830.322	1	-	0,00	0,00	0,00	0,0%	0,0	0,0	0,0	0,0	0,0

**Year: 2005**

GRID	Fuel Source	Power Plant 1	Start date	GEN <sup>2</sup>	Fossil Fuel Conversion Efficiency 1	BM Fossil Fuel Conversion Efficiency 2	NGV <sup>2</sup> TJ/kt	F <sub>UL</sub> OM t/year	F <sub>UL</sub> BM t/year	OXID	Carbon Emission Factor <sup>3</sup>		EF <sub>CO2</sub>	COEF <sub>FL</sub>	F <sub>UL</sub> /COEF <sub>FL</sub> OM		F <sub>UL</sub> */COEF <sub>FL</sub> BM	
				MWh/year							tCO <sub>2</sub> /TJ	tCO <sub>2</sub> /TJ			tCO <sub>2</sub> /t	tCO <sub>2</sub> /year	tCO <sub>2</sub> /year	
SE-CO	H	Quebra Queixo	Dec-2005	16,197	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Ouriños	Nov-2005	25,167	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Barra Grande	Nov-2005	248,690	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Miraflo	Oct-2005	48,329	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Ponte de Pedra	Aug-2005	439,462	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Almorós	Aug-2005	122,877	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Santa Clara PH	Aug-2005	321,818	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Monte Claro	Jan-2005	243,331	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	TermoRio	Nov-2004	1,150,380	0.32	0.32	48.0	269,620	269,620	99.5%	15.3	56.10	2.68	722,403	722,403	722,403	722,403	722,403
SE-CO	H	PCH CESP	Sep-2004	0	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Candonga	Sep-2004	565,935	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Queimado	May-2004	588,657	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Norte Fluminense	Feb-2004	3,035,646	0.32	0.32	48.0	852,105	852,105	99.5%	15.3	56.10	2.68	2,283,074	2,283,074	2,283,074	2,283,074	2,283,074
SE-CO	H	Jauru	Sep-2003	514,779	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Cauponé	Sep-2003	389,619	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Três Lagoas	Aug-2003	690,051	0.32	0.32	48.0	161,731	161,731	99.5%	15.3	56.10	2.68	433,331	433,331	433,331	433,331	433,331
SE-CO	H	Furnil (MG)	Jan/03	800,466	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Itaipira I	Sep-2002	1,104,190	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	G	Araucária	Sep-2002	0	0.32	0.32	48.0	0	0	99.5%	15.3	56.10	2.68	0	0	0	0	0
S	G	Canos	Sep-2002	927,537	0.32	0.32	48.0	217,391	217,391	99.5%	15.3	56.10	2.68	582,465	582,465	582,465	582,465	582,465
SE-CO	H	Praju	Sep-2002	446,366	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Nova Pratinha	Jun/02	231,010	0.2197	0.32	52.0	72,762	49,978	99.5%	15.3	56.10	2.20	211,259	145,087	145,087	145,087	145,087
S	O	PCT COTEE	Jun/02	0	0.33	0.33	40.4	0	0	99.0%	20.7	75.90	3.04	0	0	0	0	0
SE-CO	H	Rosal	Jun/02	421,691	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Ibitiré	May-2002	490,201	0.32	0.32	48.0	114,891	114,891	99.5%	15.3	56.10	2.68	307,831	307,831	307,831	307,831	307,831
SE-CO	H	Cana Brava	May-2002	2,316,683	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	São Clara	Jan/02	332,249	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	Machadinho	Jan/02	4,480,027	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Juiz de Fora	Nov/01	232,477	0.32	0.32	48.0	54,487	54,487	99.5%	15.3	56.10	2.68	145,988	145,988	145,988	145,988	145,988
SE-CO	G	Maceé Merchant	Nov/01	119,568	0.32	0.32	48.0	28,024	28,024	99.5%	15.3	56.10	2.68	75,085	75,085	75,085	75,085	75,085
SE-CO	H	Lajado (ANEEL res. 452/2001)	Nov/01	4,539,333	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Eletronil	Oct-2001	190,904	0.32	0.32	48.0	44,743	44,743	99.5%	15.3	56.10	2.68	119,882	119,882	119,882	119,882	119,882
SE-CO	H	Porto Estrela	Sep-2001	593,357	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	G	Cuiabá (Mário Covas)	Aug-2001	1,229,232	0.32	0.32	48.0	288,101	288,101	99.5%	15.3	56.10	2.68	771,920	771,920	771,920	771,920	771,920
SE-CO	G	W. Ajonja	Jan-01	728,835	0.32	0.32	48.0	170,821	170,821	99.5%	15.3	56.10	2.68	457,686	457,686	457,686	457,686	457,686
S	G	Uruguaiana	Jan/00	1,733,424	0.5	0.5	48.0	260,014	260,014	99.5%	15.3	56.10	2.68	696,664	696,664	696,664	696,664	696,664
S	H	S. Cavais	Jan/99	5,920,260	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Canos I	Jan/99	555,667	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Canos II	Jan/99	441,828	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Igarapava	Jan/99	1,297,196	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Porto Primavera	Jan/99	9,686,480	1	1	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Sobral	Sep-1998	385,988	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH EMAE	Jan/98	149,526	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	PCH CEEE	Jan/98	173,917	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	PCH ENERSUL	Jan/98	162,165	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH CEB	Jan/98	114,097	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH ESCALSA	Jan/98	500,563	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	PCH CELESC	Jan/98	481,799	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH CEMAT	Jan/98	1,515,887	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH CELG	Jan/98	72,592	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH CERJ	Jan/98	311,762	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	PCH COPEL	Jan/98	578,787	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH CEMIG	Jan/98	619,029	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH CPFL	Jan/98	461,440	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	S. Meia	Jan/98	4,731,322	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	PCH EPAULO	Jan/98	0	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Guilman Amorim	Jan/97	632,333	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Corumbá	Jan/97	1,923,111	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Miranda	Jan/97	1,480,071	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Nova Ponte	Jan/94	2,015,019	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	Segredo (Gov. Ney Braga)	Jan/92	5,587,794	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Taguaçu	Jan/89	2,032,597	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Manoel	Jan/88	616,312	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	D. Francisco	Jan/87	761,279	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
S	H	Ita	Jan/87	5,840,371	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Rosana	Jan/87	1,880,873	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	N	Angra	Jan/85	9,854,879	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	T. Irmao	Jan/85	2,030,080	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Itaipu 60 Hz	Jan/83	43,263,219	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Itaipu 50 Hz	Jan/83	38,437,460	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Emborcação	Jan/82	5,428,696	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.000
SE-CO	H	Nova Avanhandava	Jan/82	1,424,680	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.0	0.0	0.000			

## CDM – Executive Board

SE-CO	H	Promissão	jan/75	1,022,782	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	C	Pres. Medici	jan/74	1,699,573	0.2178	-	13.92	2,032,621	-	98%	26	95.33	1.29	2,624,433
SE-CO	H	Volta Grande	jan/74	2,181,749	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Porto Colombo	jun/73	1,955,931	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	H	Passo Fundo	jan/73	994,464	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	H	Passo Real	jan/73	671,226	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Ilha Solheira	jan/73	16,814,478	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Mascarenhas	jan/73	795,700	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	H	Gov. Parigot de Souza - GPS	jan/71	1,240,817	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Chavantes	jan/71	1,785,328	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Jaguara	jan/71	2,694,735	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Sã Carvalho	Apr-1970	478,444	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Estreito (Luiz Carlos Barreto)	jan/69	4,208,999	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Ibipanga	jan/69	688,094	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Jupia	jan/69	9,114,514	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	O	Alegrete	jan/68	0	0.26	-	40.4	0	-	99%	20.7	75.90	3.04	0
SE-CO	G	Campos (Roberto Silveira)	jan/68	0	0.24	-	48.0	0	-	99.5%	15.3	56.10	2.68	0
SE-CO	G	Santa Cruz (Ru)	jan/68	176,628	0.3042	-	48.0	39,633	-	99.5%	15.3	56.10	2.68	106,190
SE-CO	H	Parabuna	jan/68	272,422	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Juncoiro (Armando Sales de Oliveira)	jan/67	157,213	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Caçande	jan/66	400,542	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	C	J. Lacerda C	jan/65	2,012,313	0.3400	-	18.84	1,131,009	-	98%	26	95.33	1.76	1,990,755
S	C	J. Lacerda B	jan/65	1,188,746	0.2781	-	18.84	816,666	-	98%	26	95.33	1.76	1,437,462
S	C	J. Lacerda A	jan/65	877,032	0.2563	-	18.84	628,224	-	98%	26	95.33	1.76	1,107,533
SE-CO	H	Bariri (Alvaro de Souza Lima)	jan/65	603,788	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Puri (Ru)	jan/65	857,914	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	C	Figueira	jan/63	81,238	0.1663	-	23.85	73,698	-	98%	26	95.33	2.23	164,284
SE-CO	H	Furnas	jan/63	5,687,817	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Barra Bonita	jan/63	547,013	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	C	Charqueadas	jan/62	213,418	0.2016	-	12.98	203,557	-	98%	26	95.33	1.21	355,990
SE-CO	H	Jurumirim (Armando A. Laydner)	jan/62	454,698	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	H	Jacui	jan/62	1,174,695	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Pereira Passos	jan/62	397,305	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Tres Marias	jan/62	2,543,413	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Eucides da Cunha	jan/60	534,411	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Camargos	jan/60	200,117	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Santa Branca	jan/60	148,713	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Cachoeira Dourada	jan/59	3,604,388	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Salto Grande (Lucas N. Garcez)	jan/58	486,456	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Salto Grande (MG)	jan/56	632,393	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Mascarenhas de Moraes (Peixoto)	jan/56	2,781,338	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Itutinga	jan/55	251,290	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
S	C	S. Jerônimo	jan/54	33,587	0.1140	-	17.58	60,348	-	98%	26	95.33	1.64	99,117
SE-CO	O	Caroba	jan/54	0	0.3	-	40.4	0	-	98%	20.7	75.90	3.01	0
SE-CO	O	Pratânia	jan/54	187,501	0.2378	-	40.19	70,623	-	99%	20.7	75.90	3.02	213,275
S	H	Canastra	jan/53	213,576	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Nilo Peçanha	jan/53	2,818,325	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Fontes Nova	jan/40	748,752	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Henry Borden Sula	jan/28	199,758	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Henry Borden Est.	jan/28	551,061	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	I. Pombos	jan/24	874,875	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
SE-CO	H	Jaguari	jan/17	99,160	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
Importação Internacional	H	-	-	490,209	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
Exportação Internacional	H	-	-	820,561	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
Importação NNE	H	-	-	3,045,043	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000
Exportação NNE	H	-	-	4,789,574	1	-	0.0	0.0	0.0	0.0%	0.0	0.0	0.000	0.000

CDM – Executive Board

**Legend**

S: South	SE: Southeast
CO: Midwest	NNE: Northeast
C: Coal	D: Diesel
N: Natural Gas	O: Fuel oil
H: Hydro	N: Nuclear

**References**

- <sup>1</sup> Agência Nacional de Energia Elétrica - Banco de Informações de Geração ([www.aneel.gov.br](http://www.aneel.gov.br))
- <sup>2</sup> Operador Nacional do Sistema Elétrico - Dados Relevantes do Ano de 2005 ([www.ons.org.br](http://www.ons.org.br))
- <sup>3</sup> Diretrizes Revisadas do IPCC para Inventários Nacionais dos Gases do Efeito Estufa de 1996: Manual de Trabalho
- <sup>4</sup> Roadtesting Baselines for GHG mitigation Projects in the Electric Power Sector, October 2002
- <sup>5</sup> Executive Board recommended values
- <sup>6</sup> 2006 IPCC Guidelines for National Greenhouse Gas Inventories
- <sup>6</sup> Balanço Energético Nacional 2007 - Ministério de Minas e Energia: ([www.mme.gov.br](http://www.mme.gov.br))



**Assumption**


The evaluation of the Operating Margin emission factor was conducted in a conservative way using the following consideration:

$$\text{COEF}_k = 0 \quad \therefore$$

$$\frac{\sum_{(i,k)} F_{i,k,y} \cdot \text{COEF}_{i,k}}{\sum_k \text{GEN}_{k,y}} = 0$$

CDM – Executive Board

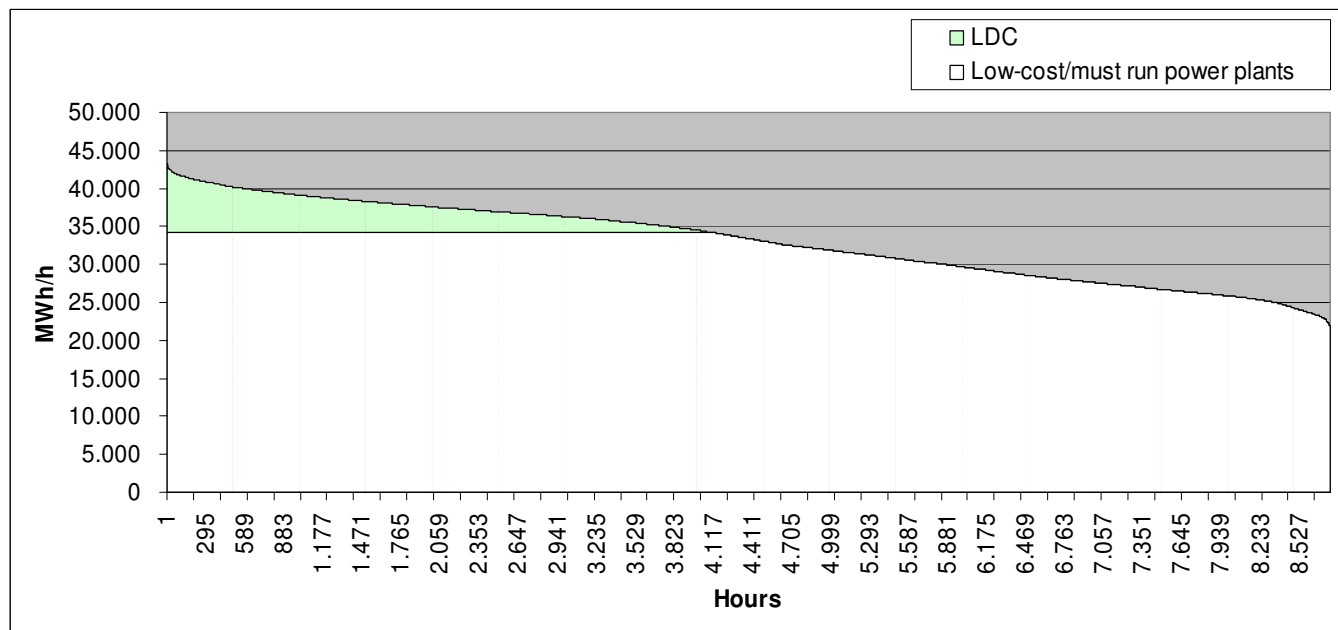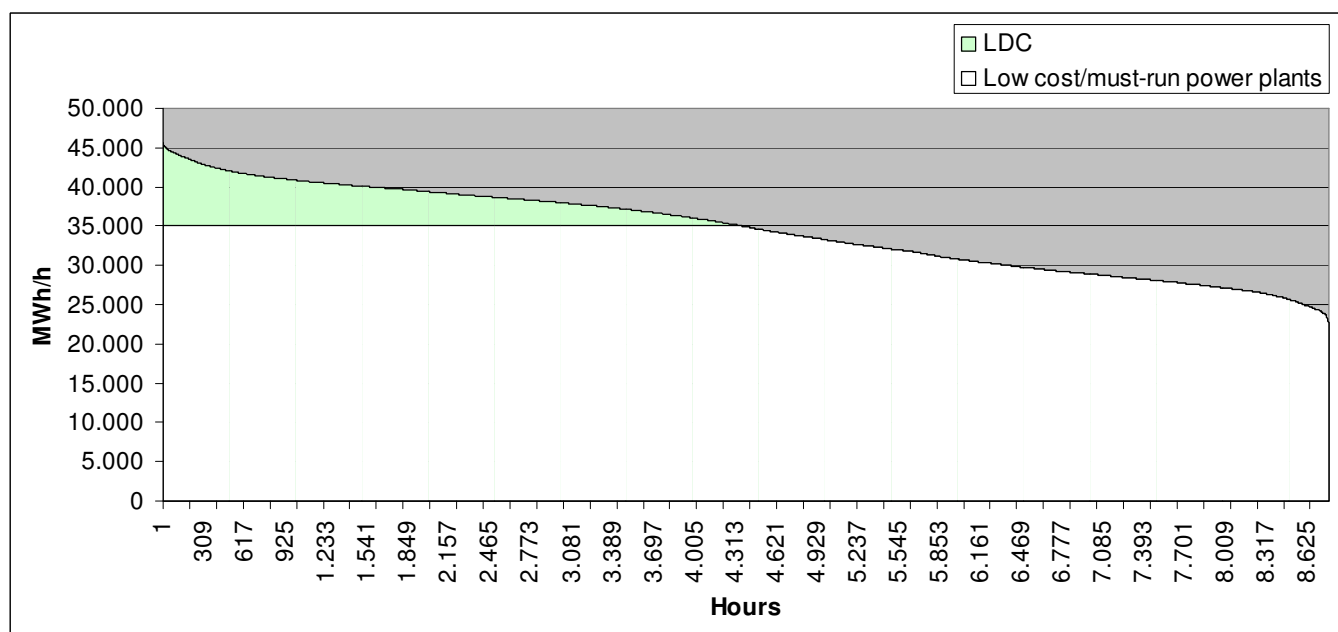**Load Duration Curve****Figure 1.** Load Duration Curve corresponding to the south-southeast-midwest Brazilian grid at 2003**Figure 2.** Load Duration Curve corresponding to the south-southeast-midwest Brazilian grid at 2004

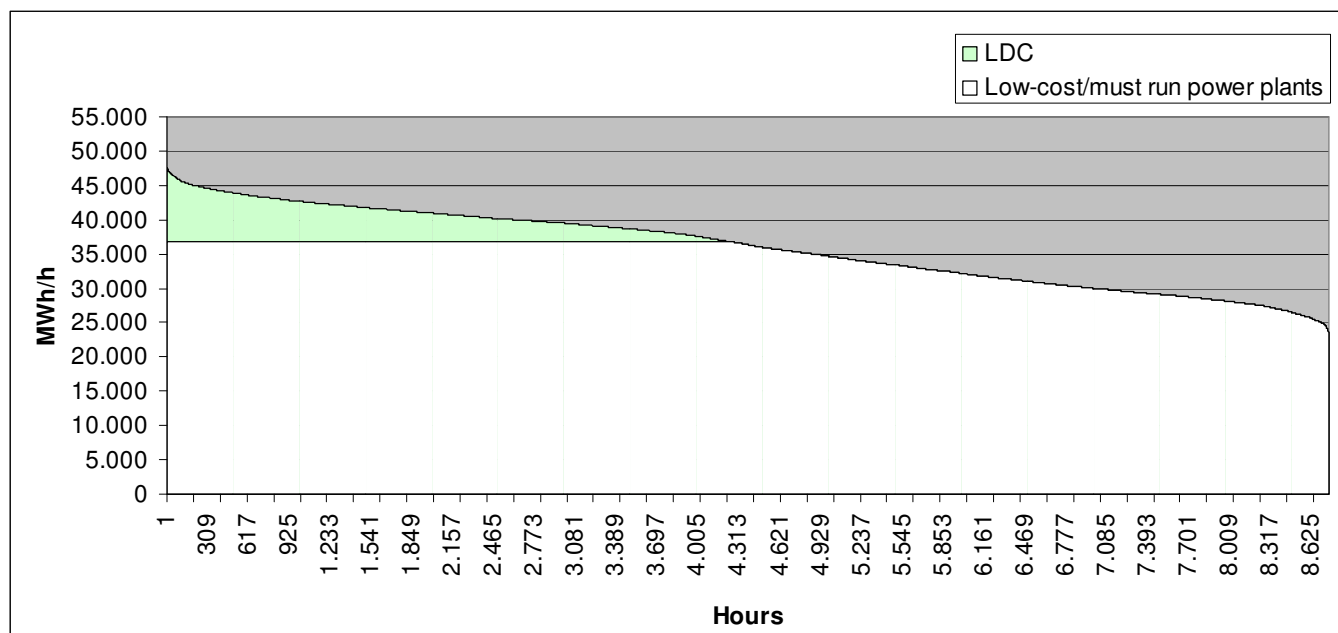

**Figure 3.** Load Duration Curve corresponding to the south-southeast-midwest Brazilian grid at 2005

Full details about the necessary data to plot the load duration curves were provided to DOE.

**Annex 4**

**MONITORING INFORMATION**

-----